


120/230V 3WIRE
SOURCE

*PROTECT PANEL FROM SEWER AND OTHER GASES
ENTRY THROUGH CONDUIT WITH SEAL-OFF FITTINGS
OR OTHER APPROPRIATE METHODS.
SEWER GASES WILL DESTROY INTERNAL COMPONENTS*

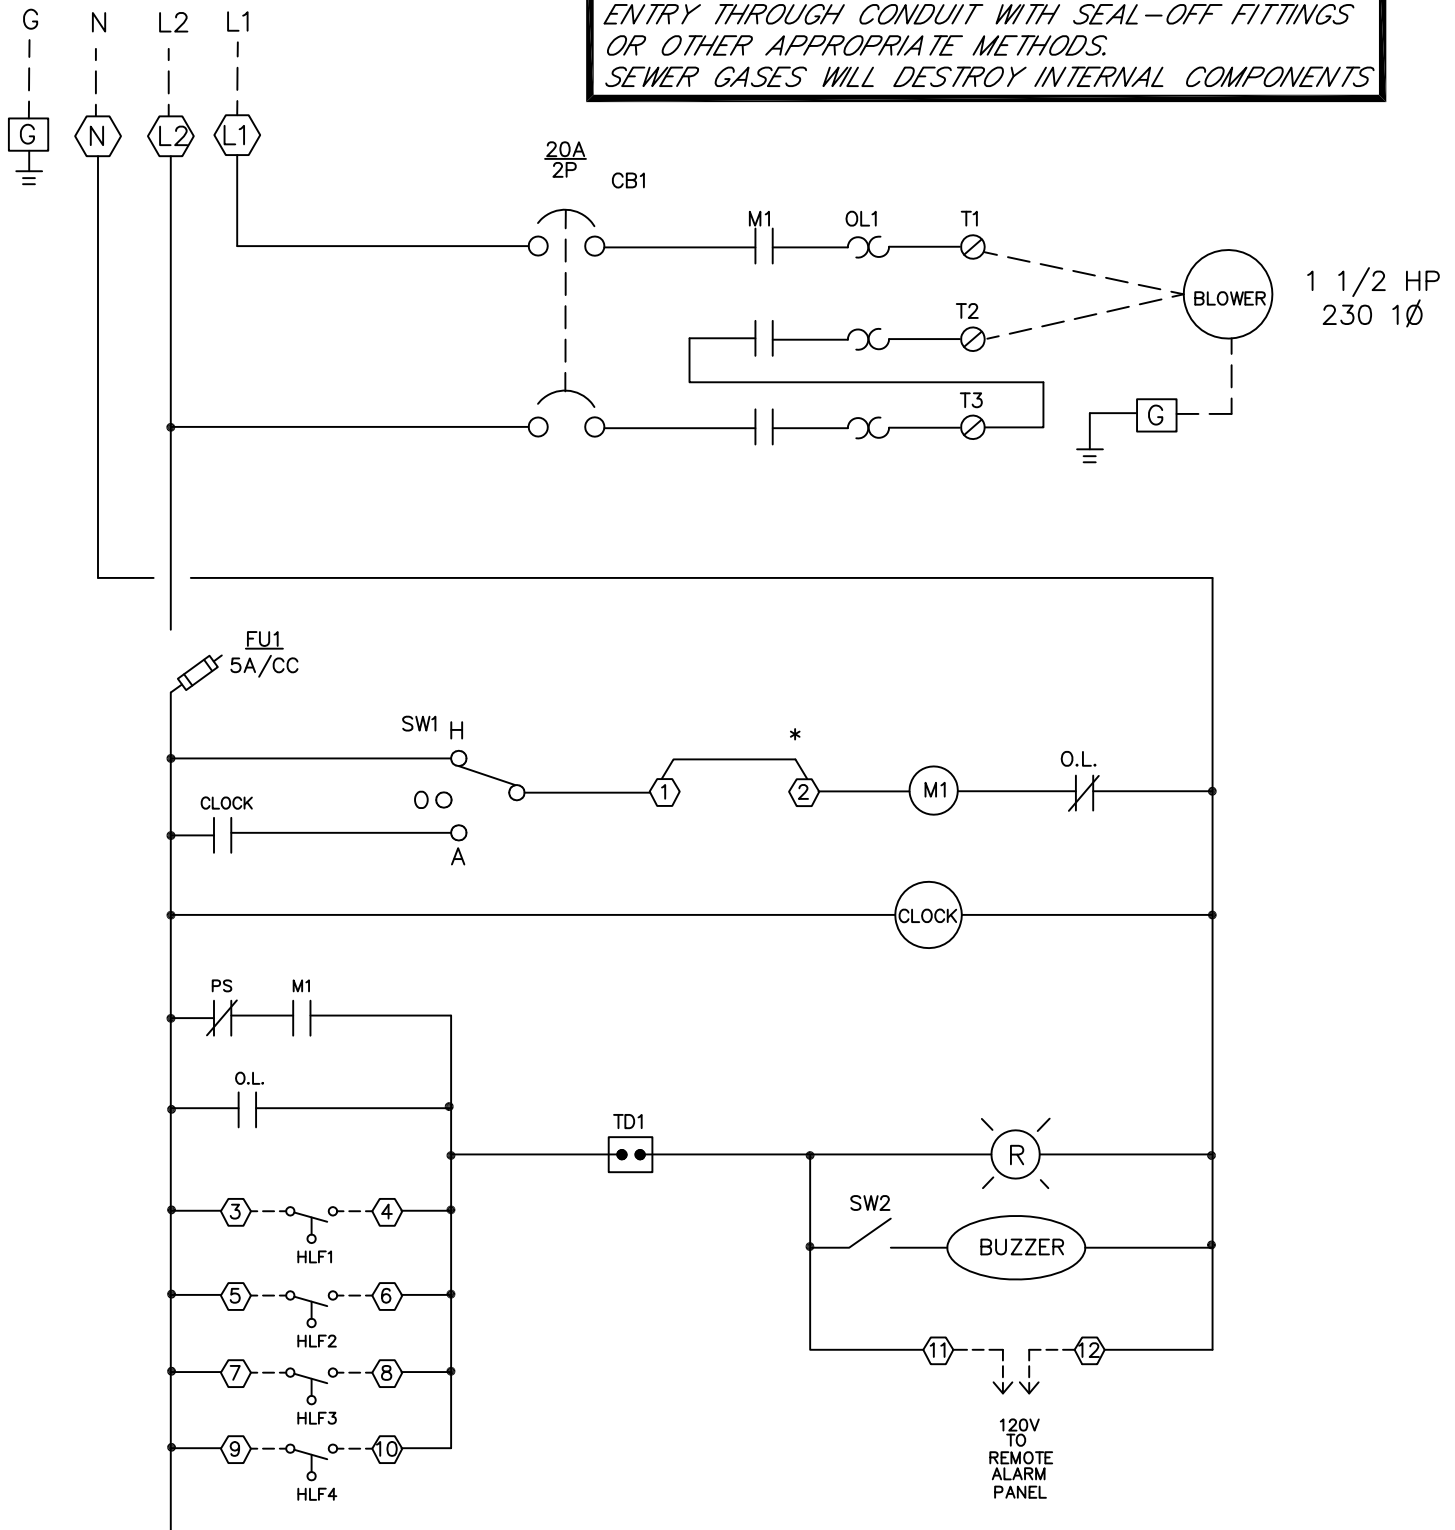

* REMOVE JUMPERS AND INSTALL LOCKOUT DEVICES IF REQUIRED

CLOCK - PINS OUT= TIME THAT COMPRESSOR WILL BE ON
PINS IN= TIME THAT COMPRESSOR WILL BE OFF

ON CLOCK MAKE SURE THAT THE MANUAL-AUTO-OFF LEVER
IS IN THE CENTER POSITION (AUTO).

⬡ DENOTES PANEL TERMINAL
-- DENOTES FIELD WIRING

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-1551Ar1
7/31/06