





Delta Process Equipment, Inc.

HIGH LEVEL ALARM  
CONTROL PANEL

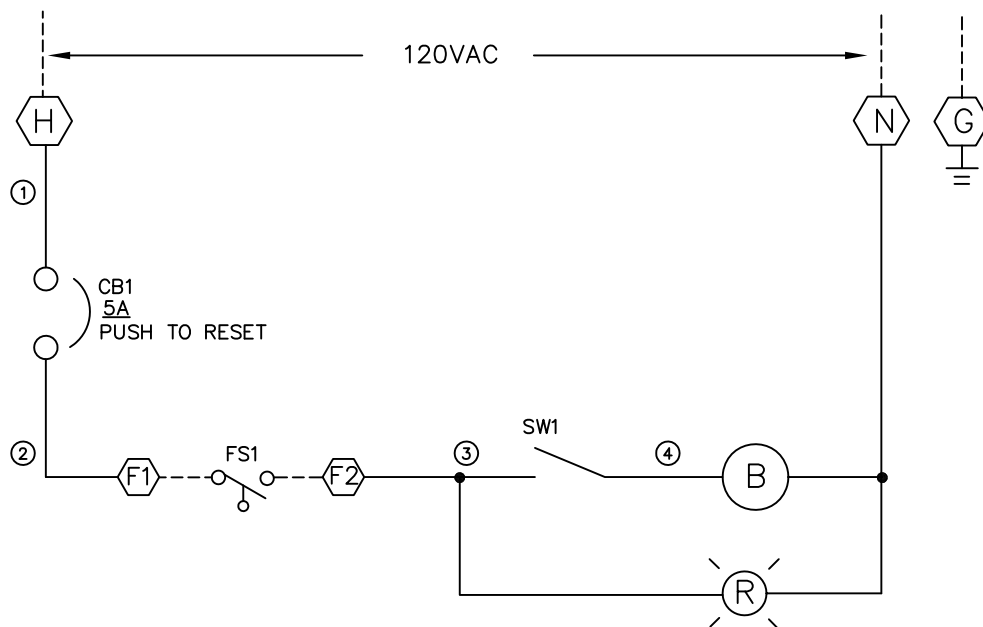



	Drawing Title							
	POWER DIAGRAM							
3/23/04 5/27/04		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	
		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL	APPROVED BY	DATE	
	Project Title	PURCHASE ORDER NUMBER						
	HIGH LEVEL ALARM CONTROL PANEL	DRAWING NUMBER CP-1814						
		SHEET NUMBER				1		


**Delta Process Equipment, Inc.**

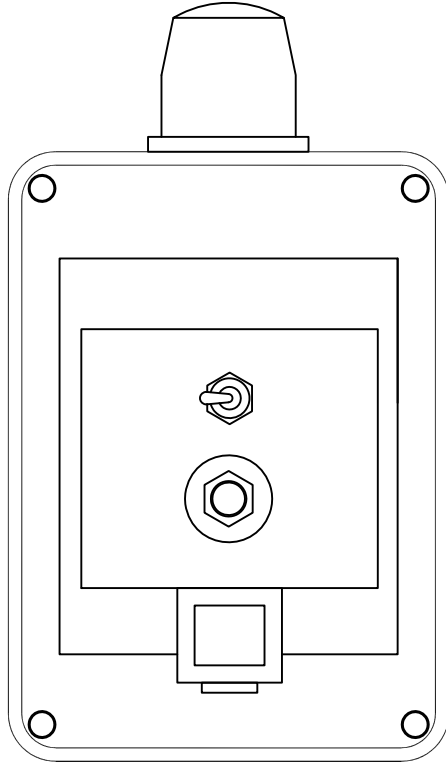

**NOTE:**  
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.  
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE  
PANEL TO PREVENT ENTRY OF GASSES.


	Drawing Title						
	ENCLOSURE						
DATE		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
5/27/04		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY CTR	APPROVED BY	DATE
	Project Title					PURCHASE ORDER NUMBER	
	HIGH LEVEL ALARM CONTROL PANEL					DRAWING NUMBER	
						CP-1814	
						SHEET NUMBER	
						2	

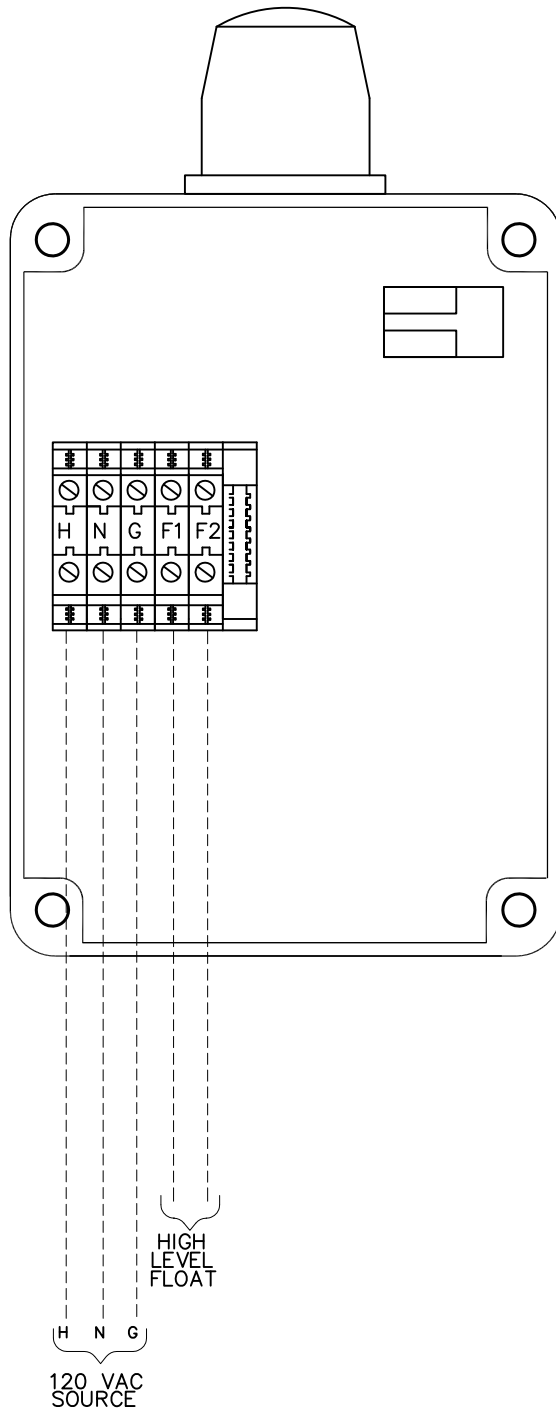

	Drawing Title							
	EXTERNAL CONNECTIONS							
DATE		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	
5/31/04		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C.RACHAL	APPROVED BY	DATE	
	Project Title					PURCHASE ORDER NUMBER		
	HIGH LEVEL ALARM CONTROL PANEL	 Delta Process Equipment, Inc.				DRAWING NUMBER CP-1814		
						SHEET NUMBER 3		

# BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	ABB	12644	ENCLOSURE
2	1	JOMEX	5A	CB1
3	1	U.S. CONTROLS		BUZZER
4	1	C.D.I.	R10-S-10	ALARM LIGHT
5	5	WEIDMULLER	WDU	TERMINAL BLOCKS
6				
7				
8				
9				
10				

	Drawing Title							
	BILL OF MATERIALS							
DATE 5/2704		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN	DATE	BY	
				DRAWN BY C. RACHAL	APPROVED BY	DATE		
	Project Title	 <b>Delta Process Equipment, Inc.</b>					PURCHASE ORDER NUMBER	
	HIGH LEVEL ALARM CONTROL PANEL						DRAWING NUMBER CP-1814	
							SHEET NUMBER 4	