

---

---

# COX

Research and Technology, Inc.

---

---

## DUPLEX PUMP CONTROL PANEL

Cox Research and Technology, Inc.  
14697 S. Harrells Ferry Road  
Baton Rouge, LA. 70816  
(225) 756-3271 Fax (225) 755-1030

CP-1430

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	3/60	
NO. MOTORS	2	
HP	7.5	
FLA	23	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	Meyers	
CATALOG NUMBER		

CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	No	(Yes, No)
CAPACITOR WIRING FIGURE	N/A	
THERM. & SEAL FAIL WIRING FIGURE		

OPTIONS:


SEAL FAIL LIGHTS	X	(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER	X	
ELAPSED TIME METER	X	
PHASE MONITOR	X	
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		

SOLD TO: Delta Process - Bossier City, LA


TAG : ABC

SHIP TO: Delta Process - Bossier City, LA


	Drawing Title						
	PANEL DESCRIPTION						
DATE 6/17/02		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY CTR	ECN	DATE
	Project Title	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1430
							SHEET NUMBER 1

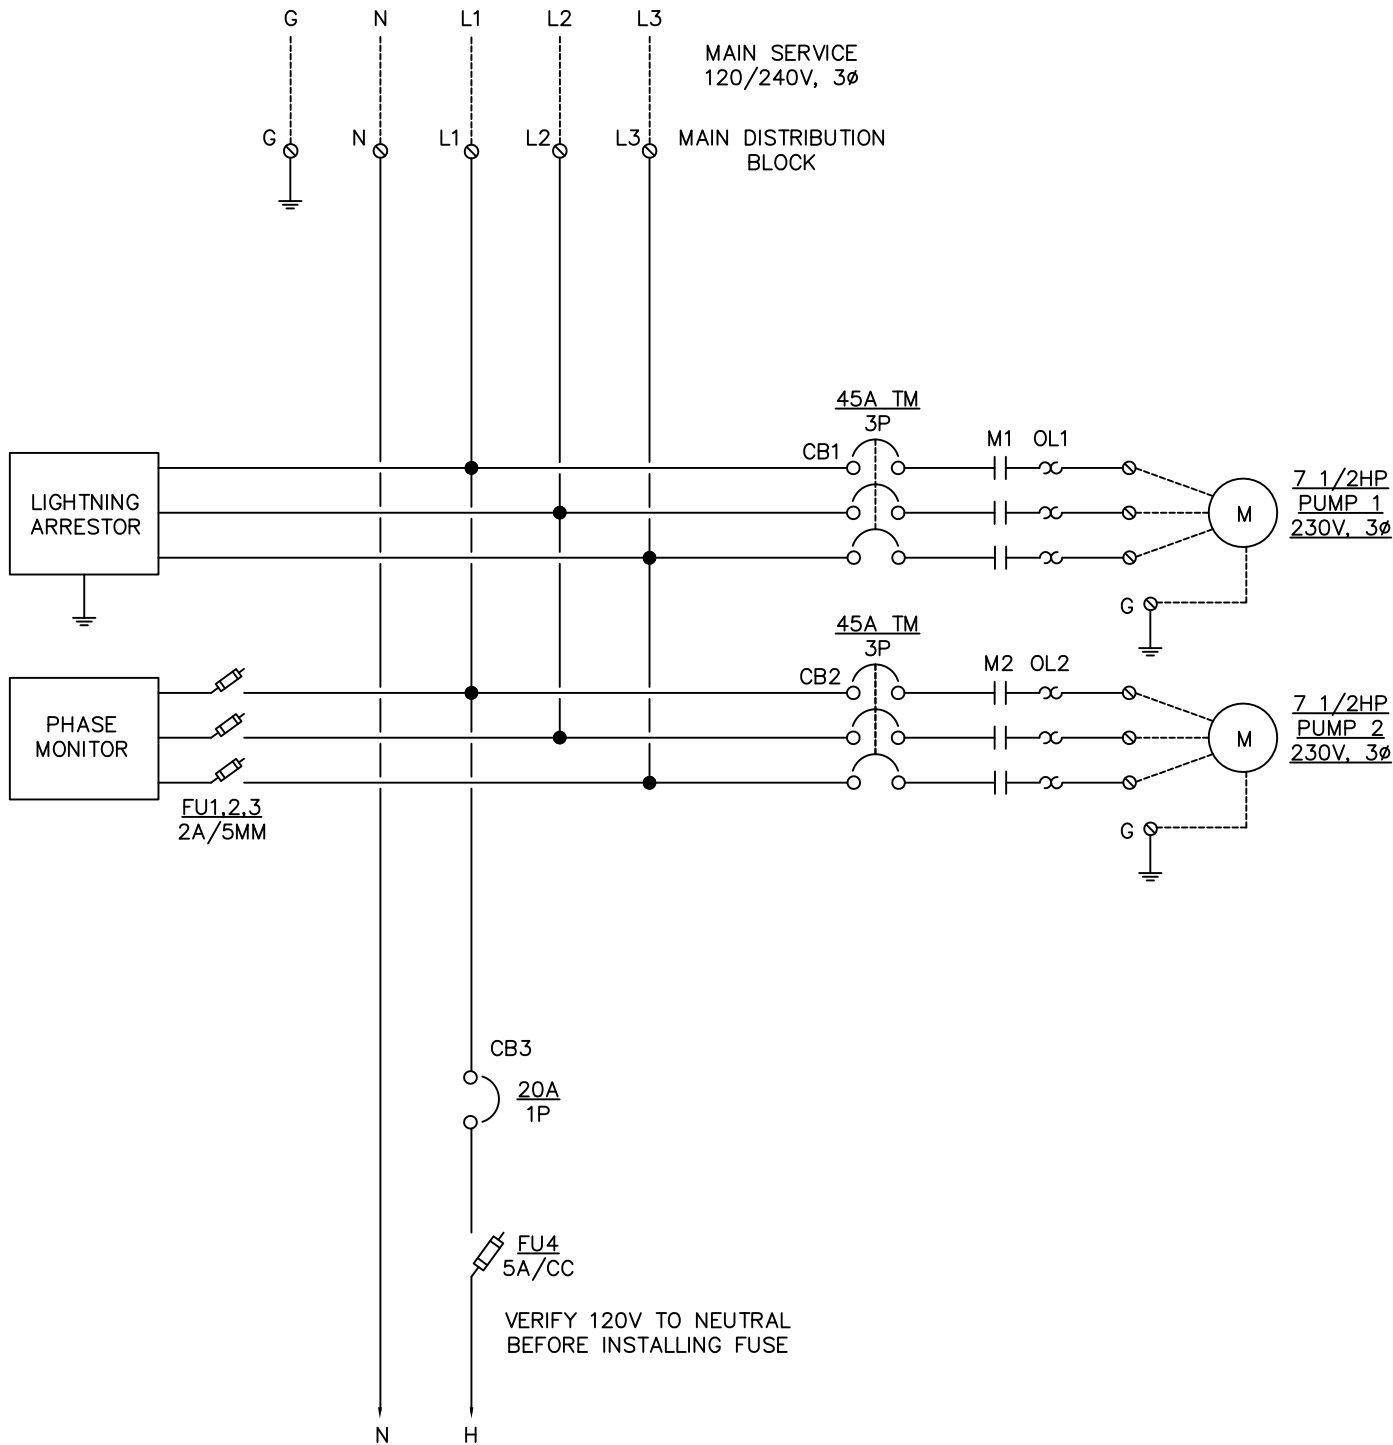

	Drawing Title								
	POWER DIAGRAM								
DATE 6/17/02		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY		
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY	CTR	BY	DATE	
	Project Title				PURCHASE ORDER NUMBER				
	DUPLEX PUMP CONTROL PANEL	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809  Ph. (225)756-3271 Fax (225)756-1030			DRAWING NUMBER CP-1430	
					SHEET NUMBER			2	

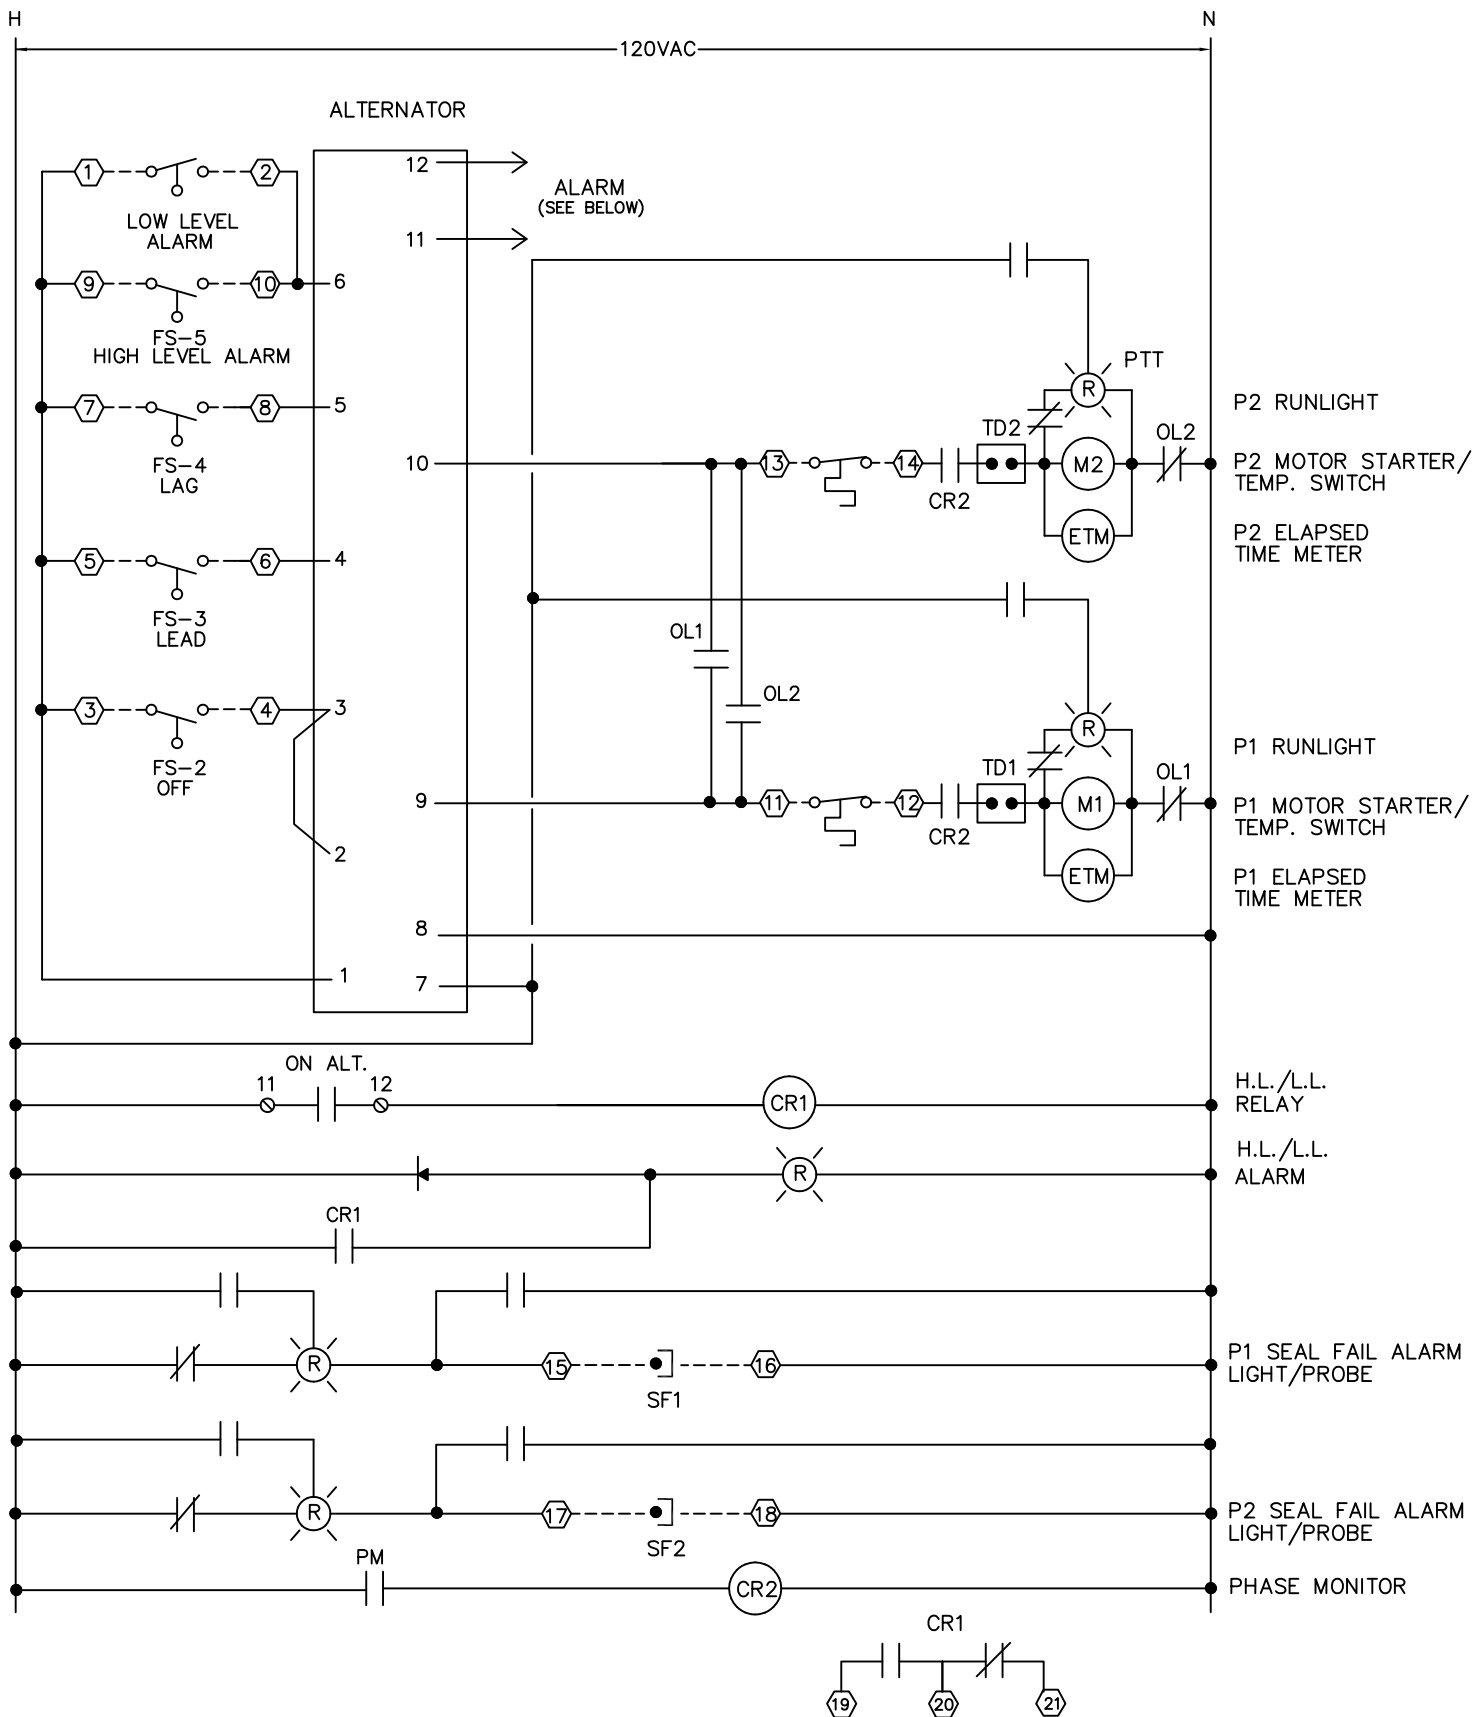

	Drawing Title   
--	---

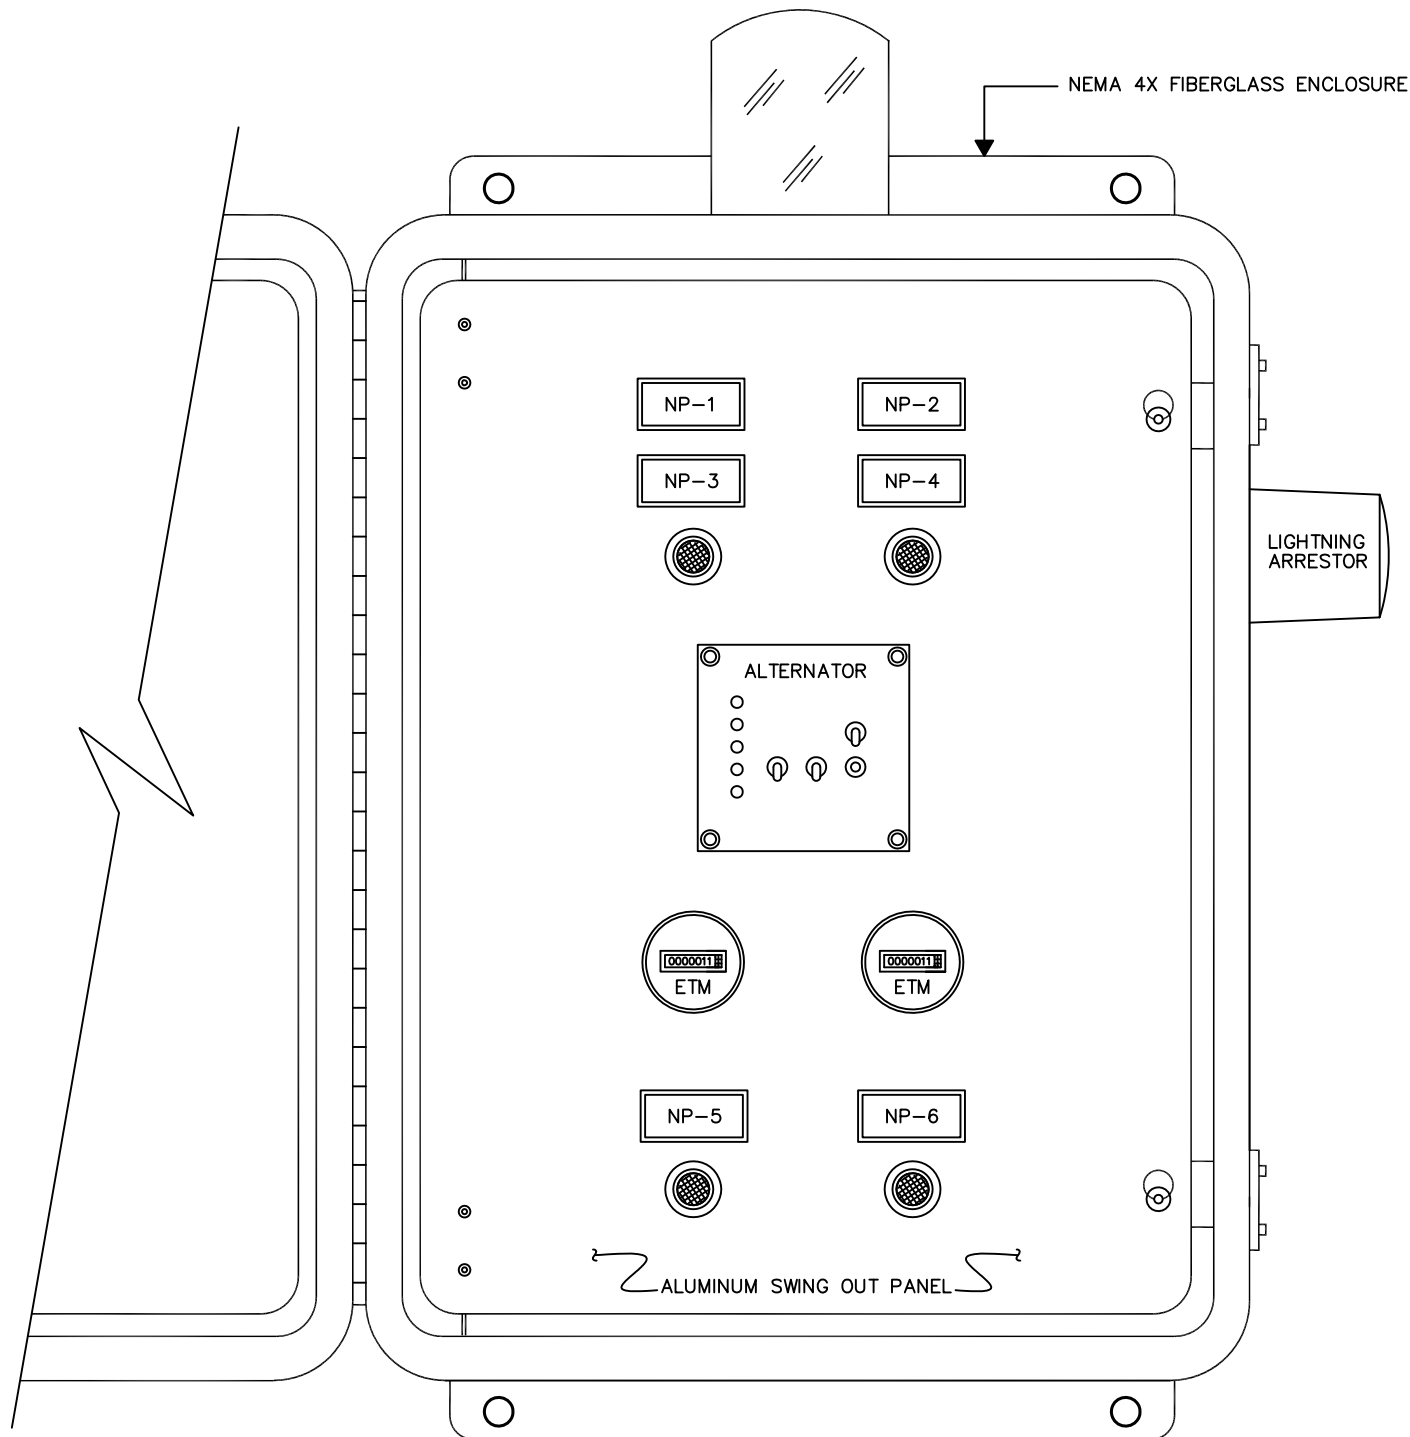

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	SEAL FAIL
NP-6	SEAL FAIL

**NOTE:**  
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.  
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE  
PANEL TO PREVENT ENTRY OF GASSES.

DATE 6/17/02	Drawing Title							
	ENCLOSURE							
Project Title		REFERENCE DRAWING		NO.		REVISION-LOCATION		ECN
		S/N		Sales Engineer		Application Engineer		DATE
				C.C.		R.C.		BY
						DRAWN		APPROVED
						BY		DATE
								PURCHASE ORDER NUMBER
								DRAWING NUMBER
								CP-1430
								SHEET NUMBER
								4

# BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	1	MARATHON	1423570	DISTRIBUTION BLOCK
3	2	SQUARE D	QOU345	CB 1,2
4	2	ABB	A26-30-10-84	MS 1,2
5	2	ABB	TA25DU25	OL 1,2
6	1	DIVERSIFIED	ARM-120-AFEP	ALTERNATOR
7	1	SSAC	PLMU11	P.M.
8	1	CH	CHSA03	LIGHTNING ARRESTER
9	2	GRASSLIN	UWZ52E	ELAPSED TIME METER
10	1	SQUARE D	QOU120	CB 3
11	2	ACI	JR22FR	PILOT LIGHT RED
12	2	DAYTON	2A561	TIME DELAY RELAY
13	2	GRASSLIN	UWZ52E	ELAPSED TIME METER
14	1	AC/DC	BL5-R-120	ALARM LIGHT
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title						
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>						
DATE 6/17/02		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN	DATE	BY
	Project Title	<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 150px;"> <h1 style="margin: 0;">COX</h1> </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	<h2 style="margin: 0;">DUPLEX PUMP CONTROL PANEL</h2>	Research and Technology, Inc.			Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1430
							SHEET NUMBER 5