
COX

Research and Technology, Inc.

DUPLEX PUMP
CONTROL PANEL
DIXIE OVERLAND ROAD
BOSSIER CITY, LA

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-2079

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	3/60	
NO. MOTORS	2	
HP	5	
FLA	19	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	Barnes	
CATALOG NUMBER	4SE5094L	

CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	No	(Yes, No)
CAPACITOR WIRING FIGURE	N/A	
THERM. & SEAL FAIL WIRING FIGURE		

OPTIONS:


SEAL FAIL LIGHTS	X	(Submersible Only)
SEAL FAIL RELAYS	X	(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER	X	
ELAPSED TIME METER	X	
PHASE MONITOR	X	
NEMA RATED STARTERS		
GROUND FAULT RECPT.	X	
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		

SOLD TO: Delta Process - Bossier City, LA


TAG : DIXIE OVERLAND ROAD

SHIP TO: Delta Process - Ruston, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 6/10/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div style="text-align: center;"> COX Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-2079
							SHEET NUMBER 1

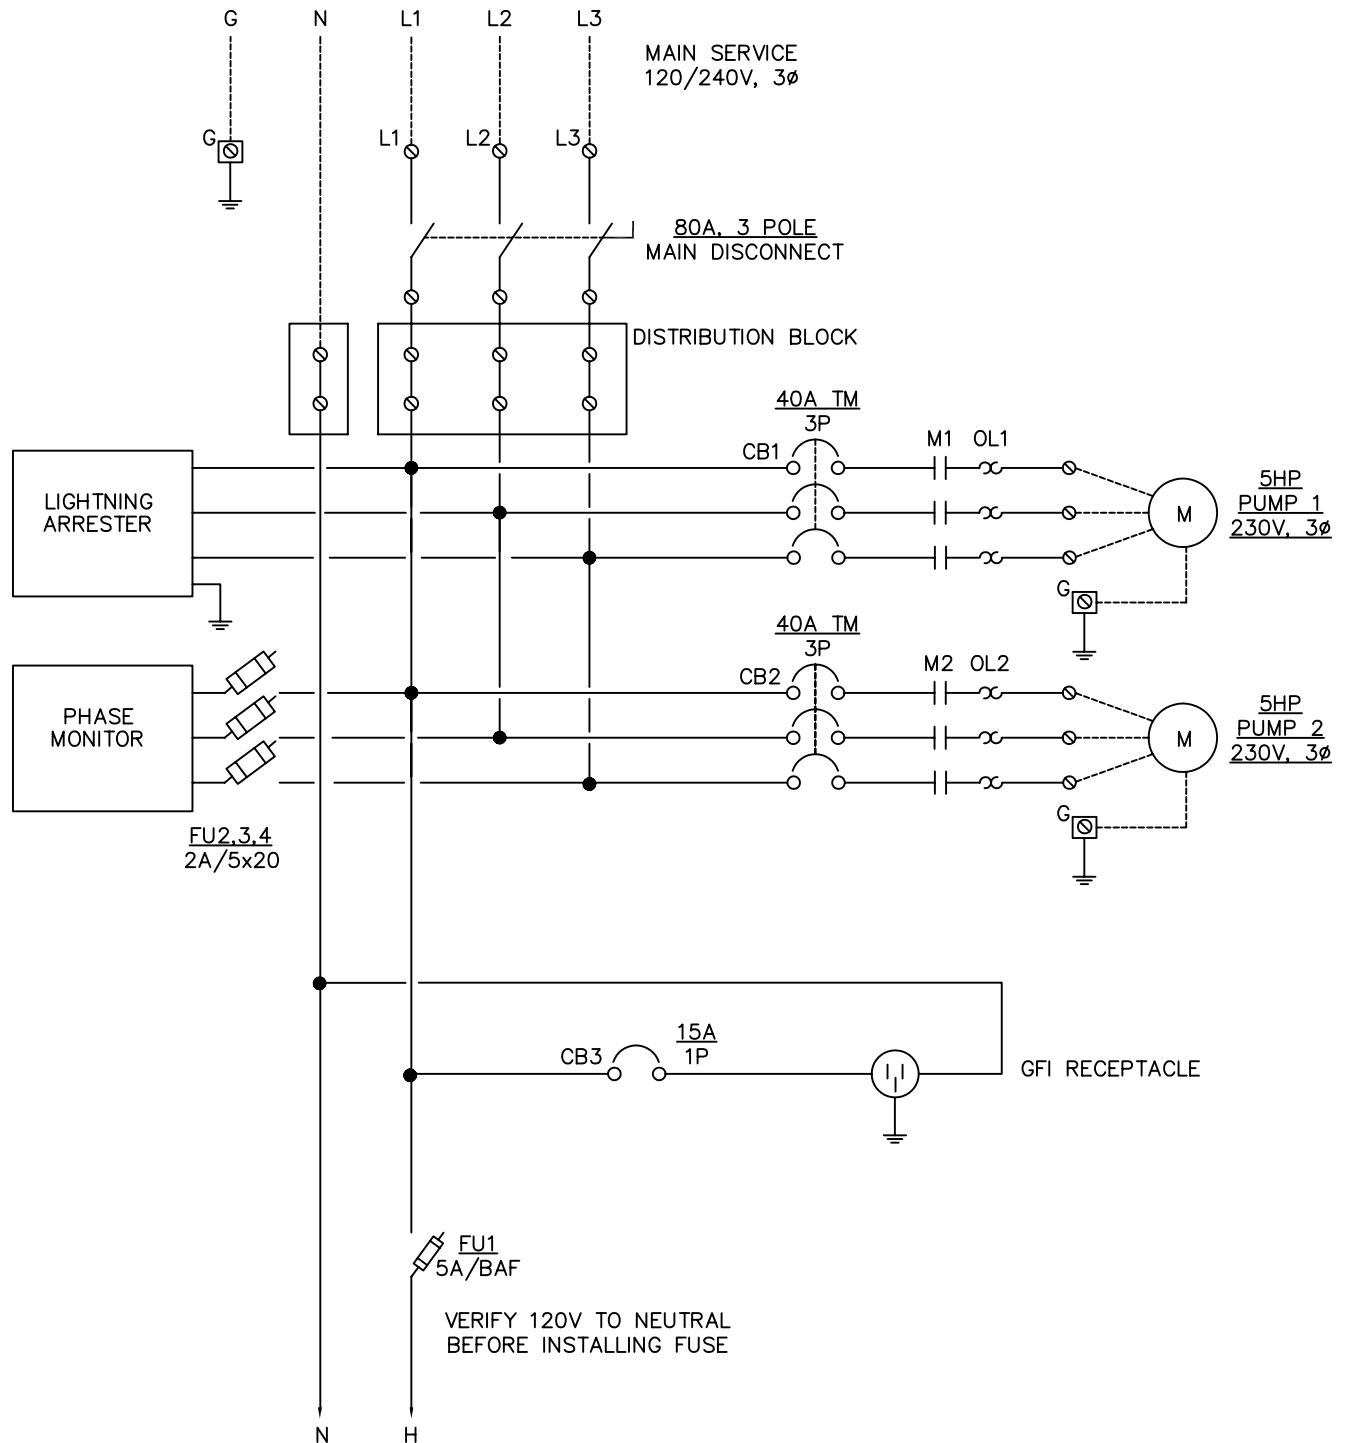

	Drawing Title							
	POWER DIAGRAM							
DATE 6/10/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
	Project Title	COX Research and Technology, Inc.			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030	PURCHASE ORDER NUMBER		
	DUPLEX PUMP CONTROL PANEL					DRAWING NUMBER CP-2079		
						SHEET NUMBER 2		

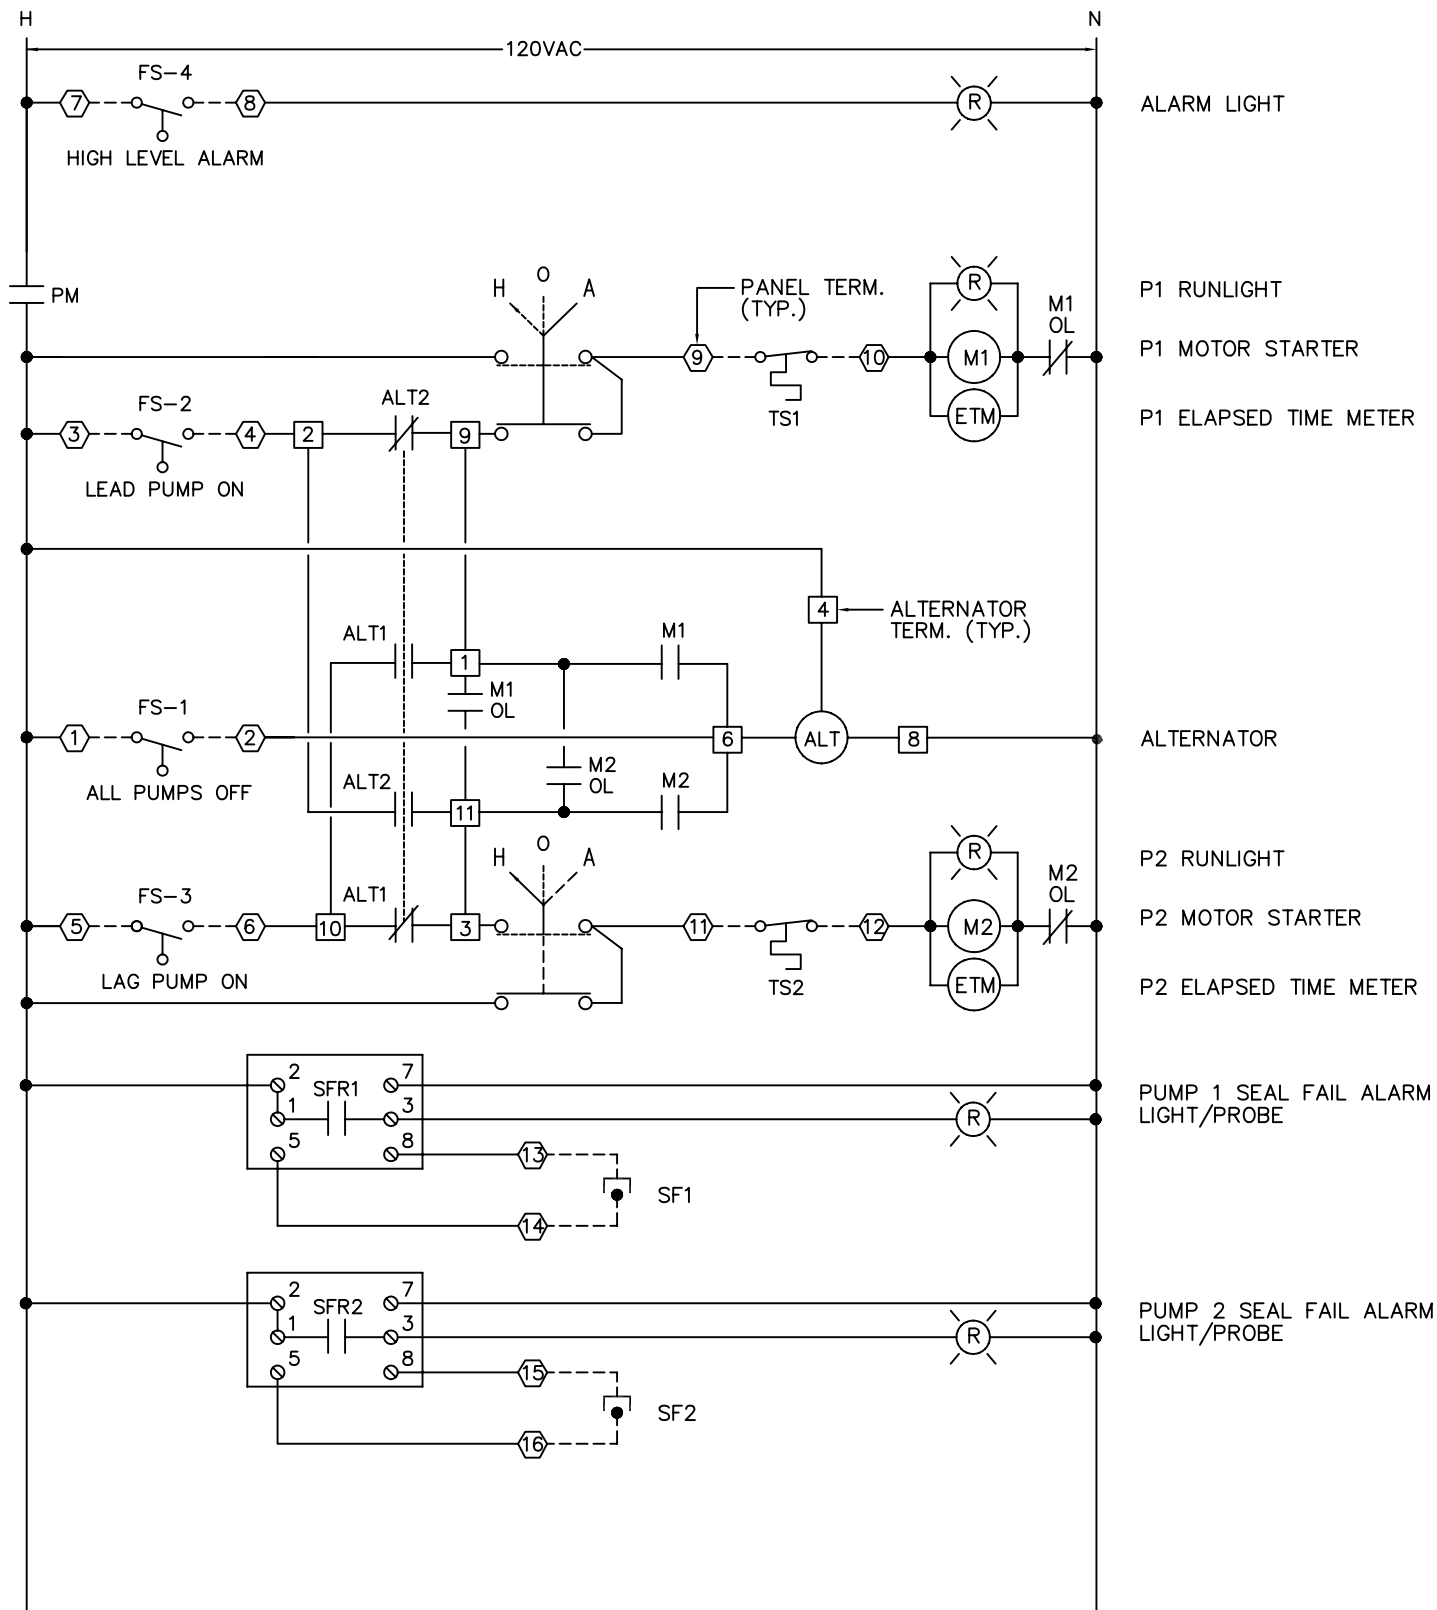


	Drawing Title								
	CONTROL DIAGRAM								
DATE 6/10/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY	APPROVED
	Project Title								PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL								DRAWING NUMBER CP-2079
									SHEET NUMBER 3

COX

Research and Technology, Inc.

P.O. Box 77808
Baton Rouge, LA
70809

Ph. (225)756-3271
Fax (225)755-1030



NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL

	Drawing Title									
	<div style="text-align: center;">ENCLOSURE</div>									
DATE 6/10/05		REFERENCE DRAWING		NO.	REVISION-LOCATION		ECN	DATE	BY	
	S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL			APPROVED BY DATE			
	Project Title				P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER				
	<div style="text-align: center;"><div>Cox & Corporation</div>DUPLEX PUMP CONTROL PANEL</div>	<div style="text-align: center;"><div>COX</div>Research and Technology, Inc.<div></div></div>			Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-2079			
							SHEET NUMBER			
							4			

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	1	ABB	OT63E3	MAIN DISC. SWITCH
3	2	ABB	A26-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU25	O.L. RELAY (18-25A)
5	2	SQUARE D	QOU340	CB1, CB2
6	1	TIMEMARK	261DT120	ALTERNATING RELAY
7	4	ACI	JR22FR	RED PILOT LIGHT
8	2	ACI	JR22P3M20B	HOA SWITCH
9	1	TOMAR	490S-120V-RED	ALARM LIGHT
10	1	MARATHON	1323580	DISTRIBUTION BLOCK
11	1	MARATHON	1321580	NEUTRAL BLOCK
12	1	SSAC	PLMU11	PHASE MONITOR
13	1	DELTA	LA603	LIGHTNING ARRESTER
14	2	REDINGTON	711-0190	ETM
15	2	SSAC	LLC54AA	SEAL FAIL RELAY
16	1	SQUARE D	QOU115	CB3
17	1	STOCK		GFI RECEPTACLE
18				
19				
20				
21				
22				
23				
24				
25				

[illegible]