

---

---

# COX

Research and Technology, Inc.

---

---

## DUPLEX PUMP CONTROL PANEL

Cox Research and Technology, Inc.  
14697 S. Harrells Ferry Road  
Baton Rouge, LA. 70816  
(225) 756-3271 Fax (225) 755-1030

CP-1471

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	1/60	
NO. MOTORS	2	
HP	2.7 HP	
FLA	11.9	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	GR	
CATALOG NUMBER	JSV 3A60-E 2.7	

CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	Yes	(Yes, No)
CAPACITOR WIRING FIGURE	G	
THERM. & SEAL FAIL WIRING FIGURE	5	

OPTIONS:

SEAL FAIL LIGHTS		(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN	X	(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER		
ELAPSED TIME METER		
PHASE MONITOR		
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION	X	

SOLD TO: Delta Process - Ruston, LA

TAG : \_\_\_\_\_

\_\_\_\_\_


SHIP TO: Delta Process - Ruston, LA

\_\_\_\_\_

\_\_\_\_\_

	Drawing Title						
	PANEL DESCRIPTION						
DATE 9/20/02		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY CTR	ECN	DATE
	Project Title	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1471
							SHEET NUMBER 1



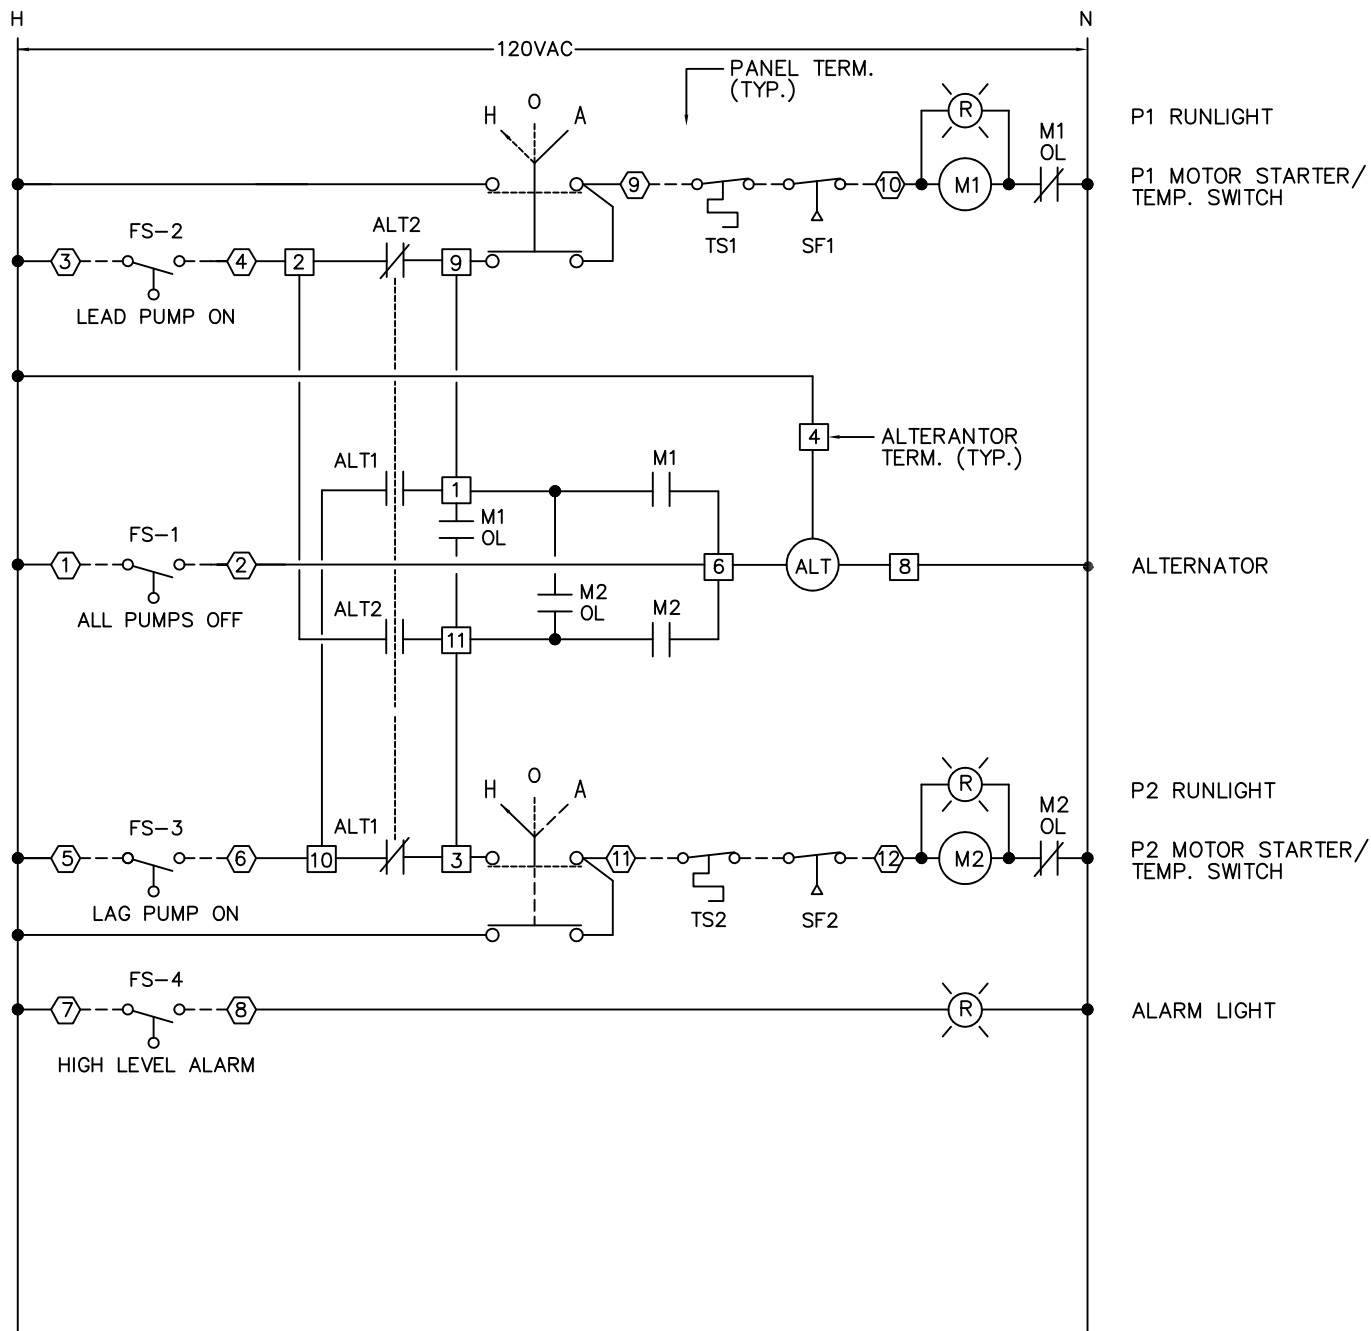


	Drawing Title								
	CONTROL DIAGRAM								
DATE	9/20/02	REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY		
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY	CTR	APPROVED		
	Project Title							PURCHASE ORDER NUMBER	
	DUPLEX PUMP CONTROL PANEL							DRAWING NUMBER CP-1471	
								SHEET NUMBER	3

**COX**

Research and Technology, Inc.

P.O. Box 77808  
Baton Rouge, LA  
70809

Ph. (225)756-3271  
Fax (225)756-1030

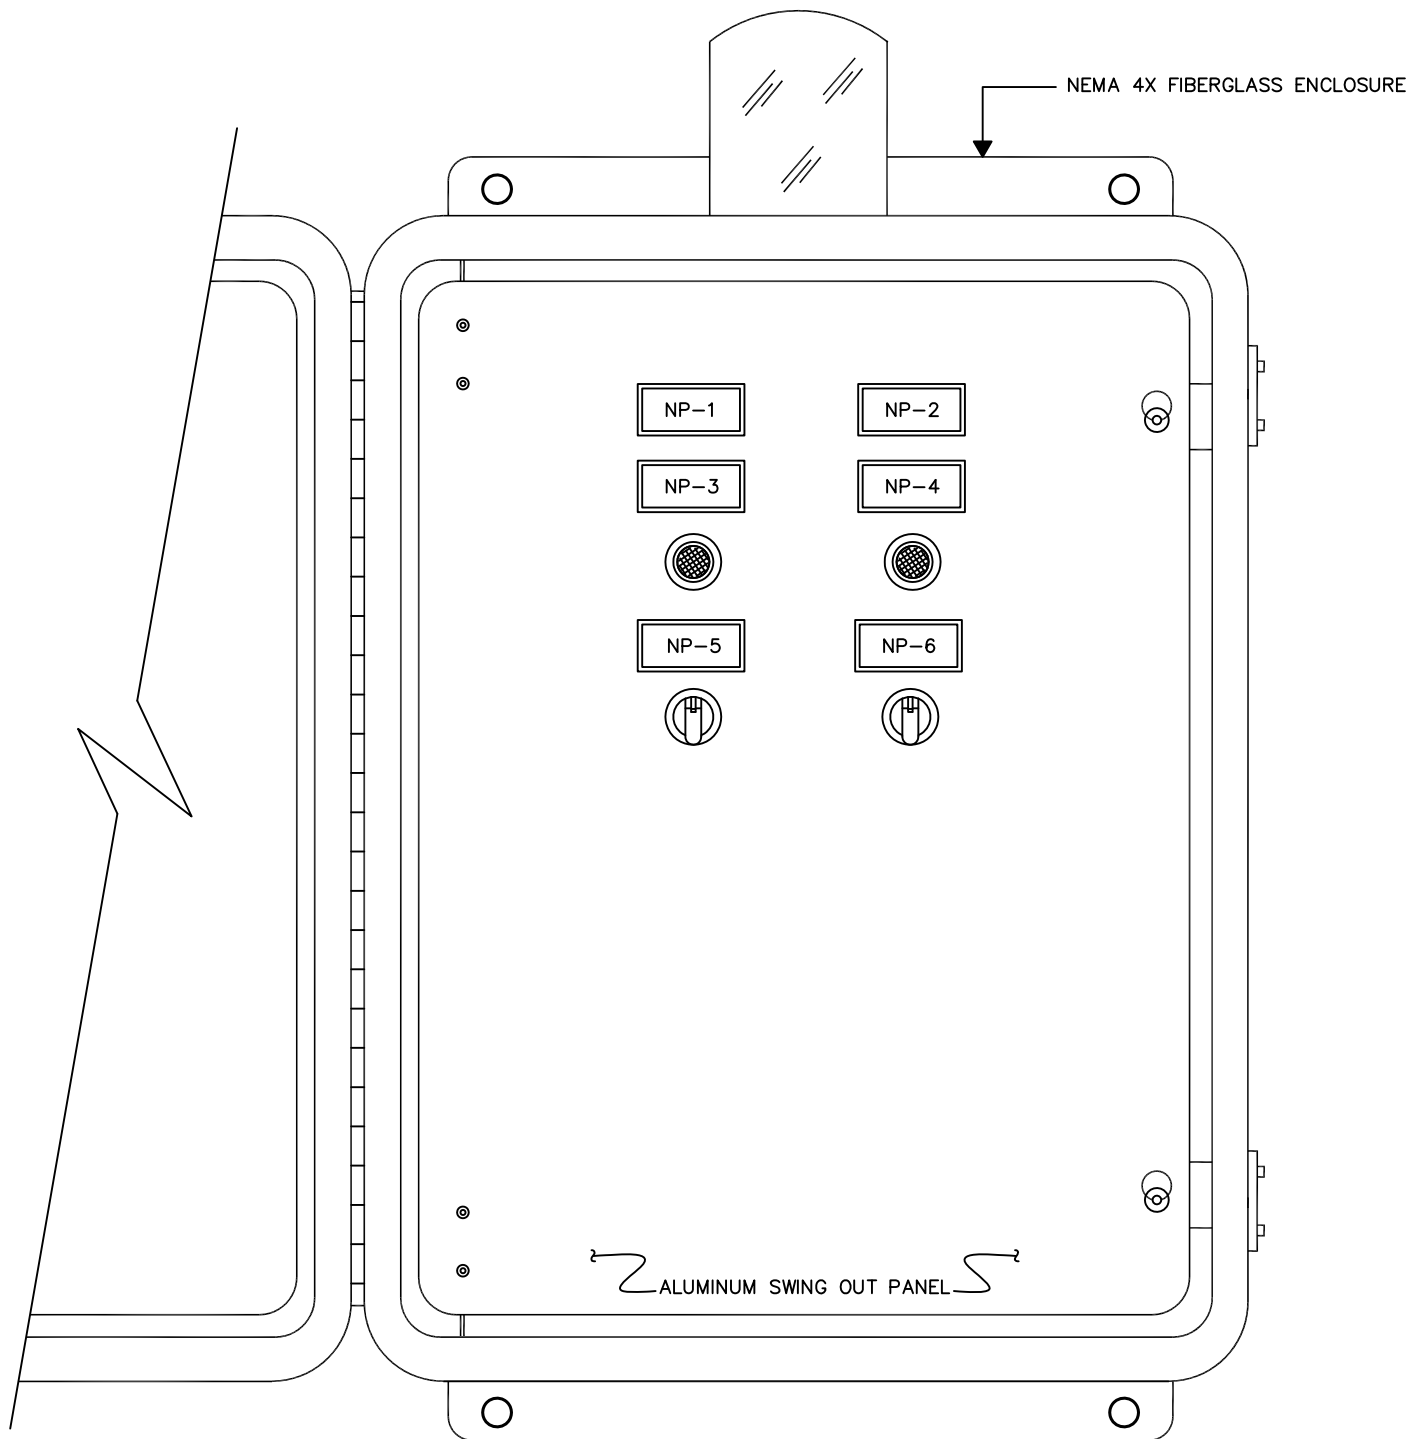

**NOTE:**  
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.  
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE  
PANEL TO PREVENT ENTRY OF GASSES.

#### NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA

DATE 9/20/02	Drawing Title								
	ENCLOSURE								
	Project Title		REFERENCE DRAWING		NO.		REVISION-LOCATION		ECN
	DUPLEX PUMP CONTROL PANEL		S/N		Sales Engineer C.C.		Application Engineer R.C.		DATE
							DRAWN		BY
									DATE
									PURCHASE ORDER NUMBER
									DRAWING NUMBER
									CP-1471
									SHEET NUMBER
									4

# BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	2	ABB	A16-30-10-84	MOTOR STARTER
3	2	ABB	TA25DU14	O.L. RELAY (10-14A)
4	2	SQUARE D	QOU225	CB1, CB2
5	1	TIMEMARK	261DT120	ALTERNATING RELAY
6	2	ACI	JR22FR	RED PILOT LIGHT
7	2	ACI	JR22P3M20B	HOA SWITCH
8	1	AC/DC	BL5-R-120	ALARM LIGHT
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title						
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>						
DATE		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
9/20/02		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY CTR	APPROVED BY	DATE
	Project Title	<div style="border-top: 3px double black; border-bottom: 3px double black; padding: 5px 0;"> <h1 style="margin: 0;">COX</h1> </div> <div style="margin-top: 5px;">Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809  Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER  DRAWING NUMBER <div style="text-align: right;">CP-1471</div> SHEET NUMBER <div style="text-align: right;">5</div>
	<h2 style="margin: 0;">DUPLEX PUMP CONTROL PANEL</h2>						