
COX

Research and Technology, Inc.

DUPLEX PUMP
CONTROL PANEL
BUCK KREIHS
TODD YARD LIFT STATION

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP1560

VOLTAGE	<u>277/480V</u>	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	<u>3/60</u>	
NO. MOTORS	<u>2</u>	
HP	<u>2</u>	
FLA	<u>4.2</u>	
TYPE OF PUMP	<u>Submersible</u>	(Self-Priming, Submersible)
MANUFACTURER	<u>Meyers</u>	
CATALOG NUMBER	<u>WG20</u>	
CONTROL VOLTAGE	<u>120V</u>	(120V, Other)
ENCLOSURE	<u>NEMA 4X</u>	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	<u>Fiberglass</u>	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	<u>Floats</u>	(Floats, Bubbler, Other)
CAPACITORS	<u>No</u>	(Yes, No)
CAPACITOR WIRING FIGURE	<u>N/A</u>	
THERM. & SEAL FAIL WIRING FIGURE	<u>1, 6, 8</u>	

OPTIONS:


SEAL FAIL LIGHTS	<u>X</u>	(Submersible Only)
SEAL FAIL RELAYS	<u> </u>	(Submersible Only)
SEAL FAIL PUMP SHUTDOWN	<u> </u>	(Submersible Only)
HT PUMP SHUTDOWN	<u>X</u>	(Self-Primer, Submersible)
ALARM HORN	<u> </u>	
ALARM LIGHT	<u>X</u>	
LIGHT PANEL MTD	<u>X</u>	
LIGHT REMOTE MTD	<u>X</u>	
LIGHT FLASHER	<u> </u>	
LIGHTNING ARRESTER	<u>X</u>	
ELAPSED TIME METER	<u> </u>	
PHASE MONITOR	<u>X</u>	
NEMA RATED STARTERS	<u> </u>	
GROUND FAULT RECPT.	<u> </u>	
GREEN RUN LIGHTS VS. RED	<u> </u>	
POLE, BOX, SEAL	<u> </u>	
INTRINSICALLY SAFE RELAYS	<u> </u>	
HIGH TEMP. LOCKOUT, MANUAL RESET	<u> </u>	
ECONOMY VERSION	<u> </u>	


SOLD TO: Delta Process - New Orleans, LA

TAG : BUCK KREIHS


TODD YARD LIFT STATION

SHIP TO: Delta Process - Denham Springs, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 5/02/03		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div style="text-align: center;">  COX Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP1560
							SHEET NUMBER 1

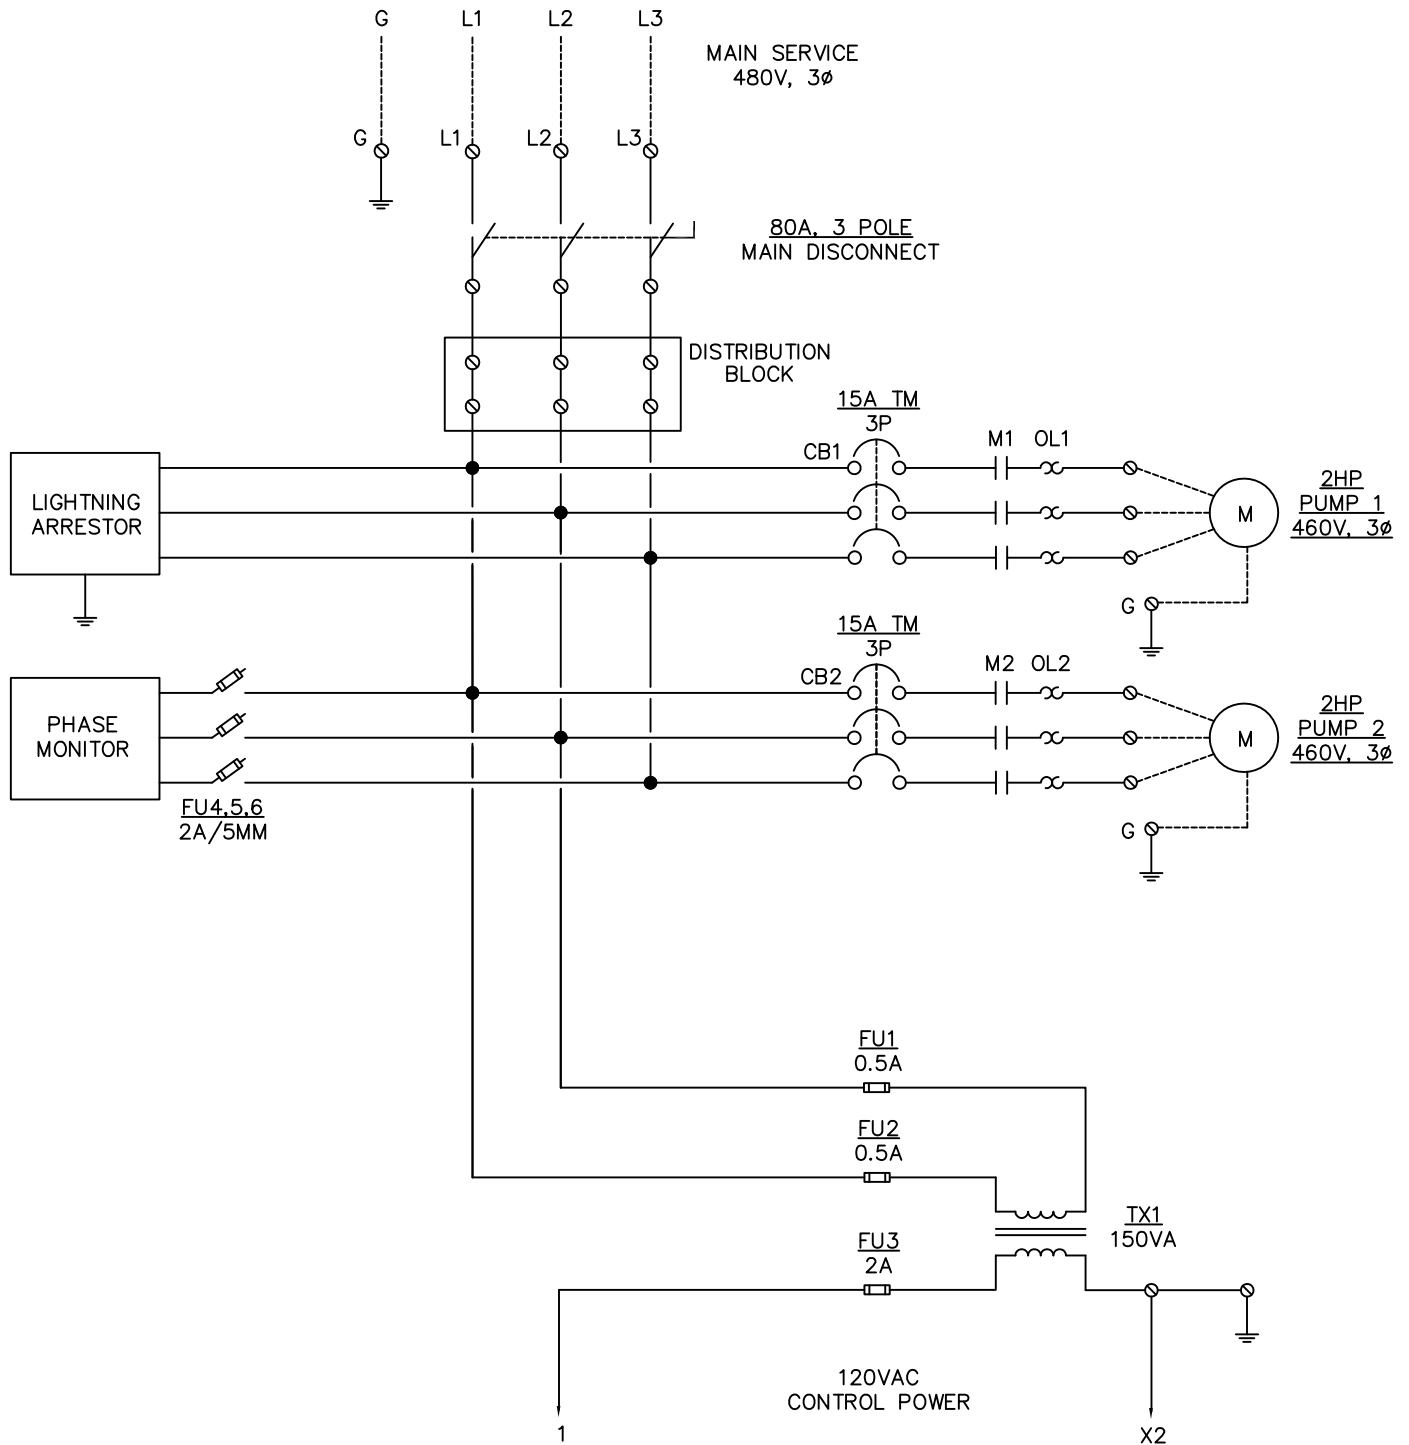

	Drawing Title								
	POWER DIAGRAM								
DATE	5/02/03	REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	APPROVED	
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	BY	DATE		
	Project Title	COX			P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER			
	DUPLEX PUMP CONTROL PANEL	Research and Technology, Inc.			Ph. (225)756-3271 Fax (225)756-1030	DRAWING NUMBER CP1560			
						SHEET NUMBER 2			

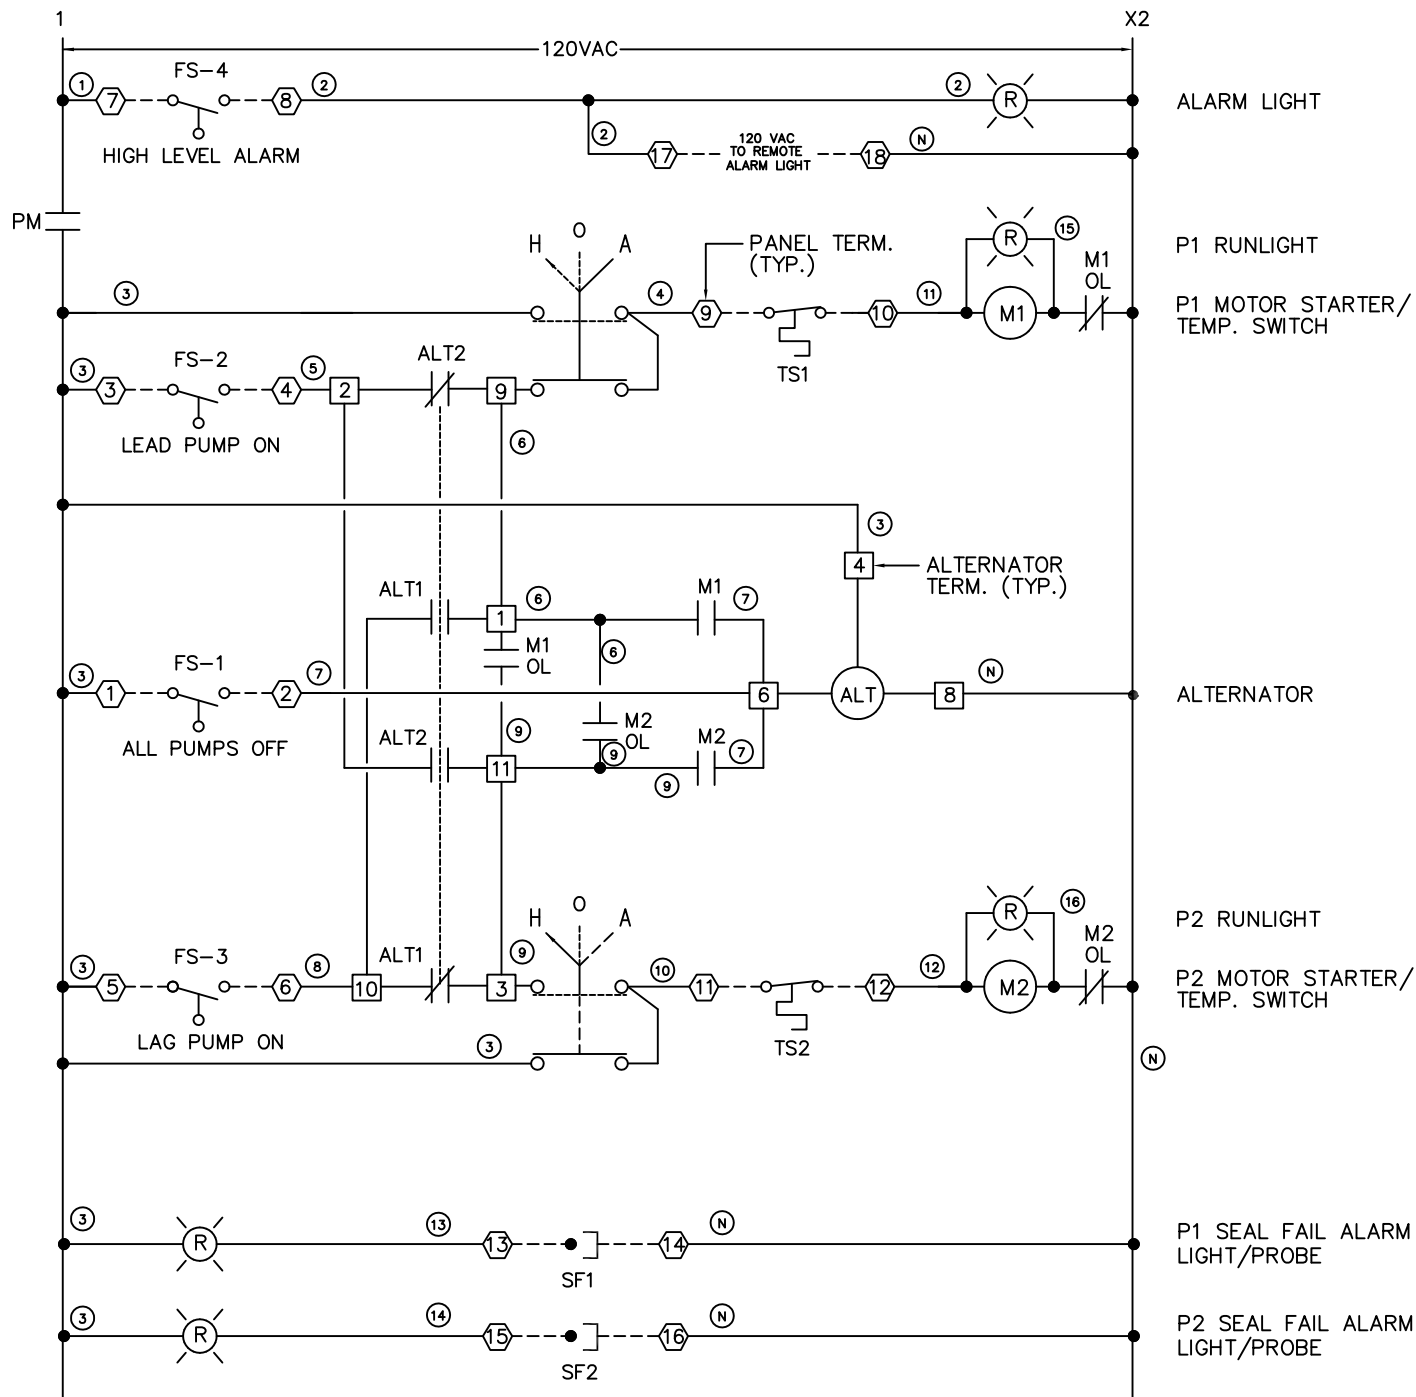


	Drawing Title								
	CONTROL DIAGRAM								
DATE	5/02/03	REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	APPROVED	
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL				
	Project Title							PURCHASE ORDER NUMBER	
	DUPLEX PUMP CONTROL PANEL							DRAWING NUMBER CP1560	
								SHEET NUMBER	3

COX

Research and Technology, Inc.

P.O. Box 77808
Baton Rouge, LA
70809

Ph. (225)756-3271
Fax (225)756-1030

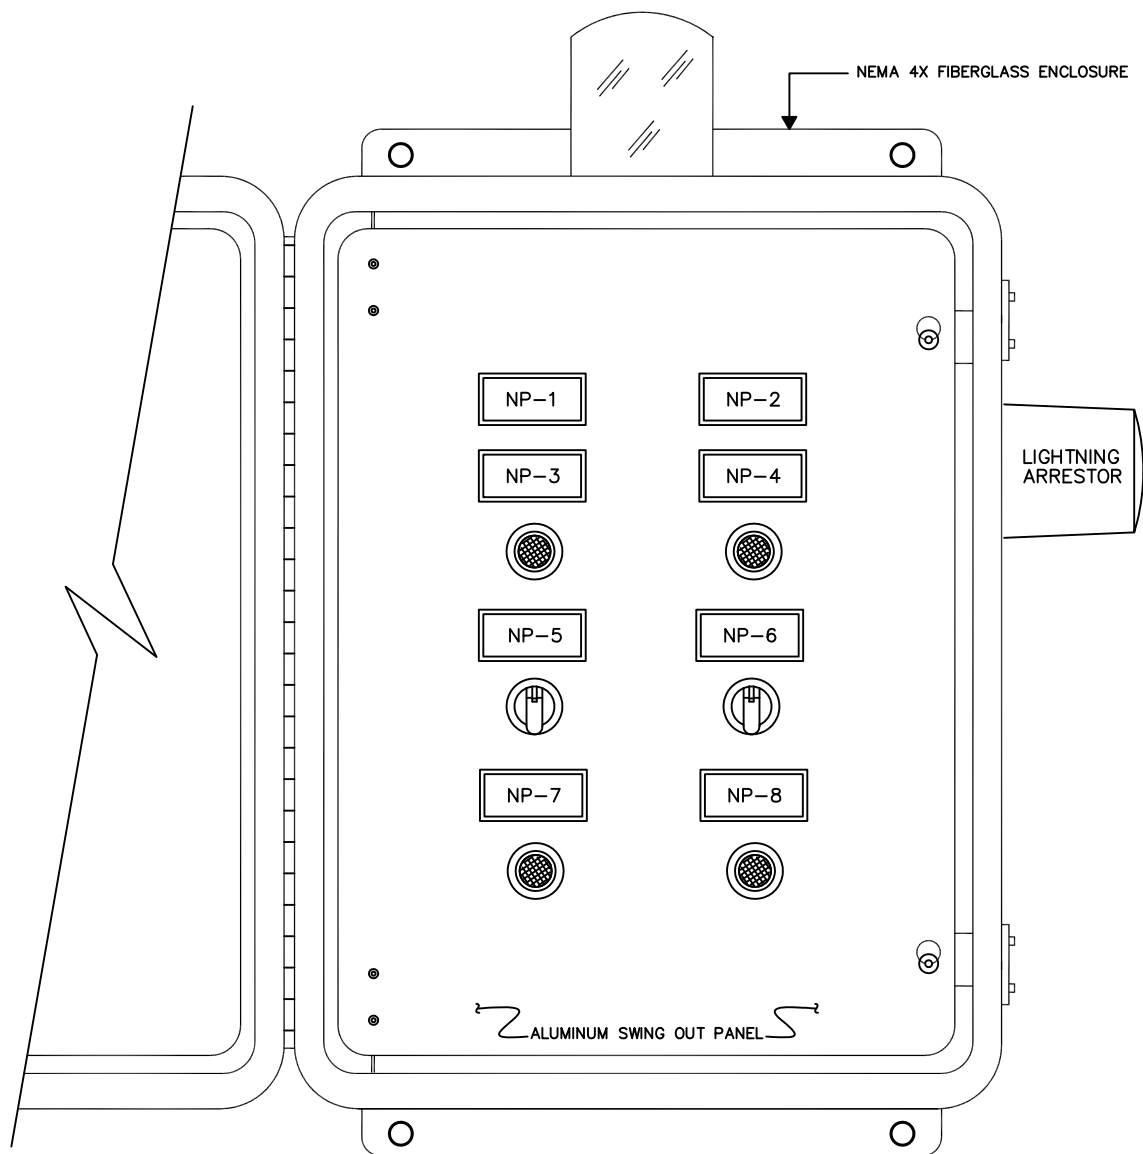

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL

NOTE:
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

DATE 5/02/03	Drawing Title							
	ENCLOSURE							
		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	
	Project Title	S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	APPROVED	BY	DATE
	DUPLEX PUMP CONTROL PANEL	<div style="text-align: center;"> COX Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030	PURCHASE ORDER NUMBER		
						DRAWING NUMBER CP1560		
						SHEET NUMBER 4		

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HWPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	1	ABB	OT63E3	MAIN DISC. SWITCH
3	2	ABB	A16-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU5.0	O.L. RELAY (3.5-5A)
5	2	ABB	S1N015TL	CB1, CB2
6	1	TIMEMARK	261DT120	ALTERNATING RELAY
7	4	ACI	JR22FR	RED PILOT LIGHT
8	2	ACI	JR22P3M20B	HOA SWITCH
9	1	SQUARE D	9070TF150D1	TRANSFORMER
10	1	AC/DC	BL5-R-120	ALARM LIGHT
11	1	C-H	CHSA03	LIGHTNING ARRESTER
12	1	SSAC	PLMU-11	PHASE MONITOR
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				

	Drawing Title						
	BILL OF MATERIALS						
DATE 5/02/03		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN	DATE	BY
	Project Title	<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 150px;"> COX Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER DRAWING NUMBER CP1560 SHEET NUMBER 5
	DUPLEX PUMP CONTROL PANEL						