



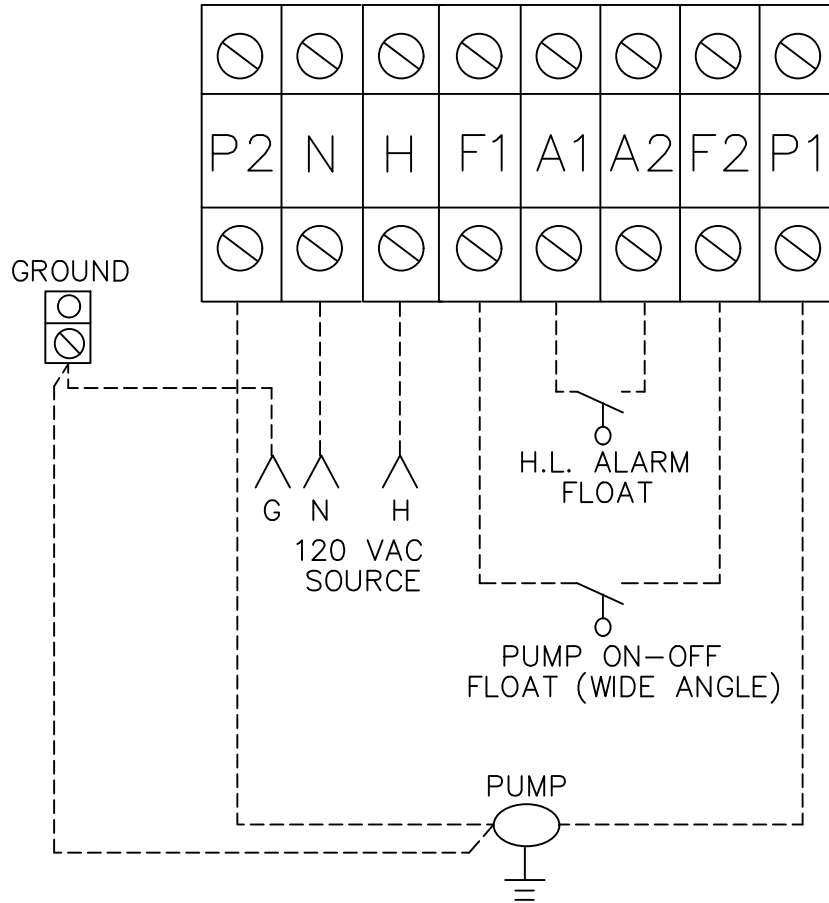


CP-1312
CONTROL PANEL

Delta Treatment Systems
15785 Industry Way
Walker, LA 70785
(225) 665-6162 Fax (800) 219-9183

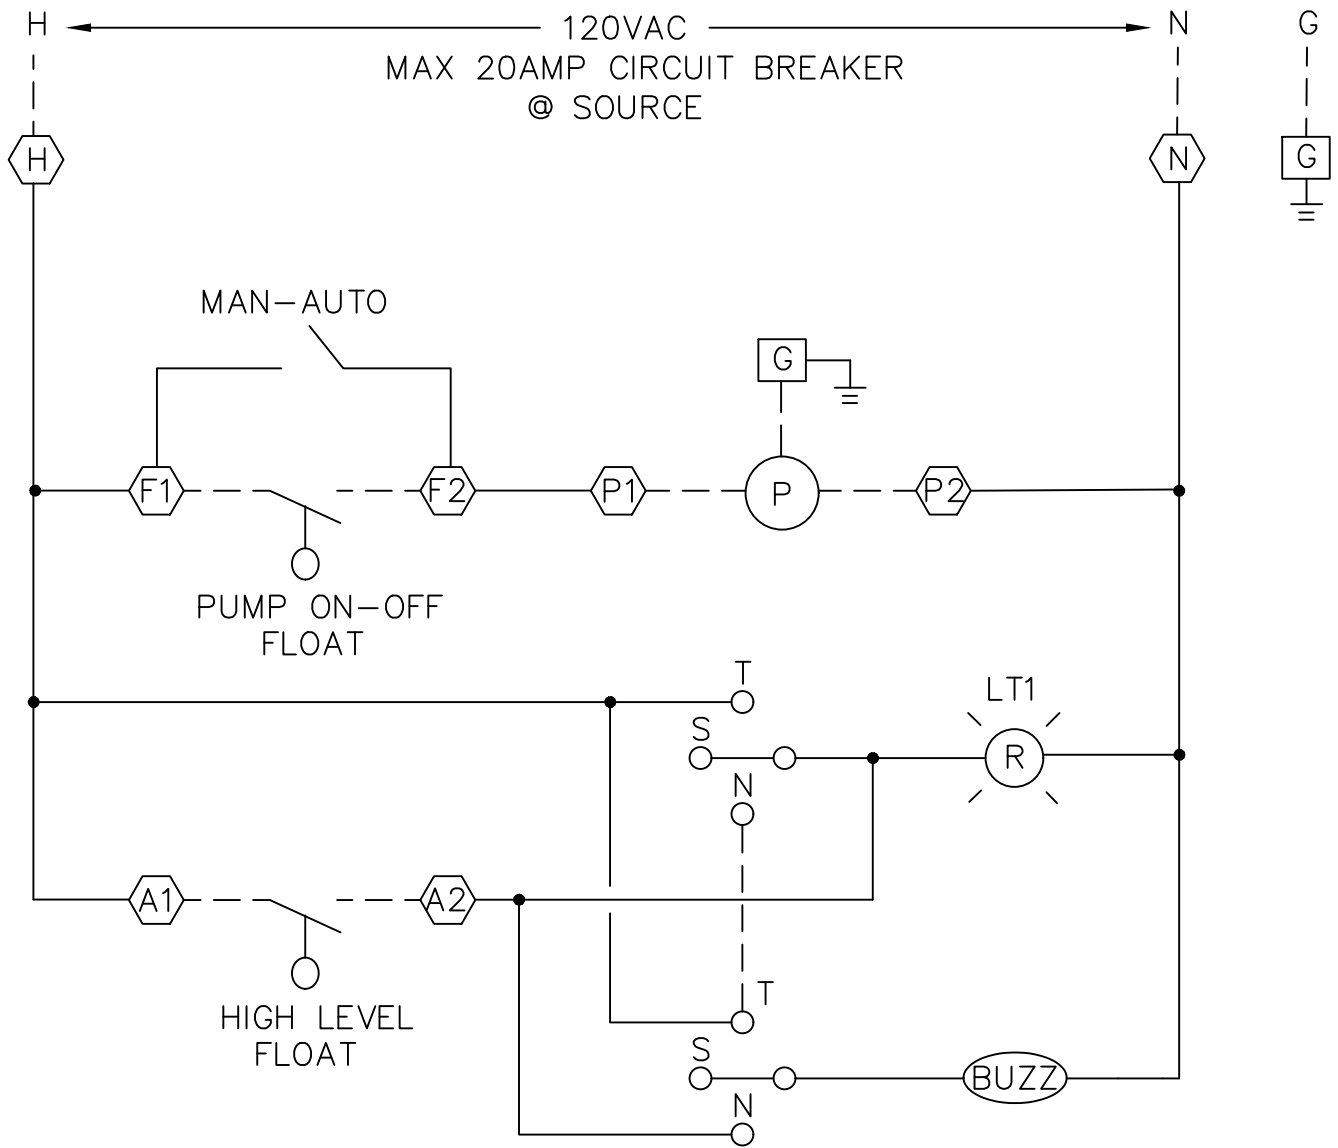


					15785 Industry Way Walker, LA 70785 Ph. (225) 665-6162 Fax (800)219-9183	SCHEMATIC DIAGRAM				
-	-	-	-							
-	-	-	-							
REV.	DATE	REVISION DESCRIPTION	BY							
COMPANY CONFIDENTIAL: INFORMATION CONTAINED HEREIN IS CONFIDENTIAL. IT IS THE PROPERTY OF PENTAIR PUMP GROUP. IT IS TO BE USED SOLELY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF PENTAIR PUMP GROUP.				PLOT SCALE	DRAWING NUMBER	DRAWN BY	DATE	SHEET OF	REV.	
				NTS	CP-1312	NCR	06/18/24	1 1	A	



NOTES:

1. EXTERNAL DISCONNECT IS REQUIRED
2. PUMP MUST HAVE INTERNAL THERMAL OVERLOAD PROTECTION.
3. PUMP FLOAT MUST BE CAPABLE OF CARRYING FULL MOTOR CURRENT. (MAX PUMP CURRENT MUST NOT EXCEED 16 AMPS)

					15785 Industry Way Walker, LA 70785 Ph. (225) 665-6162 Fax (800)219-9183	EXTERNAL CONNECTIONS			
-	-	-	-						
-	-	-	-						
REV.	DATE	REVISION DESCRIPTION	BY						
COMPANY CONFIDENTIAL: INFORMATION CONTAINED HEREIN IS CONFIDENTIAL. IT IS THE PROPERTY OF PENTAIR PUMP GROUP, IT IS TO BE USED SOLELY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF PENTAIR PUMP GROUP.				PLOT SCALE	DRAWING NUMBER	DRAWN BY	DATE	SHEET OF	REV.
				NTS	CP-1312	NCR	06/18/24	2 2	A