


MAIN SERVICE
120/240V, 1Ø

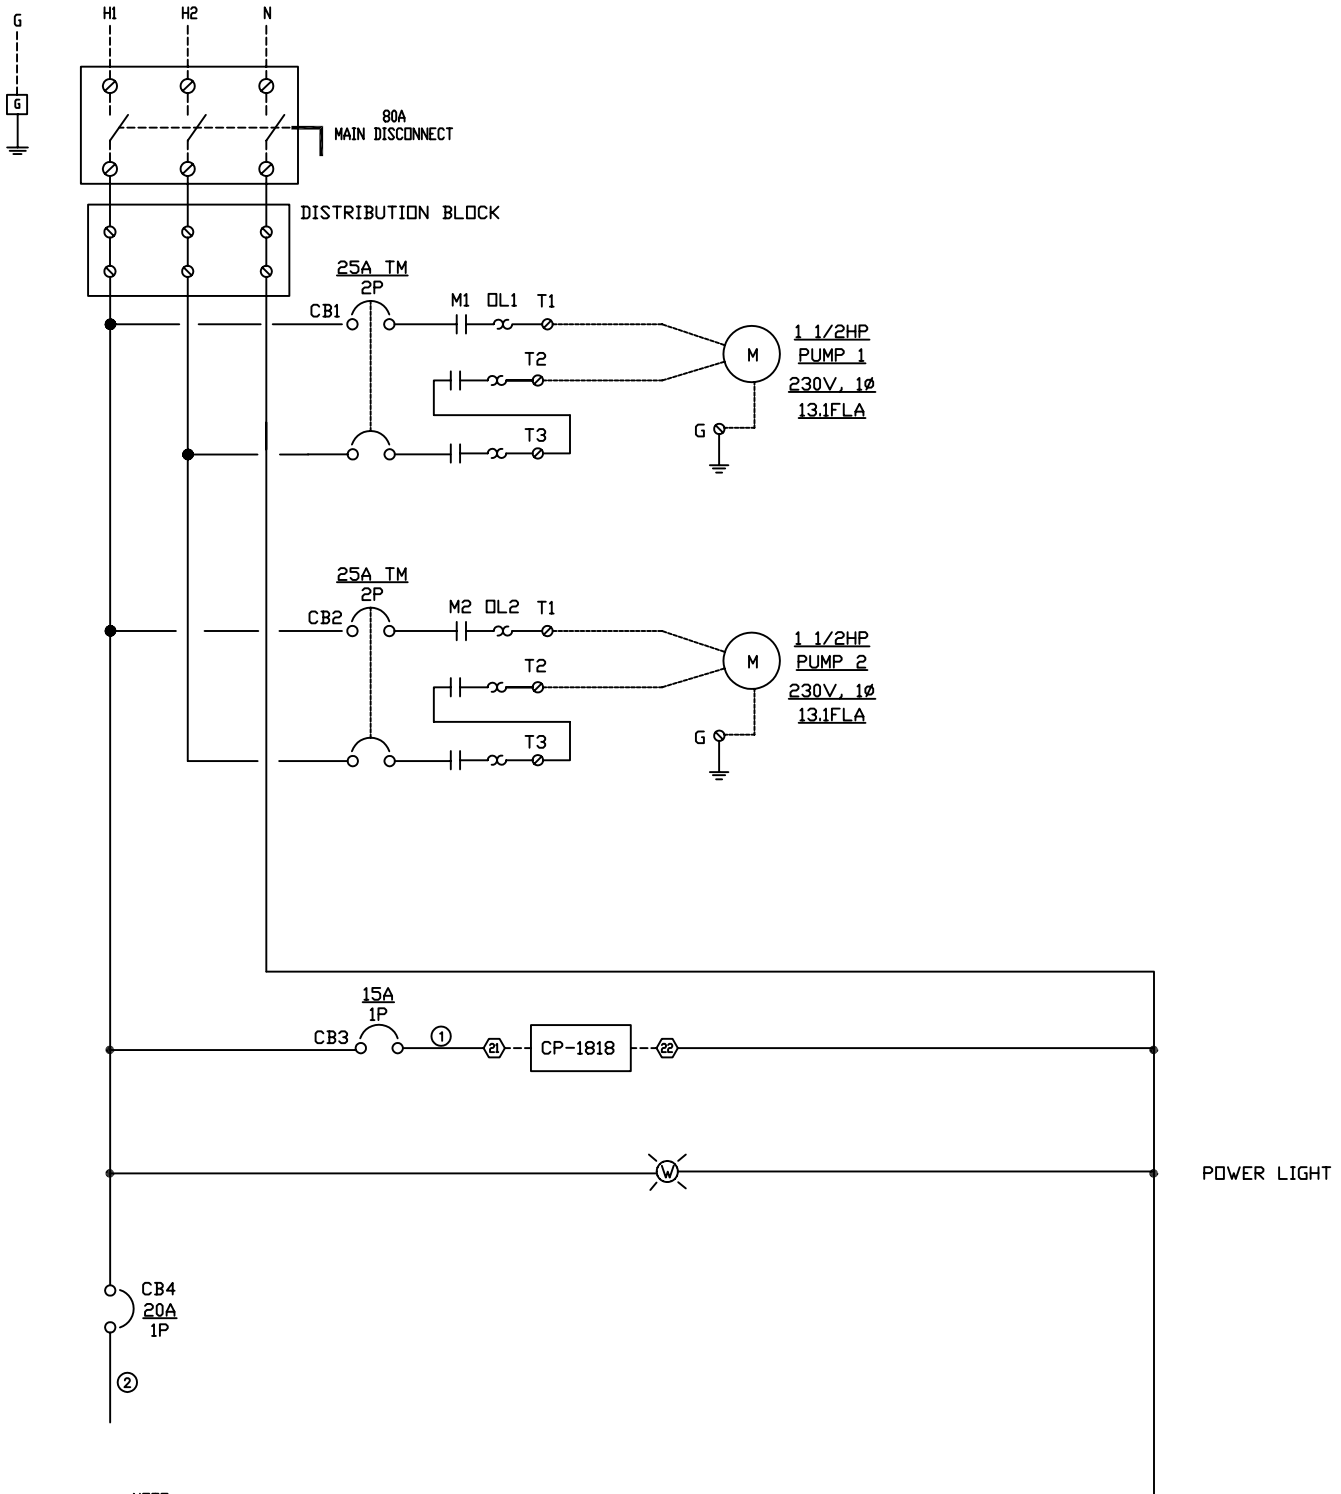

LEGEND

— WIRING BY VENDOR
- - - WIRING BY CUSTOMER

NOTE

1. INTERNAL PUMP THERMAL OVERLOAD IS RECOMMENDED.
2. PLC WILL INDICATE NUMBER OF HIGH LEVEL ALARMS AND NUMBER OF TIMES A PUMP IS TURNED TO HAND POSITION.

PROGRAM
PULSE 6 FIELDS W/O
BACKWASH VALVE r1 FOR
PANEL CP-1811



Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

Schematic Diagram Filter System

DWN BY:
C.RACHAL


DATE:
5/13/05

SCALE:
N.T.S.

DWG. NO.:
1 OF 6

JOB NO.:
CP-2057

JOB NO.:
CP-2057

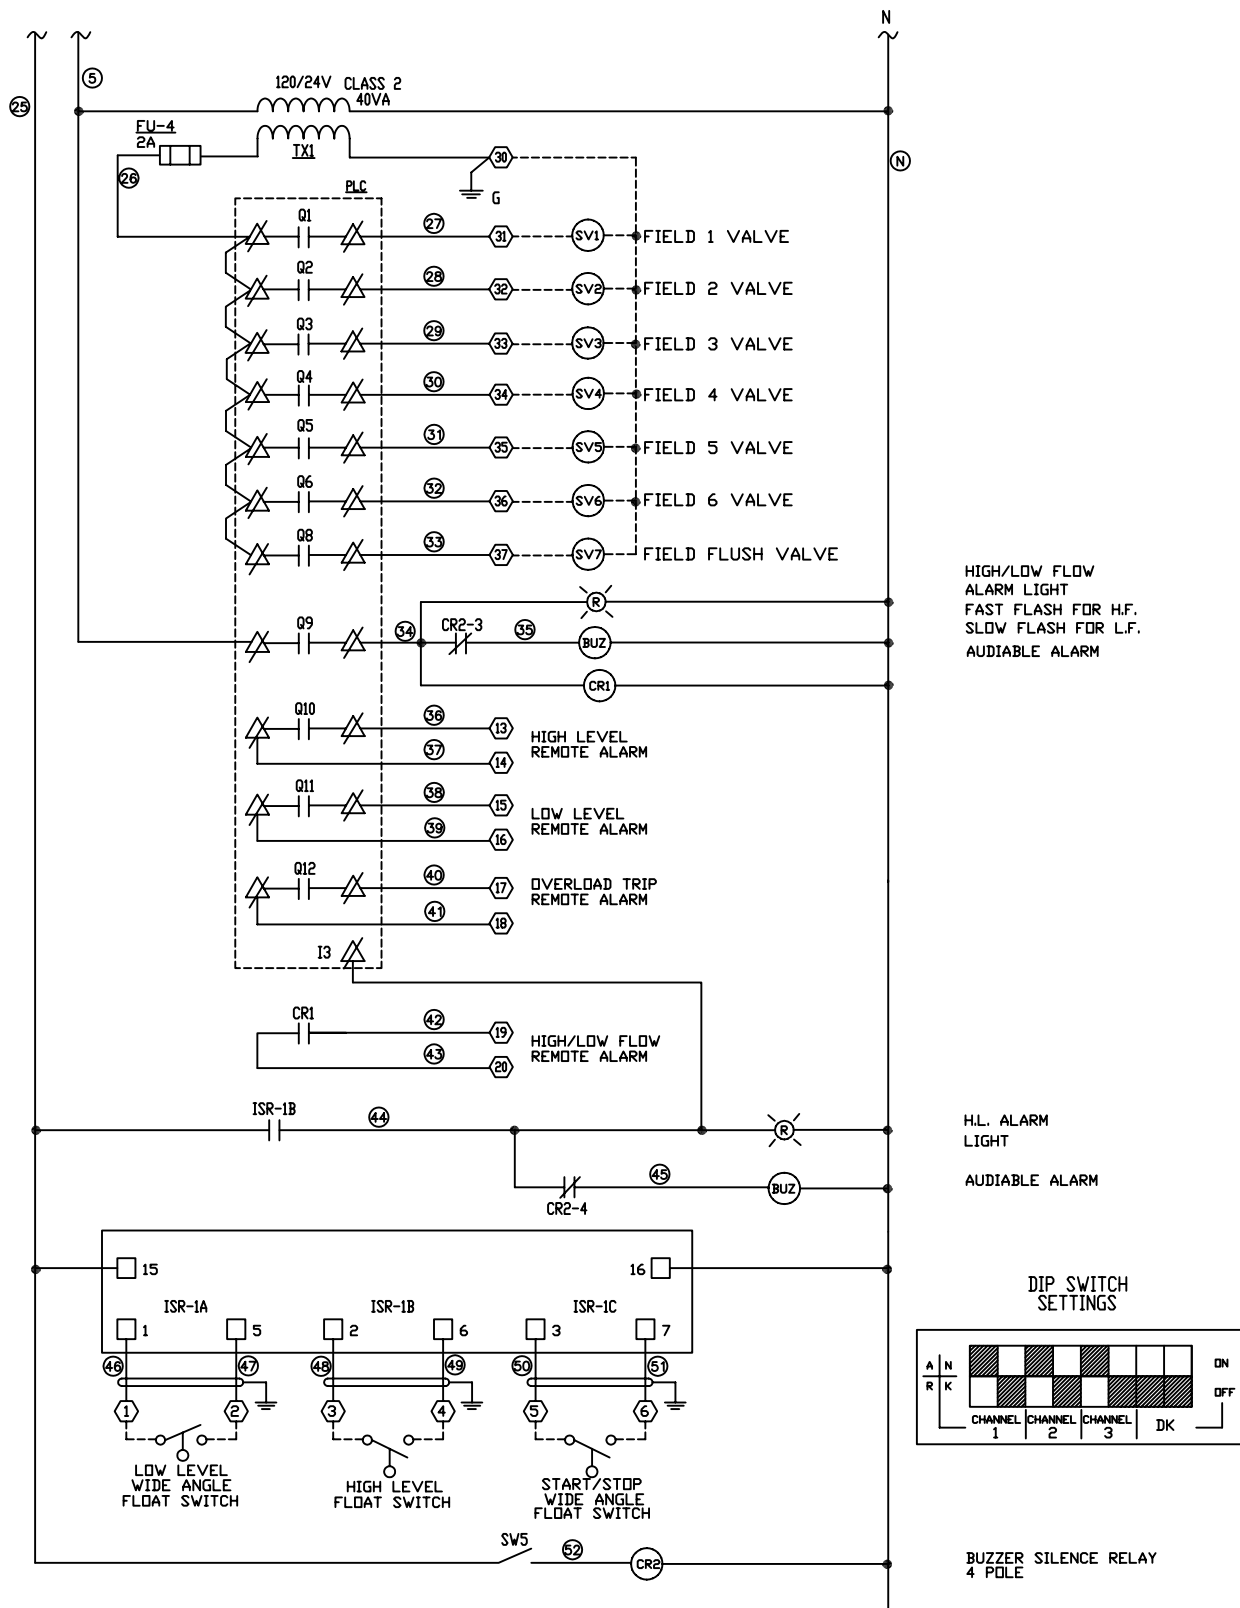

Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

DWN BY:
C.RACHAL

DATE:
5/10/05

SCALE:
N.T.S.


DWG. NO.:
3 OF 6

JOB NO.:
CP-2057


Schematic Diagram Filter System

PROGRAM
PULSE 6 FIELDS W/O
BACKWASH VALVE r1 FOR
PANEL CP-1811



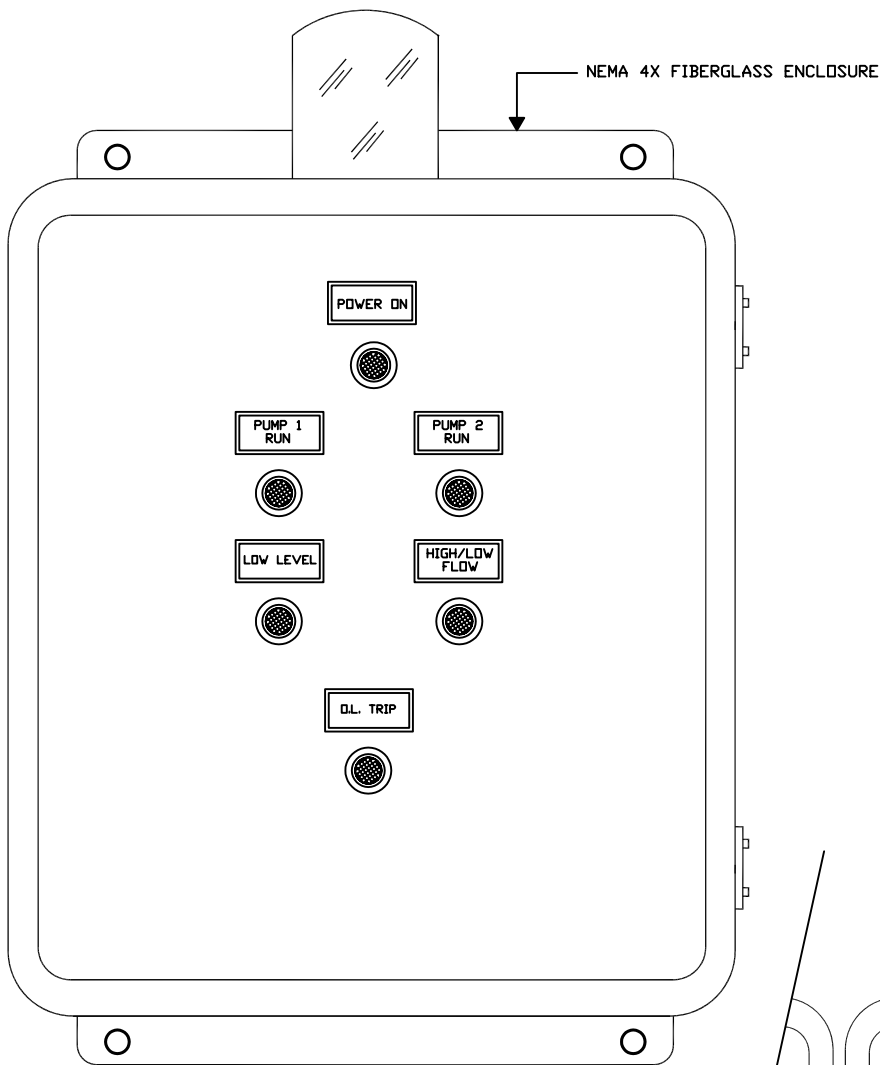

VIEW OF FRONT OF ENCLOSURE

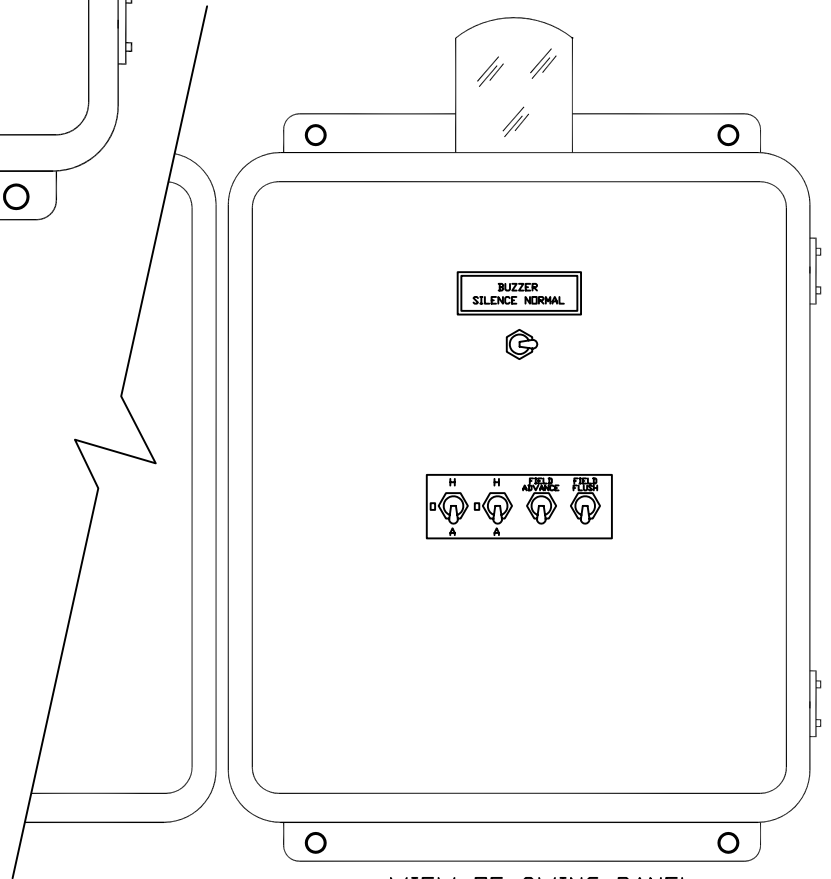

VIEW OF SWING PANEL



Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

DWN BY:
C.RACHAL


DATE:
5/13/05

SCALE:
N.T.S.

DWG. NO.:
5 OF 6

JOB NO.:
CP-2057

ENCLOSURE Filter System

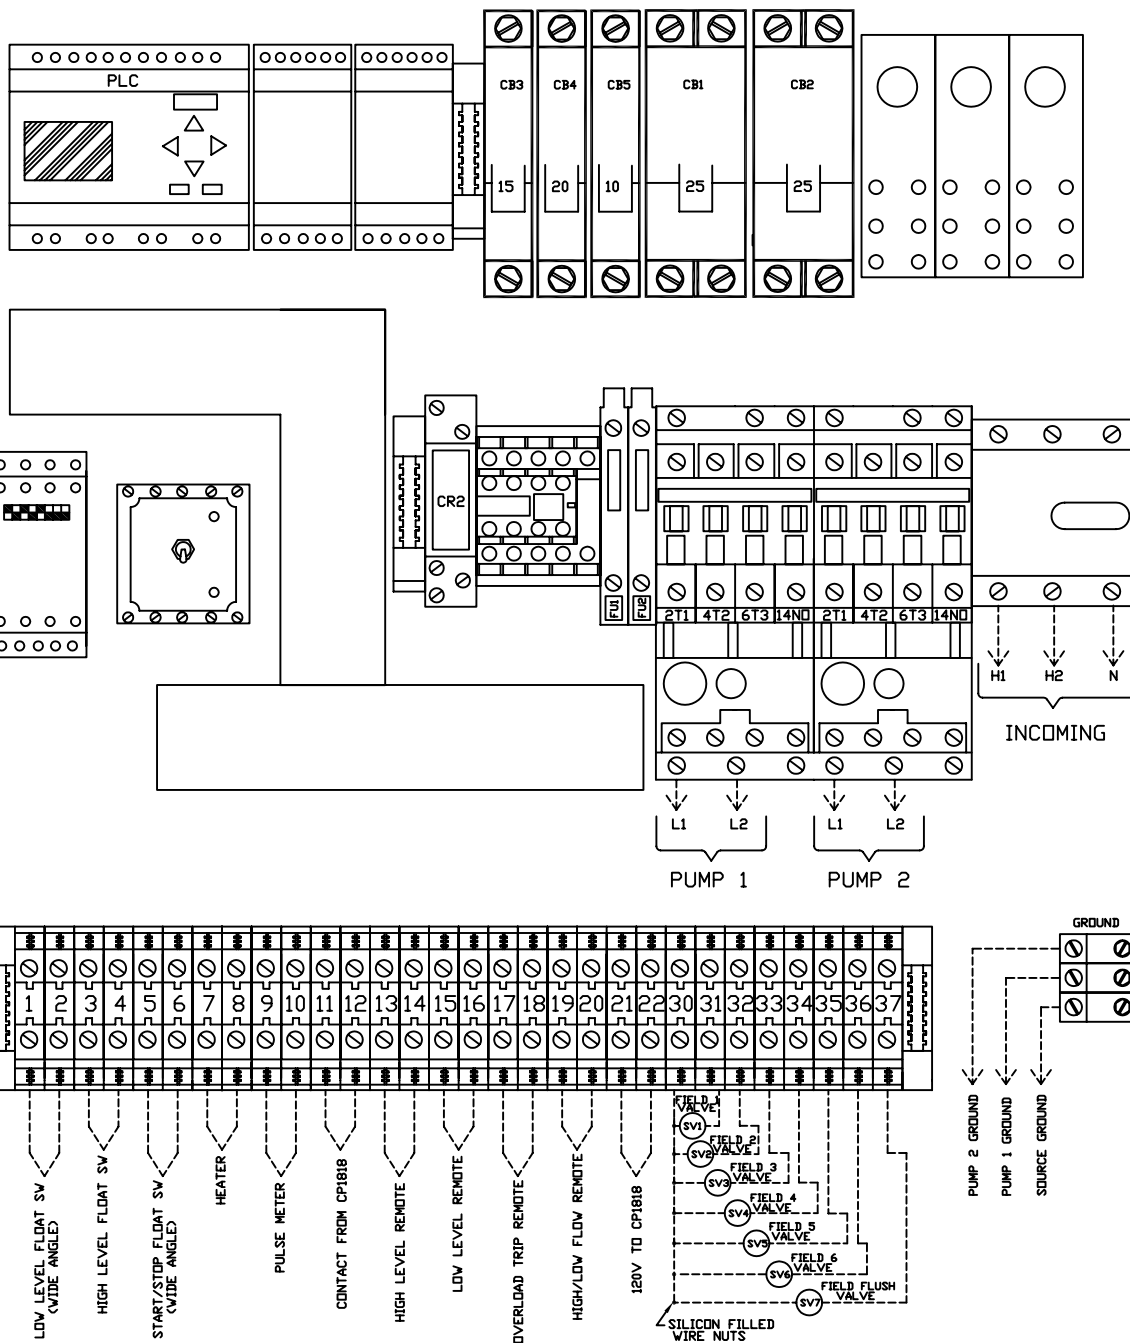

VIEW OF INNER LAYOUT



Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

DWN BY:
C.RACHAL

DATE:
5/13/05

SCALE:
N.T.S.

DWG. NO.:
6 OF 6

JOB NO.:
CP-2057

ENCLOSURE Filter System