

---

---

# COX

Research and Technology, Inc.

---

---

DUPLEX PUMP  
CONTROL PANEL  
LIFT STATION 22

Cox Research and Technology, Inc.  
14697 S. Harrells Ferry Road  
Baton Rouge, LA. 70816  
(225) 756-3271 Fax (225) 755-1030

CP-2301

VOLTAGE	<u>120/240V</u>	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	<u>1/60</u>	
NO. MOTORS	<u>2</u>	
HP	<u>3</u>	
FLA	<u>23</u>	
TYPE OF PUMP	<u>Submersible</u>	(Self-Priming, Submersible)
MANUFACTURER	<u>Barnes</u>	
CATALOG NUMBER	<u></u>	
CONTROL VOLTAGE	<u>120V</u>	(120V, Other)
ENCLOSURE	<u>NEMA 4X</u>	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	<u>Fiberglass</u>	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	<u>Floats</u>	(Floats, Bubbler, Other)
CAPACITORS	<u>Yes</u>	(Yes, No)
CAPACITOR WIRING FIGURE	<u></u>	
THERM. & SEAL FAIL WIRING FIGURE	<u></u>	


OPTIONS:

SEAL FAIL LIGHTS	<u>X</u>	(Submersible Only)
SEAL FAIL RELAYS	<u></u>	(Submersible Only)
SEAL FAIL PUMP SHUTDOWN	<u></u>	(Submersible Only)
HT PUMP SHUTDOWN	<u>X</u>	(Self-Primer, Submersible)
ALARM HORN	<u></u>	
ALARM LIGHT	<u>X</u>	
LIGHT PANEL MTD	<u>X</u>	
LIGHT REMOTE MTD	<u></u>	
LIGHT FLASHER	<u></u>	
LIGHTNING ARRESTER	<u>X</u>	
ELAPSED TIME METER	<u>X</u>	
PHASE MONITOR	<u></u>	
NEMA RATED STARTERS	<u></u>	
GROUND FAULT RECPT.	<u>X</u>	
GREEN RUN LIGHTS VS. RED	<u></u>	
POLE, BOX, SEAL	<u></u>	
INTRINSICALLY SAFE RELAYS	<u></u>	
HIGH TEMP. LOCKOUT, MANUAL RESET	<u></u>	
ECONOMY VERSION	<u>X</u>	


SOLD TO: Delta Process - Bossier City, LA

TAG : Lift Station 22

SHIP TO: Delta Process - Ruston, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 2/13/06		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div style="text-align: center;">   <b>COX</b>  Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-2301
							SHEET NUMBER 1



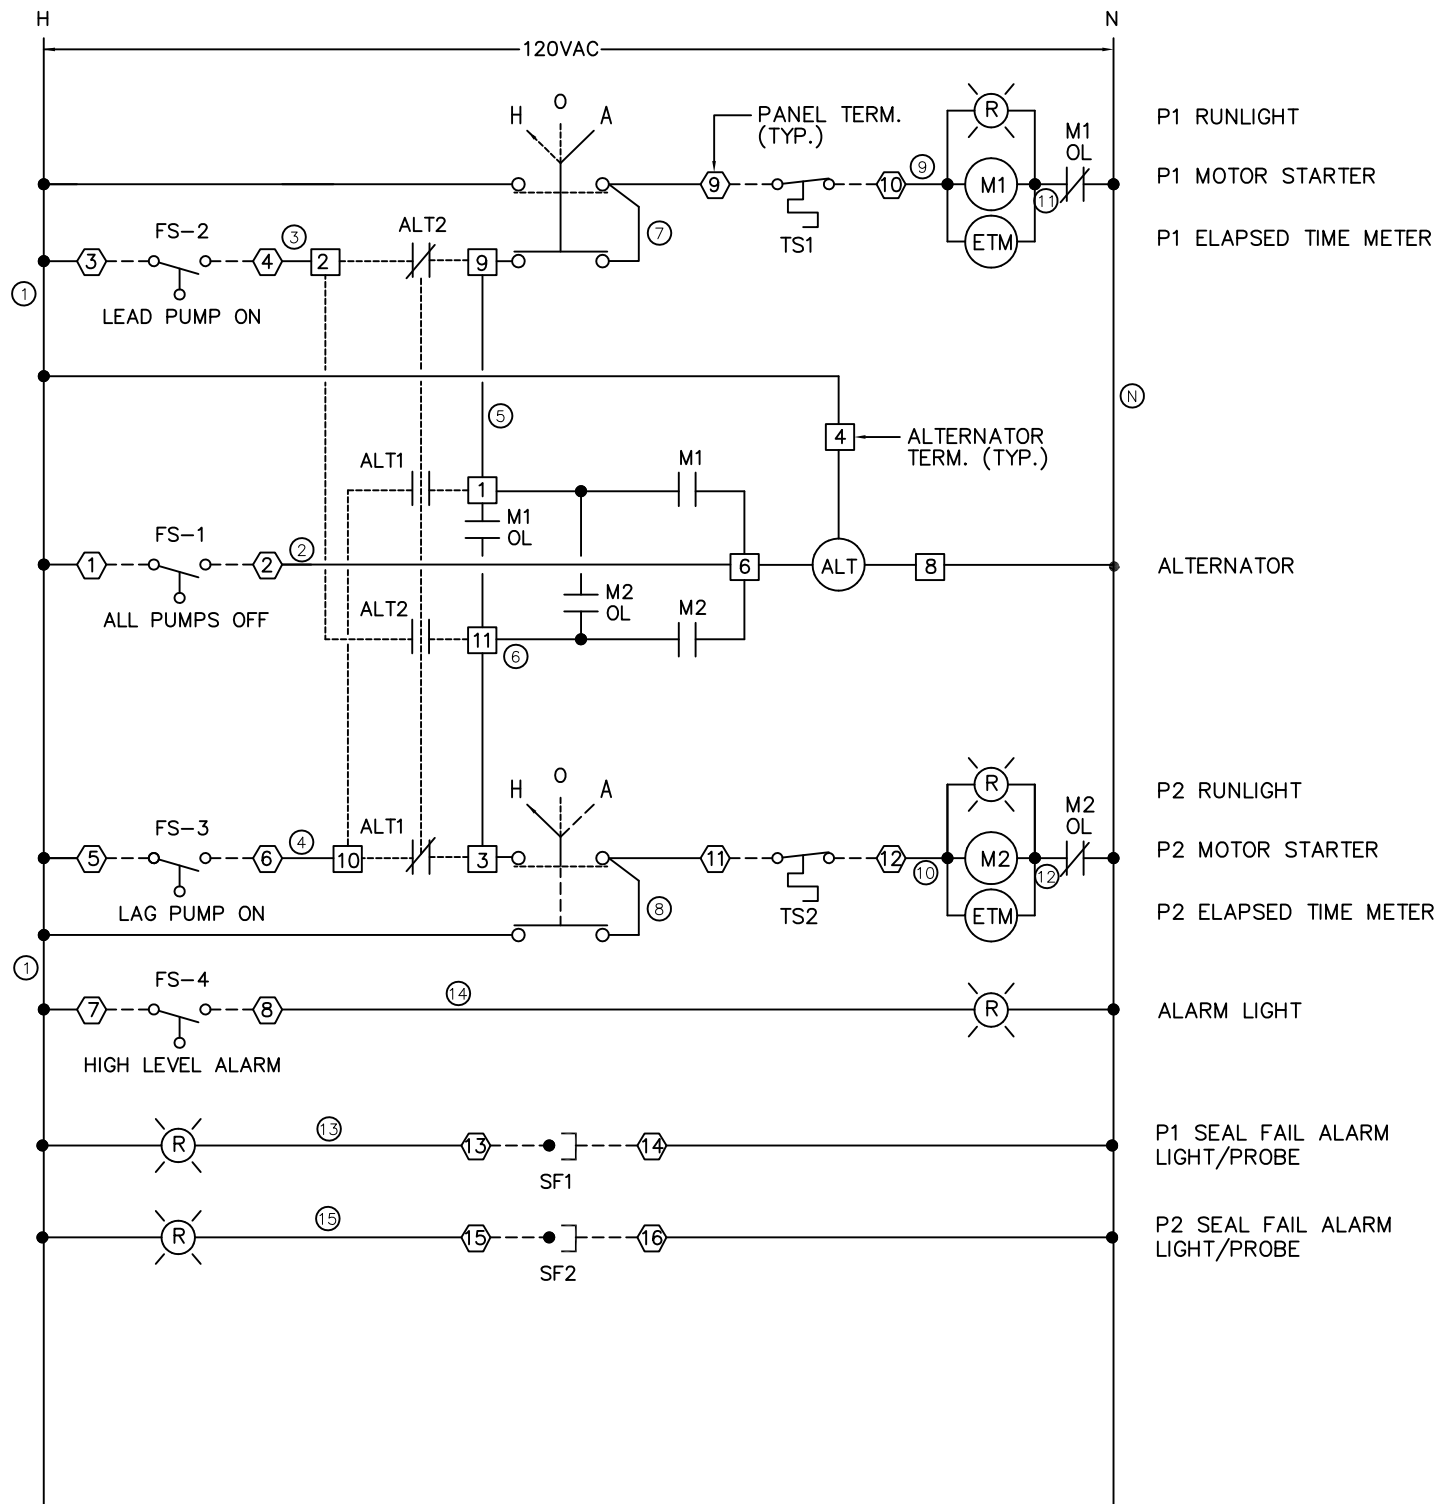



	Drawing Title								
	CONTROL DIAGRAM								
DATE	2/13/06	REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY		
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	APPROVED			
	Project Title							PURCHASE ORDER NUMBER	
	DUPLEX PUMP CONTROL PANEL							DRAWING NUMBER CP-2301	
								SHEET NUMBER	3

**COX**

Research and Technology, Inc.

P.O. Box 77808  
Baton Rouge, LA  
70809

Ph. (225)756-3271  
Fax (225)755-1030

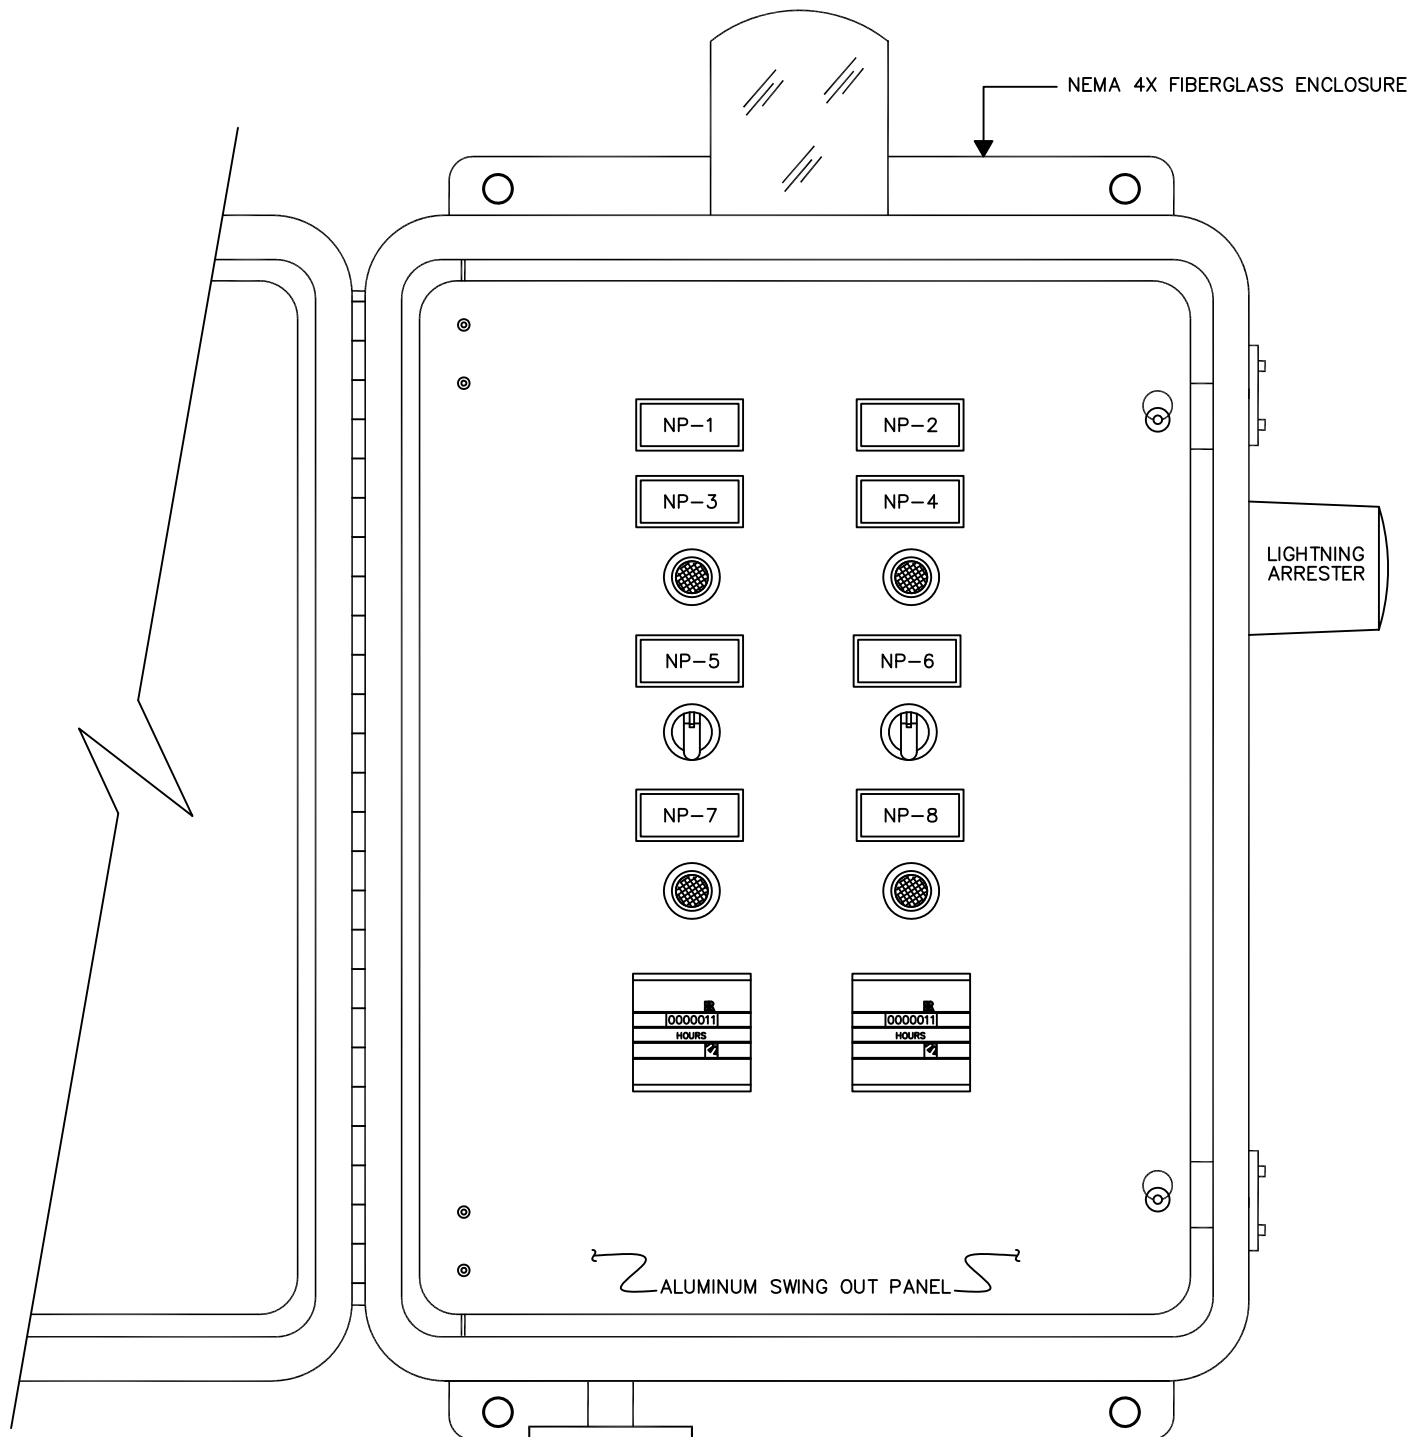

VIEW OF SWING OUT PANEL

**NOTE:**  
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.  
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE  
PANEL TO PREVENT ENTRY OF GASSES.

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL

	Drawing Title   	
--	---	--

**COX**

Research and Technology, Inc.

P.O. Box 77808  
Baton Rouge, LA  
70809

Ph. (225)756-3271  
Fax (225)755-1030

# BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	1	MARATHON	1323580	DISTRIBUTION BLOCK
3	2	ABB	A26-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU25	O.L. RELAY (18-25A)
5	2	SQUARE D	QOU250	CB1, CB2
6	1	TIMEMARK	261DT120	ALTERNATING RELAY
7	4	ACI	JR22FR	RED PILOT LIGHT
8	2	ACI	JR22P3M20B	HOA SWITCH
9	1	AC/DC	BL5-R120	ALARM LIGHT
10	1	SQUARE D	QOU115	CB4
11	1	DELTA	LA302R	LIGHTNING ARRESTER
12	1	STOCK		GFI RECEPTACLE
13	1	SQUARE D	QOU110	CB3
14	2	REDINGTON	711-0190	ELAPSED TIME METER
15	2	NEUVA	4CU57	START CAPACITOR 257 $\mu$ f
16	2	GE	6X660	RUN CAPACITOR 20 $\mu$ f
17	2	GE	6X553	RELAY
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title							
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>							
DATE 2/13/06		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
		<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 100px;"> <h3 style="margin: 0;">COX</h3> <p style="margin: 0; font-size: small;">Research and Technology, Inc.</p> </div>			<p style="margin: 0; font-size: small;">P.O. Box 77808 Baton Rouge, LA 70809</p> <p style="margin: 0; font-size: small;">Ph. (225)756-3271 Fax (225)755-1030</p>		<p style="margin: 0; font-size: small;">PURCHASE ORDER NUMBER</p> <hr/> <p style="margin: 0; font-size: small;">DRAWING NUMBER CP-2301</p> <hr/> <p style="margin: 0; font-size: small;">SHEET NUMBER</p>	
	Project Title	<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 100px;"> <h3 style="margin: 0;">COX</h3> <p style="margin: 0; font-size: small;">Research and Technology, Inc.</p> </div>			<p style="margin: 0; font-size: small;">P.O. Box 77808 Baton Rouge, LA 70809</p> <p style="margin: 0; font-size: small;">Ph. (225)756-3271 Fax (225)755-1030</p>		<p style="margin: 0; font-size: small;">PURCHASE ORDER NUMBER</p> <hr/> <p style="margin: 0; font-size: small;">DRAWING NUMBER CP-2301</p> <hr/> <p style="margin: 0; font-size: small;">SHEET NUMBER</p>	
	DUPLEX PUMP CONTROL PANEL						5	