
COX

Research and Technology, Inc.

DUPLEX PUMP CONTROL PANEL LIFT STATION 4

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-2229

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	3/60	
NO. MOTORS	2	
HP	7.5	
FLA	22	
TYPE OF PUMP	Self-Priming	(Self-Priming, Submersible)
MANUFACTURER	GR	
CATALOG NUMBER		
CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	No	(Yes, No)
CAPACITOR WIRING FIGURE	N/A	
THERM. & SEAL FAIL WIRING FIGURE		


OPTIONS:

SEAL FAIL LIGHTS		(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER	X	
ELAPSED TIME METER	X	
PHASE MONITOR	X	
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET	X	
ECONOMY VERSION	X	


SOLD TO: Delta Process - Bossier City, LA
TAG : Lift Station 4

SHIP TO: Delta Process - Ruston, LA

DATE 12/09/05	Drawing Title PANEL DESCRIPTION	REFERENCE DRAWING		NO.	REVISION-LOCATION		ECN	DATE	BY
		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL	APPROVED BY			
	Project Title DUPLEX PUMP CONTROL PANEL				P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER		
					Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER	CP-2229	
							SHEET NUMBER		1

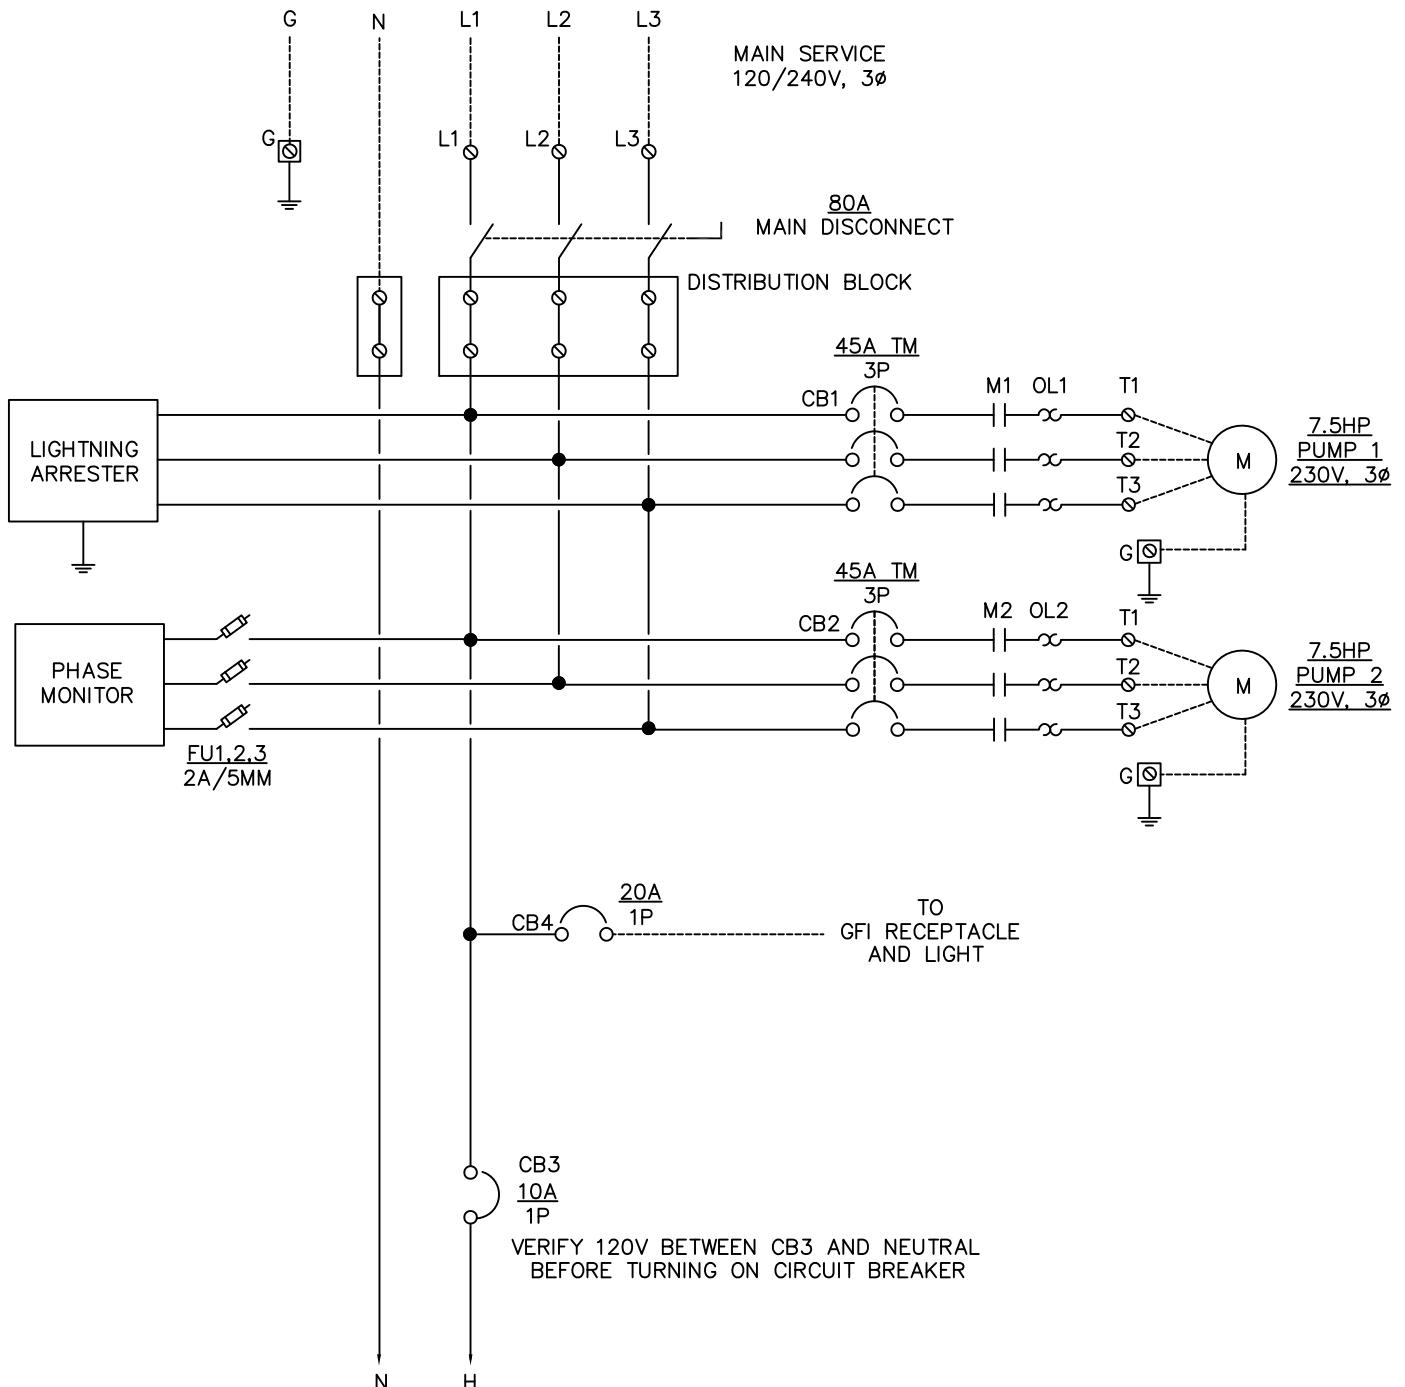


	Drawing Title					
	POWER DIAGRAM					
DATE 12/09/05	REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN DRAWN BY C. RACHAL	DATE APPROVED BY	BY
Project Title						
DUPLEX PUMP CONTROL PANEL	COX Research and Technology, Inc.	P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030	PURCHASE ORDER NUMBER DRAWING NUMBER CP-2229 SHEET NUMBER 2			

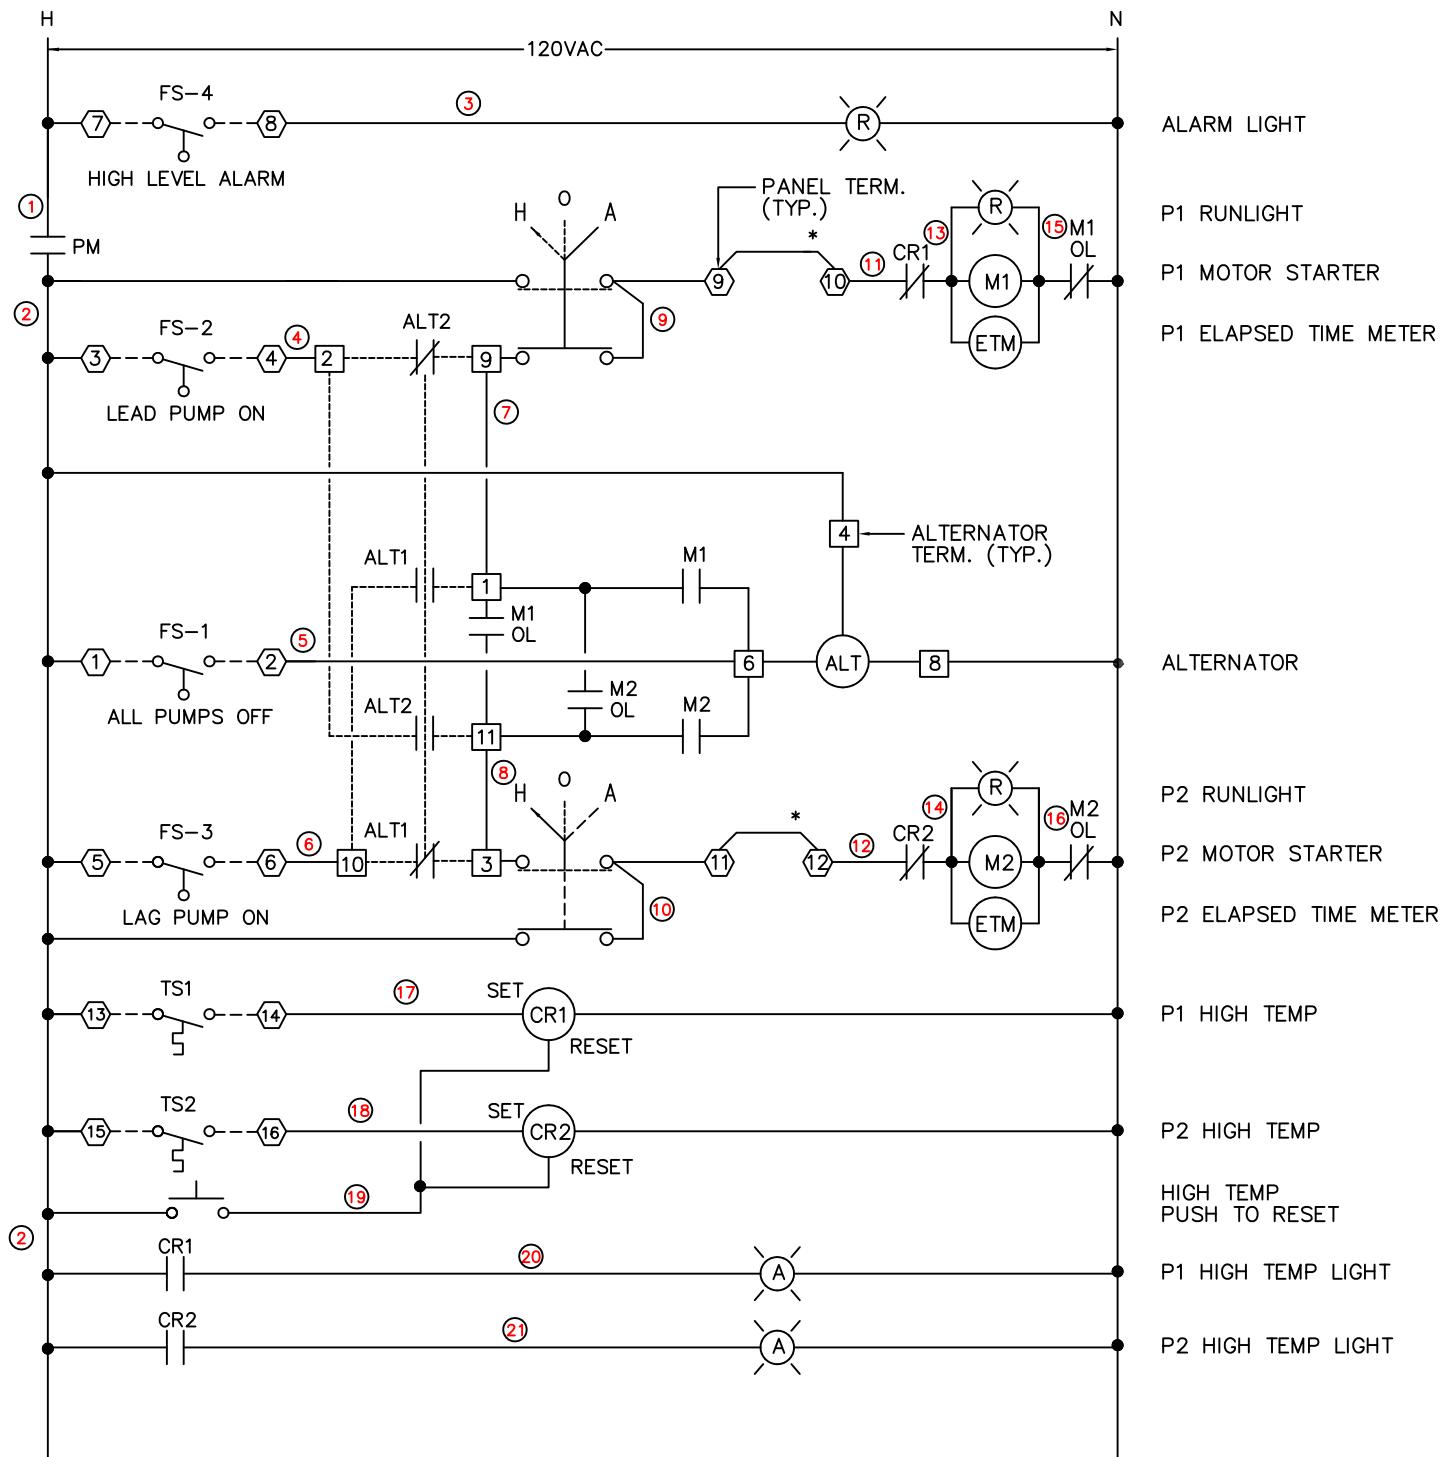

* REMOVE JUMPERS AND INSTALL LOCKOUT DEVICES IF REQUIRED

	Drawing Title CONTROL DIAGRAM DATE 12/09/05						
		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
S/N	Sales Engineer C.C.	Application Engineer R.C.		DRAWN BY C. RACHAL	APPROVED BY	DATE	
	Project Title DUPLEX PUMP CONTROL PANEL	<hr/> <hr/> <hr/> COX Research and Technology, Inc. <hr/> <hr/>			P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER DRAWING NUMBER CP-2229	
					Ph. (225)756-3271 Fax (225)755-1030	SHEET NUMBER 3	

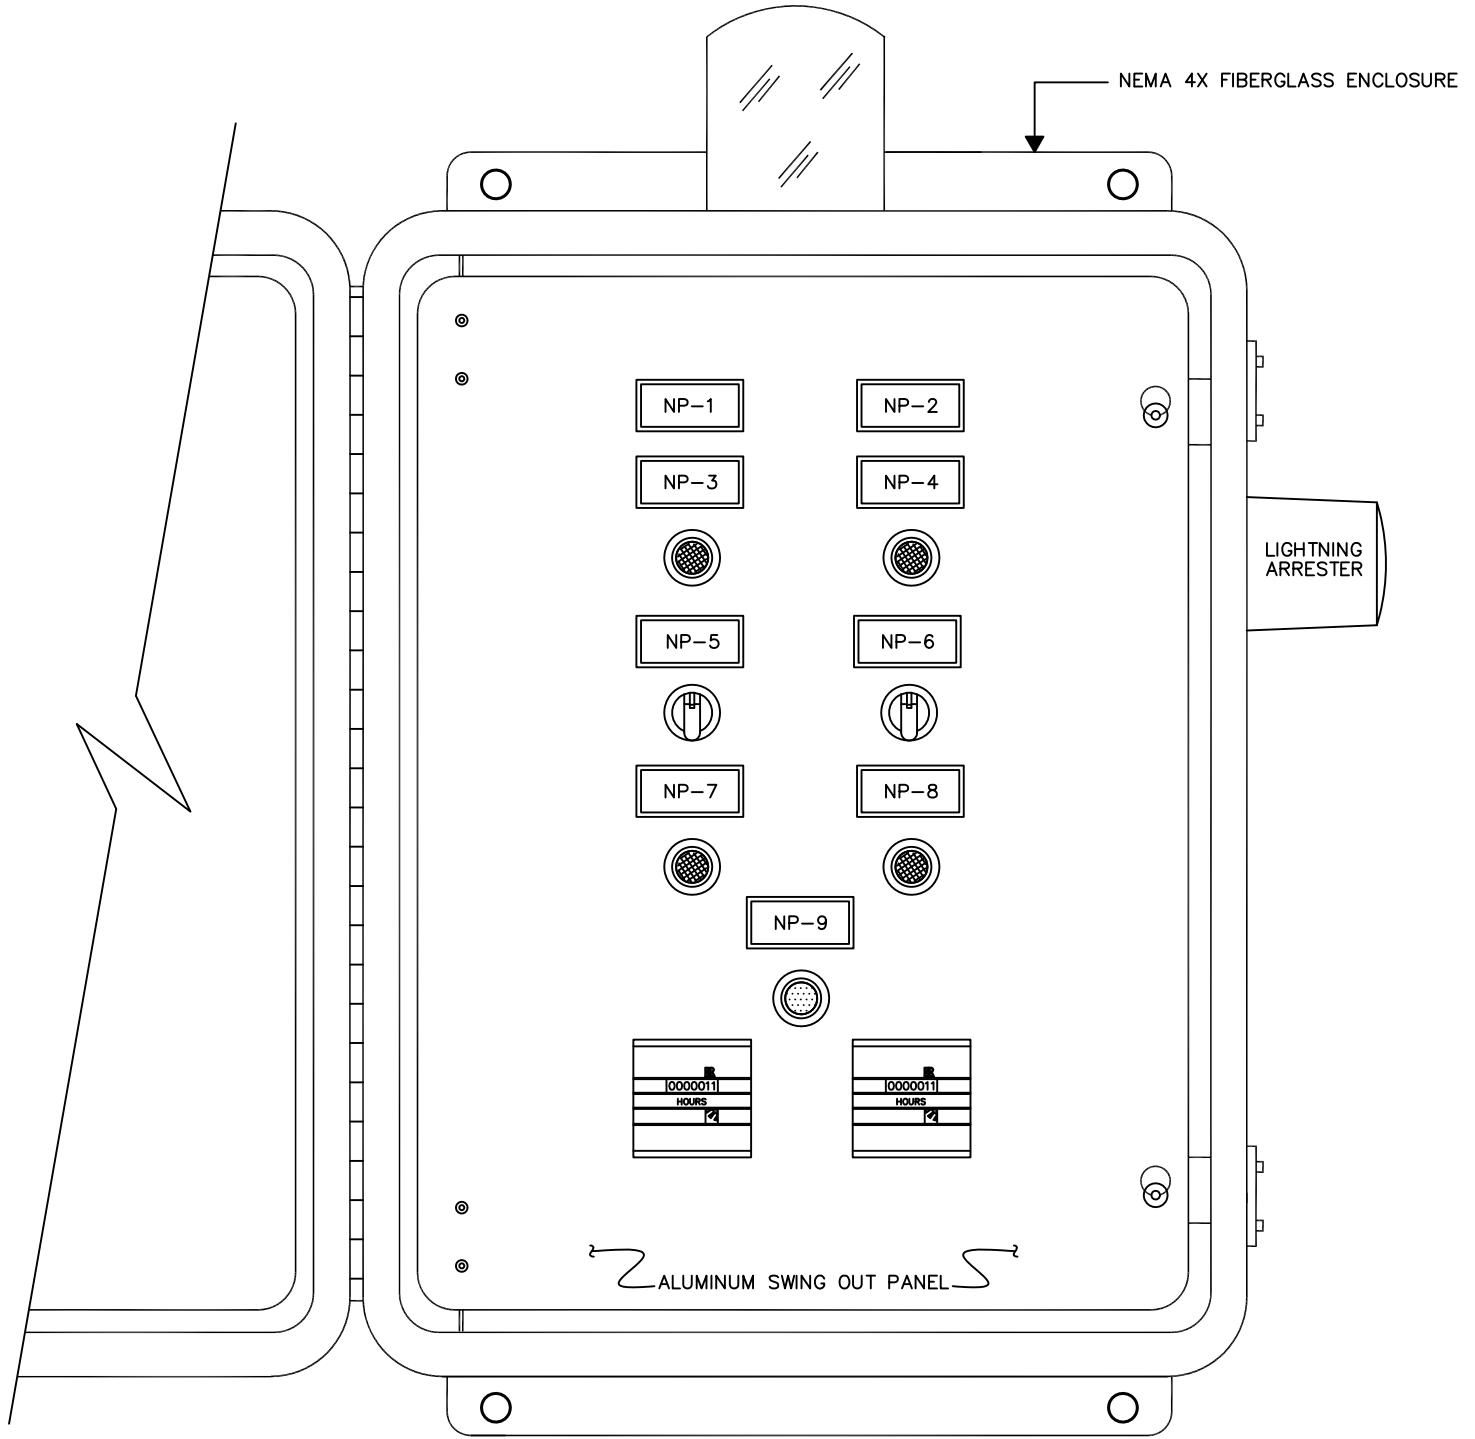

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	HIGH TEMP
NP-8	HIGH TEMP
NP-9	HIGH TEMP RESET

NOTE:
SEWER GASES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASES.

	Drawing Title					
	ENCLOSURE					
DATE 12/09/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN DRAWN BY C. RACHAL	DATE APPROVED BY DATE
	Project Title	<hr/> <hr/> <hr/> COX <hr/> <hr/> <hr/> Research and Technology, Inc.			P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)755-1030	DRAWING NUMBER CP-2229
						SHEET NUMBER 4

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	2	ABB	A26N1-30-10-84	MOTOR STARTER
3	2	ABB	TA25DU25	O.L. RELAY (18-25A)
4	2	SQUARE D	QOU345	CB1, CB2
5	1	SQUARE D	QOU110	CB3
6	1	TIMEMARK	261DT120	ALTERNATING RELAY
7	2	ACI	JR22FY	AMBER PILOT LIGHT
8	2	ACI	JR22FR	RED PILOT LIGHT
9	2	ACI	JR22P3M20B	HOA SWITCH
10	1	ACI	JR22AN11B	PUSH BUTTON
11	1	DELTA	LA603	LIGHTNING ARRESTER
12	2	MAGNECRAFT	W388AMLCPX-9	LATCHING RELAYS
13	1	AC/DC	BL5-R-120	ALARM LIGHT
14	1	SSAC	PLMU-11	PHASE MONITOR
15	2	REDINGTON	711-0190	ELAPSED TIME METER
16	1	SQUARE D	QOU120	CB4
17	1	ABB	OT63E3	MAIN DISC. SWITCH
18				
19				
20				
21				
22				
23				
24				
25				

Drawing Title								
BILL OF MATERIALS								
DATE 12/09/05	REFERENCE DRAWING		NO.	REVISION-LOCATION		ECN	DATE	BY
	S/N	Sales Engineer	Application Engineer	DRAWN	APPROVED		BY	DATE
Project Title DUPLEX PUMP CONTROL PANEL	 Research and Technology, Inc.		P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030		PURCHASE ORDER NUMBER DRAWING NUMBER CP-2229 SHEET NUMBER 5			