

---

---

# COX

Research and Technology, Inc.

---

---

## DUPLEX PUMP CONTROL PANEL

Cox Research and Technology, Inc.  
14697 S. Harrells Ferry Road  
Baton Rouge, LA. 70816  
(225) 756-3271 Fax (225) 755-1030

CP-2376

VOLTAGE	277/480V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	3/60	
NO. MOTORS	2	
HP	7.5	
FLA	10.5	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	Vaughan	
CATALOG NUMBER	SE3F-060	
CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	No	(Yes, No)
CAPACITOR WIRING FIGURE	N/A	
THERM. & SEAL FAIL WIRING FIGURE		

OPTIONS:

SEAL FAIL LIGHTS	X	(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER		
ELAPSED TIME METER		
PHASE MONITOR		
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		

SOLD TO: Delta Process - Denham Springs, LA

TAG : \_\_\_\_\_

\_\_\_\_\_


SHIP TO: Delta Process - Denham Springs, LA

\_\_\_\_\_

\_\_\_\_\_

	Drawing Title						
	PANEL DESCRIPTION						
DATE 4/26/06		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div style="text-align: center;"> <b>COX</b>  Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLIX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-2369
							SHEET NUMBER 1



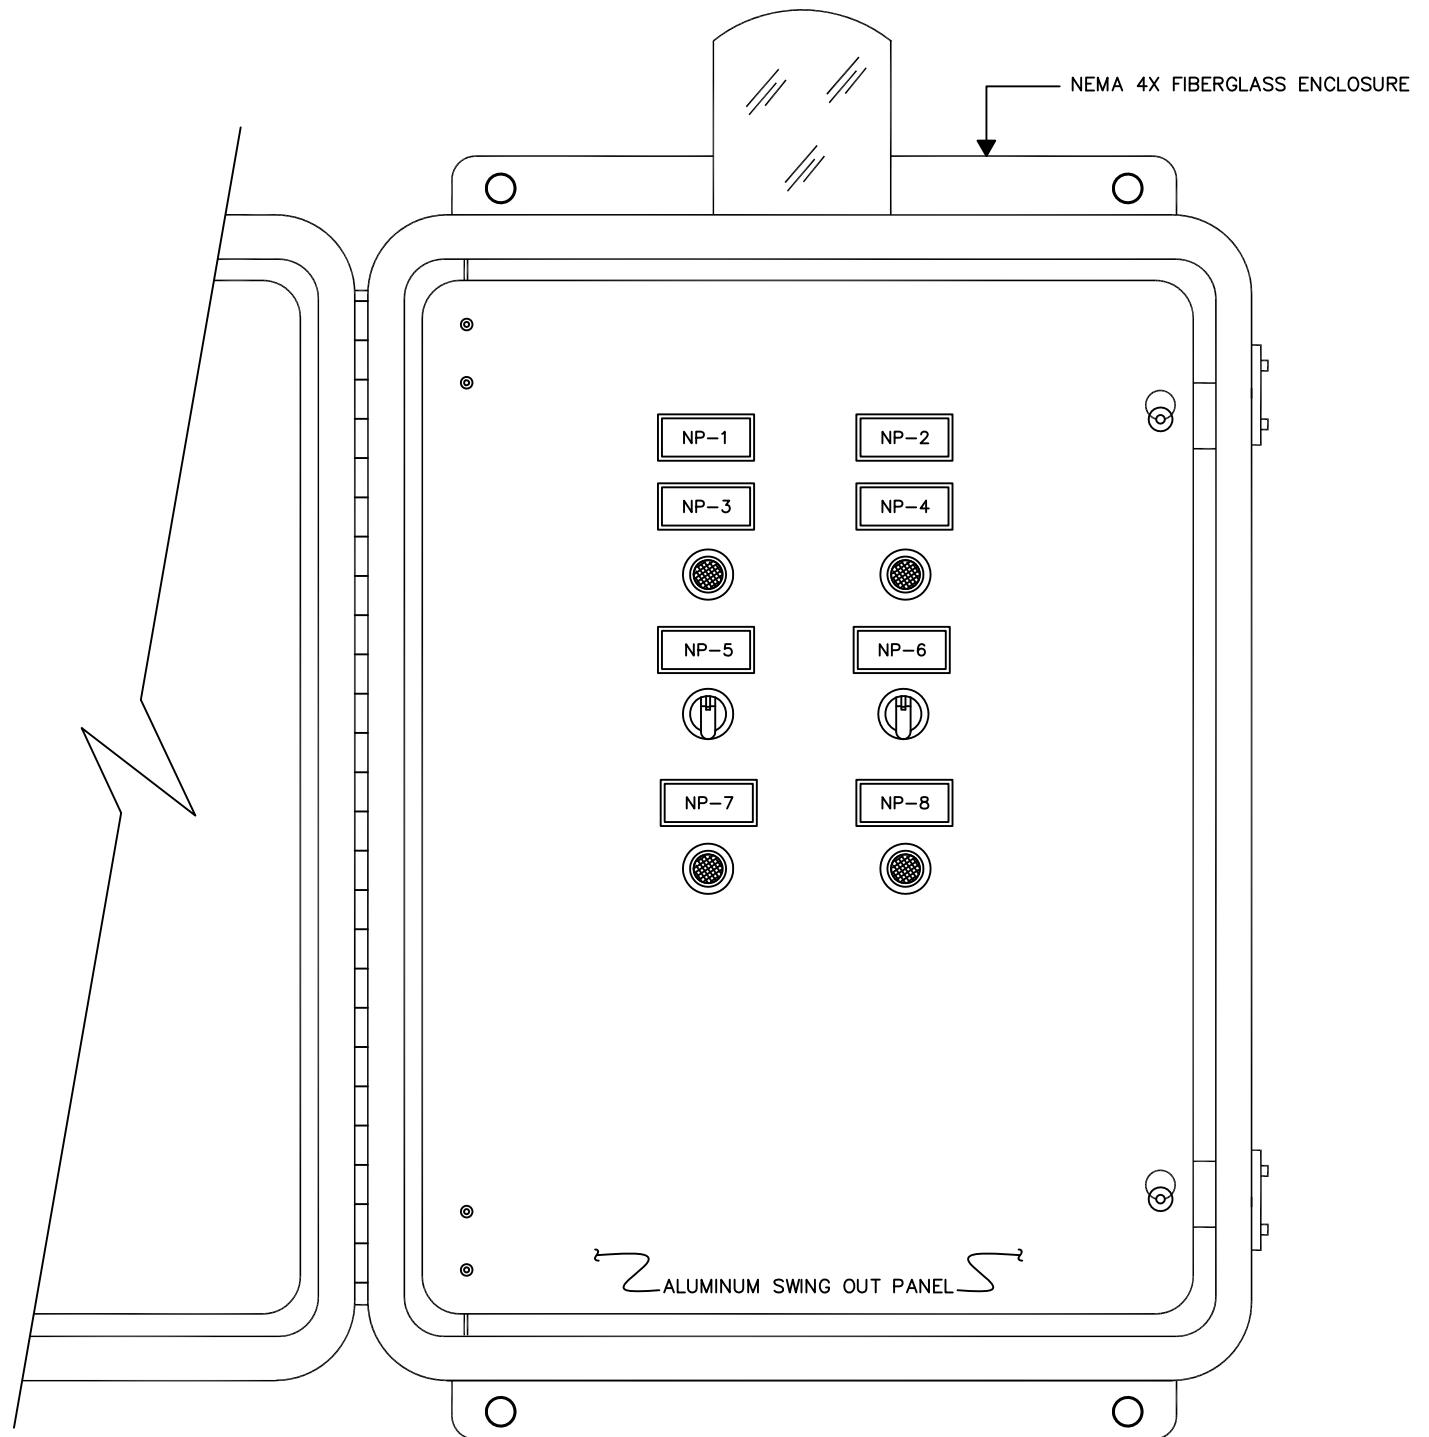

VIEW OF SWING OUT PANEL

**NOTE:**  
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.  
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE  
PANEL TO PREVENT ENTRY OF GASSES.

**NAMEPLATE SCHEDULE**

NP-1 PUMP 1  
NP-2 PUMP 2  
NP-3 RUN  
NP-4 RUN  
NP-5 HOA  
NP-6 HOA  
NP-7 SEAL FAIL  
NP-8 SEAL FAIL

DATE 4/26/06	Drawing Title							
	ENCLOSURE							
REFERENCE DRAWING		NO.		REVISION-LOCATION		ECN	DATE	BY
S/N		Sales Engineer		Application Engineer		DRAWN		APPROVED
		C.C.		R.C.		BY C. RACHAL		BY DATE
Project Title						PURCHASE ORDER NUMBER		
DUPLIX PUMP CONTROL PANEL						DRAWING NUMBER		CP-2369
						SHEET NUMBER		4

**COX**

Research and Technology, Inc.

P.O. Box 77808  
Baton Rouge, LA  
70809

Ph. (225)756-3271  
Fax (225)755-1030

# BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	1	ABB	OT63E3	MAIN DISC. SWITCH
3	2	ABB	A16-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU14	O.L. RELAY (10-14A)
5	2	ABB	T1N020TL	CB1, CB2
6	1	TIMEMARK	261DT120	ALTERNATING RELAY
7	4	ACI	JR22FR	RED PILOT LIGHT
8	2	ACI	JR22P3M20B	HOA SWITCH
9	1	ABB	T4150PSF1	TRANSFORMER
10	1	AC/DC	BL5-R-120	ALARM LIGHT
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title							
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>							
DATE 4/26/06		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
		<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 100px;"> <h1 style="margin: 0;">COX</h1> <p style="margin: 0; font-size: small;">Research and Technology, Inc.</p> </div>			<p style="margin: 0; font-size: small;">P.O. Box 77808 Baton Rouge, LA 70809</p> <p style="margin: 0; font-size: small;">Ph. (225)756-3271 Fax (225)755-1030</p>		<p style="margin: 0; font-size: small;">PURCHASE ORDER NUMBER</p> <hr/> <p style="margin: 0; font-size: small;">DRAWING NUMBER CP-2369</p> <hr/> <p style="margin: 0; font-size: small;">SHEET NUMBER 5</p>	
	Project Title	<h2 style="margin: 0;">DUPLEX PUMP CONTROL PANEL</h2>						