







DOE RUN, MISSOURI  
CP-1818-6-2HP FOR  
CP-6151 (CP12460-3-6-2HP)

Delta Treatment Systems  
9125 Comar Drive  
Walker, LA 70785  
(225) 665-6162 Fax (800) 219-9183

CP-1818-6-2HP



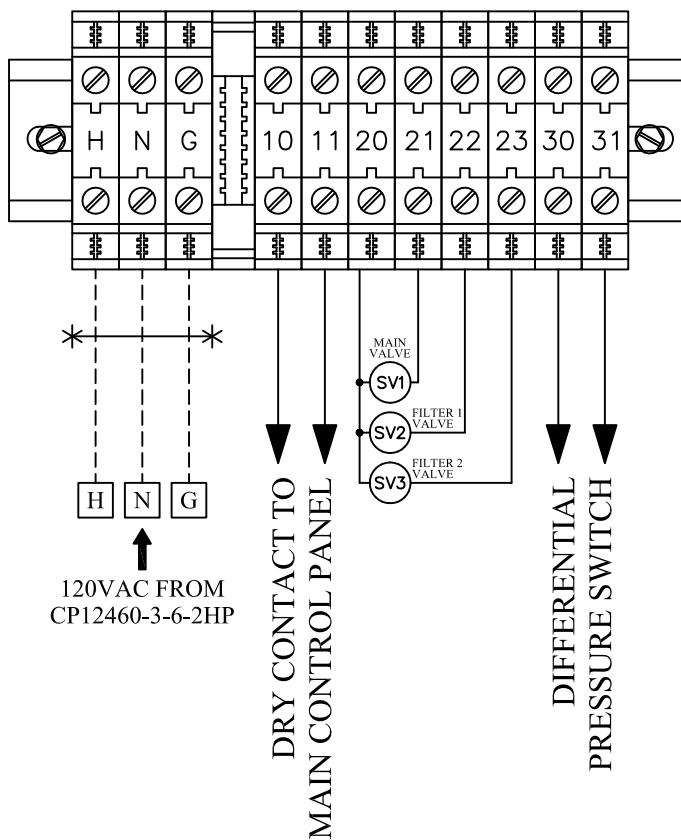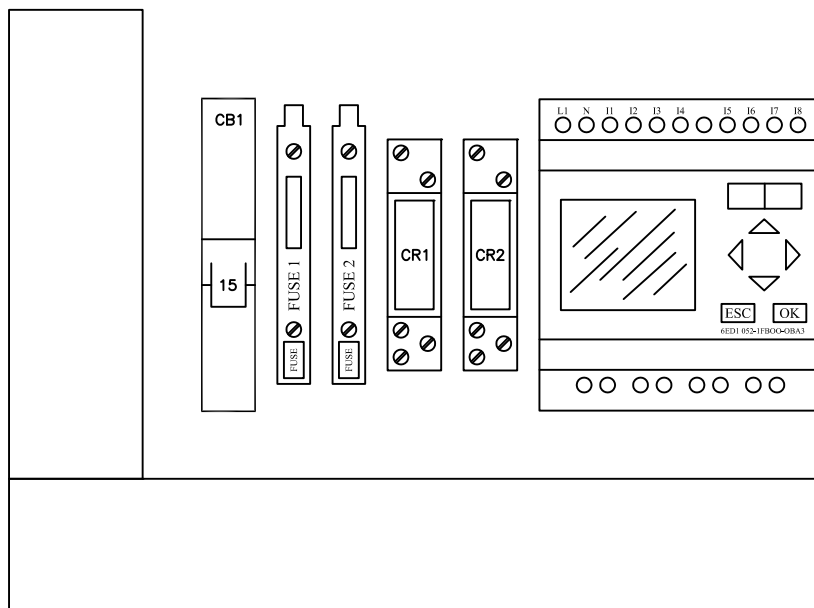

Delta Treatment Systems  
9125 Comar Drive Walker, LA 70782

## EXTERNAL CONNECTIONS DUAL DISC. FILTER BACKWASH CONTROL PANEL


DWN BY:  
BMF

DATE:  
08/04/20

SCALE:  
N.T.S.

DWG. NO. :  
2/3

JOB NO. :  
CP-1818-6-2HP

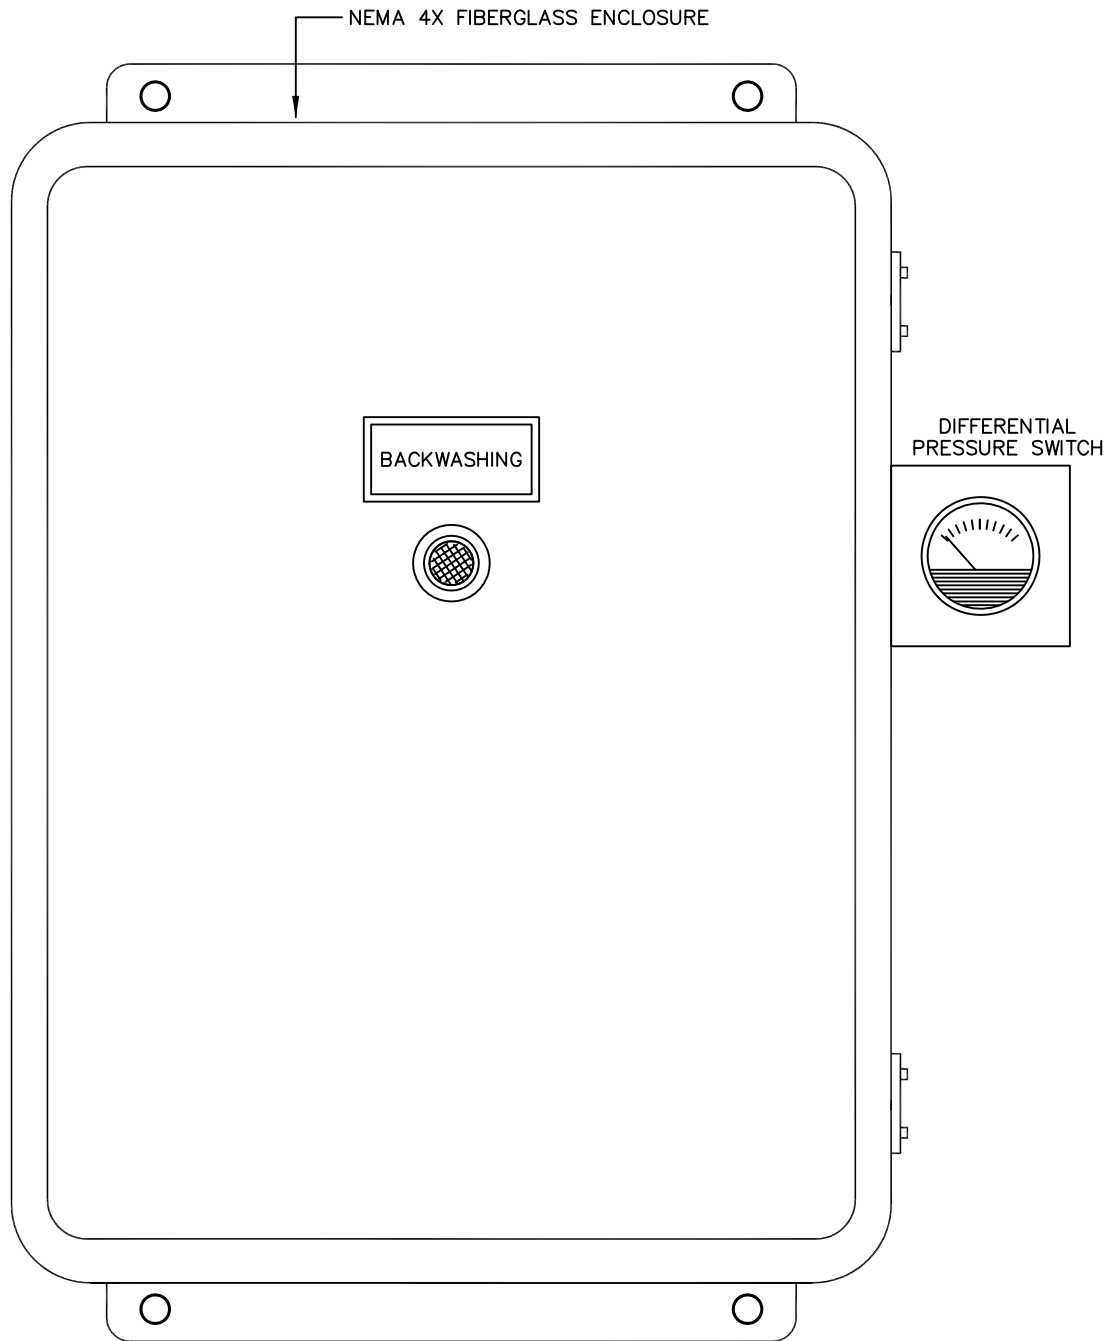

VIEW OF FRONT OF PANEL

**NOTE:**

SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.  
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE  
PANEL TO PREVENT ENTRY OF GASSES.



Delta Treatment Systems  
9125 Comar Drive Walker, LA 70782

ENCLOSURE  
DUAL DISC. FILTER  
BACKWASH CONTROL PANEL

DWN BY:  
BMF

DATE:  
08/04/20

SCALE:  
N.T.S.

DWG. NO. :  
3/3

JOB NO. :  
CP-1818-6-2HP

## BILL OF MATERIALS

ITEM	QTY.	MANUFACTURER	PART NUMBER	DESCRIPTION
1	1	STAHLIN	RJ1614HPL	ENCLOSURE
2	1	SQUARE D	QOU115	CB1
3	2	PHOENIX	UT4 HESI	FU1,2
4	2	IDEC	PY2SULAC24	CR1,2
5	1	SIEMENS	OBA8	PLC
6	1	WHITE RODGERS	90T40F3	120V/24V TRANSFORMER
7	1	STOCK	E-Z SWITCH	E-Z SWITCH
8	1	MURPHY	A20DP-K-15	DIFF. PRESSURE SWITCH
9	1	EBT	511-1548	24VAC LED LIGHT
10	1	ABB	CL100-R	LED LIGHT HOLDER
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				
26				
27				
28				
29				
30				



Delta Treatment Systems  
9125 Comar Drive Walker, LA 70782

### BILL OF MATERIALS DUAL DISC. FILTER BACKWASH CONTROL PANEL

DWN BY:  
BMF

DATE:  
08/04/20

SCALE:  
N.T.S.

DWG. NO. :

JOB NO. :  
CP-1818-6-2HP