

---

---

# COX

Research and Technology, Inc.

---


---

ALBANY  
EWST  
CONTROL PANEL 2

Cox Research and Technology, Inc.  
14697 S. Harrells Ferry Road  
Baton Rouge, LA. 70816  
(225) 756-3271 Fax (225) 755-1030

CP-2268



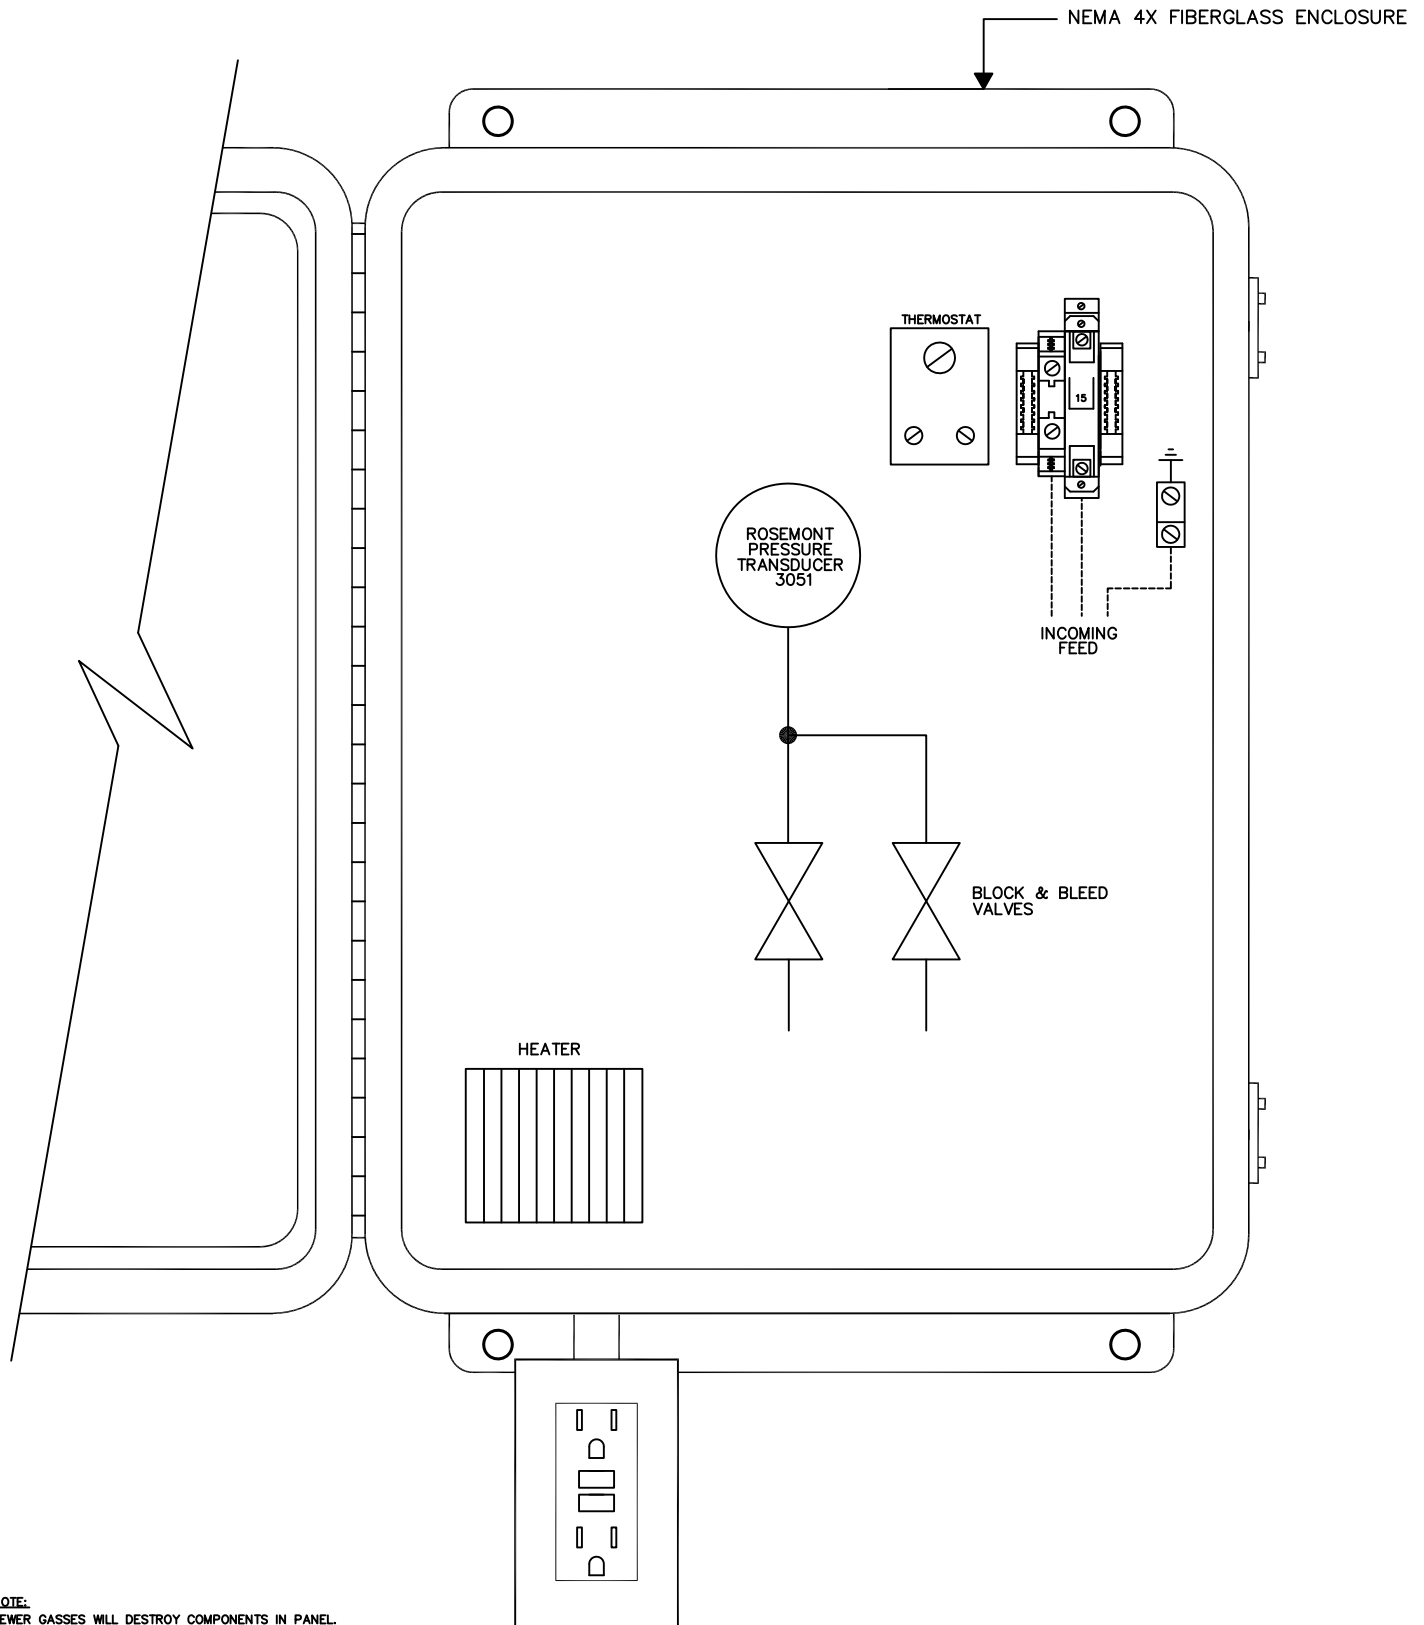

NOTE:  
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.  
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE  
PANEL TO PREVENT ENTRY OF GASSES.

DATE 1/16/06	Drawing Title								
	ENCLOSURE								
	REFERENCE DRAWING		NO.	REVISION-LOCATION		ECN	DATE	BY	
	S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN		APPROVED			
	Project Title			BY	CTR	BY	DATE	PURCHASE ORDER NUMBER	
	EWST CONTROL PANEL 2		<div>COX</div> <div>Research and Technology, Inc.</div>	P.O. Box 77808 Baton Rouge, LA 70809  Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-2268		SHEET NUMBER 2	

## BILL OF MATERIALS

[illegible][illegible]