
COX

Research and Technology, Inc.

DUPLEX BLOWER
CONTROL PANEL
PINEHILLS

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-2293

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	1/60	
NO. MOTORS	2	
HP	5	
FLA	28	
TYPE OF PUMP	Blower	(Self-Priming, Submersible)
MANUFACTURER		
CATALOG NUMBER		
CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR		(Floats, Bubbler, Other)
CAPACITORS		(Yes, No)
CAPACITOR WIRING FIGURE		
THERM. & SEAL FAIL WIRING FIGURE		


OPTIONS:


SEAL FAIL LIGHTS		(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN		(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT		
LIGHT PANEL MTD		
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER		
ELAPSED TIME METER		
PHASE MONITOR		
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		


SOLD TO: Delta Process - Ruston, LA

TAG : Pinehills

SHIP TO: Delta Process - Ruston, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 1/25/06		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div style="text-align: center;">  COX Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX BLOWER CONTROL PANEL				Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-2293
							SHEET NUMBER 1

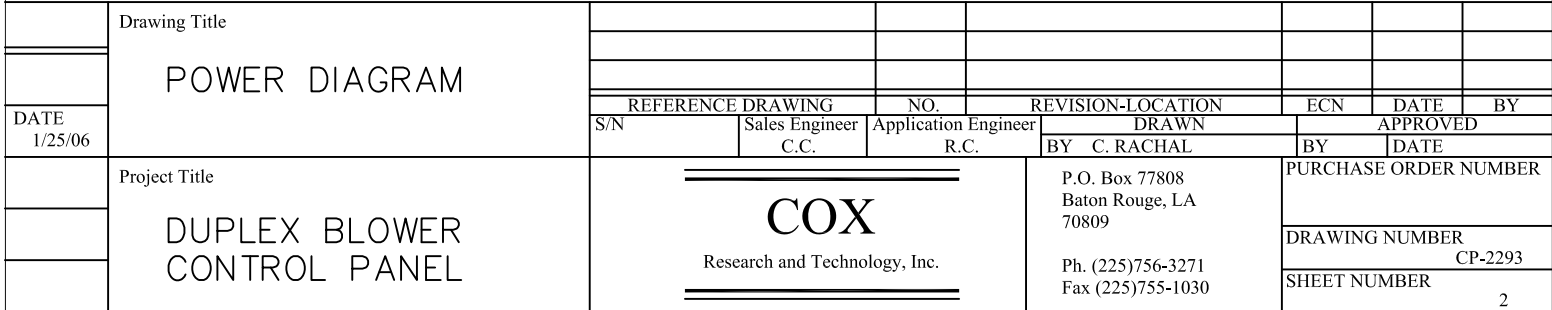

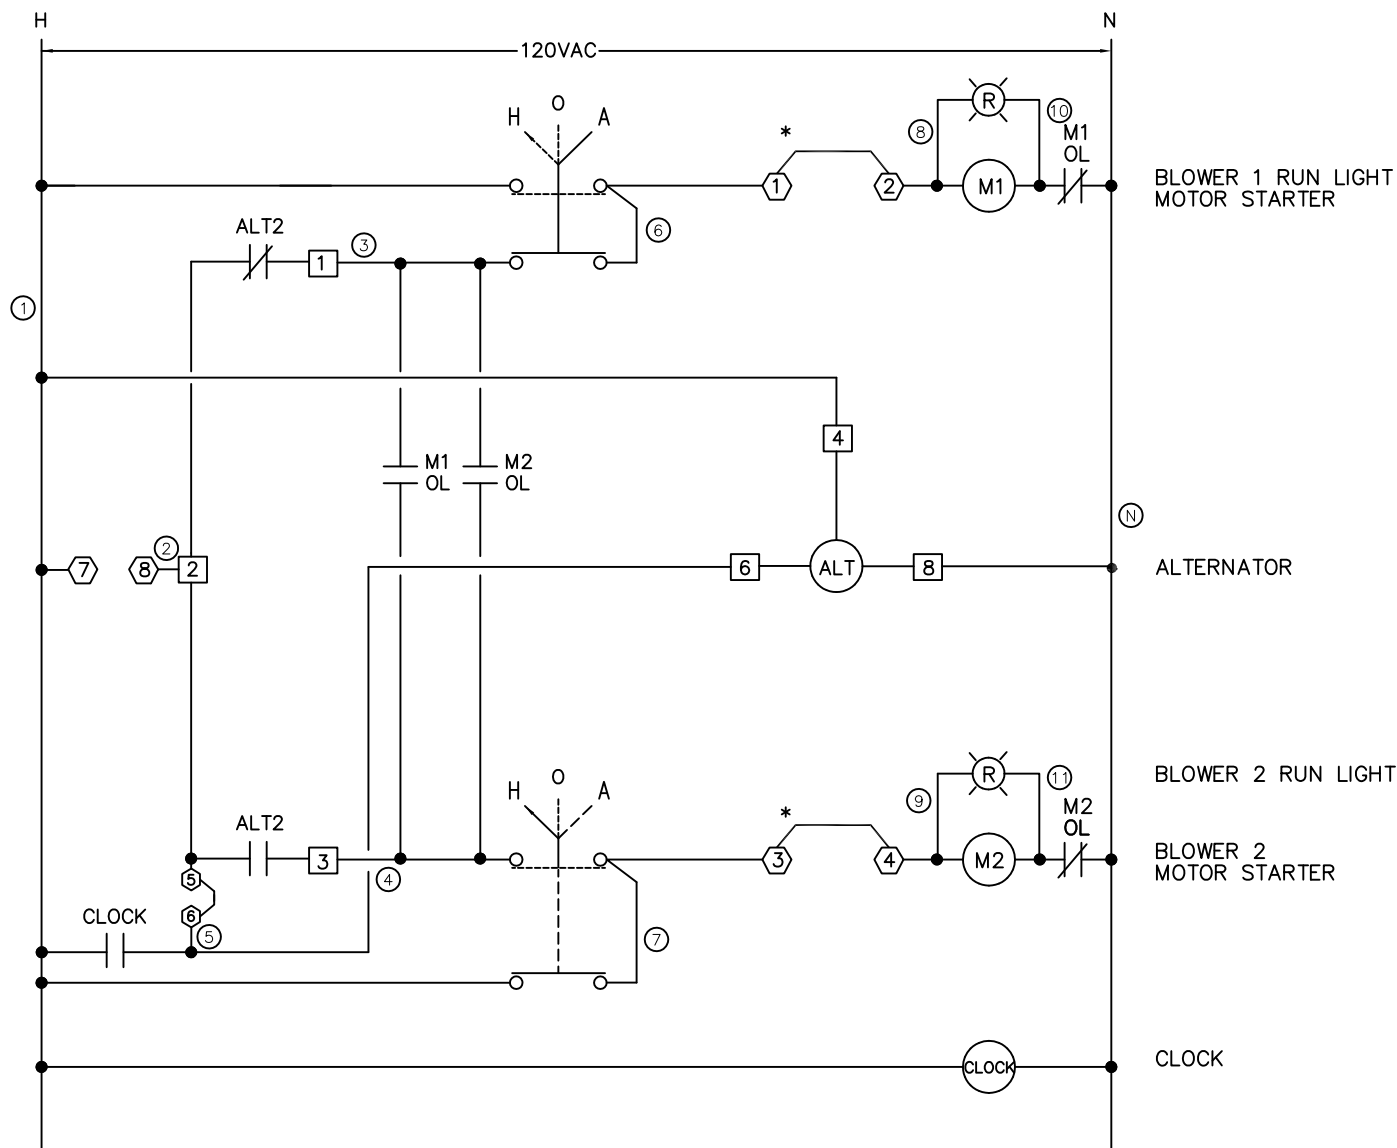

PANEL IS DESIGNED TO RUN AERATORS WITH A MINIMUM OF 15 MINUTES OF OFF TIME BETWEEN ALTERNATION. PINS PUSHED OUT ON CLOCK INDICATE RUN TIME. PINS PUSHED IN INDICATE OFF TIME. EACH PIN IS EQUAL TO 15 MINUTES.

IF NO OFF TIME IS REQUIRED BETWEEN ALTERNATION, REMOVE JUMPER FROM TERMINALS ⑤ AND ⑥ PLACE JUMPER ACROSS TERMINALS ⑦ AND ⑧ NOW AERATORS WILL RUN CONTINUOUSLY. SET 1 PIN IN AT THE TIME YOU WISH THE AERATORS TO ALTERNATE. ALL REMAINING PINS SHOULD BE PUSHED OUT.

* REMOVE JUMPERS AND INSTALL LOCKOUT DEVICES IF REQUIRED

Drawing Title							
CONTROL DIAGRAM							
DATE 1/25/06	REFERENCE DRAWING		NO.		REVISION-LOCATION		ECN
	S/N		Sales Engineer C.C.		Application Engineer R.C.		DATE
Project Title		DRAWN		APPROVED		BY	
DUPLEX BLOWER CONTROL PANEL		BY C. RACHAL				DATE	
		PURCHASE ORDER NUMBER					
		DRAWING NUMBER					
		SHEET NUMBER					


COX

Research and Technology, Inc.

P.O. Box 77808
Baton Rouge, LA
70809

Ph. (225)756-3271
Fax (225)755-1030


DRAWING NUMBER
CP-2293

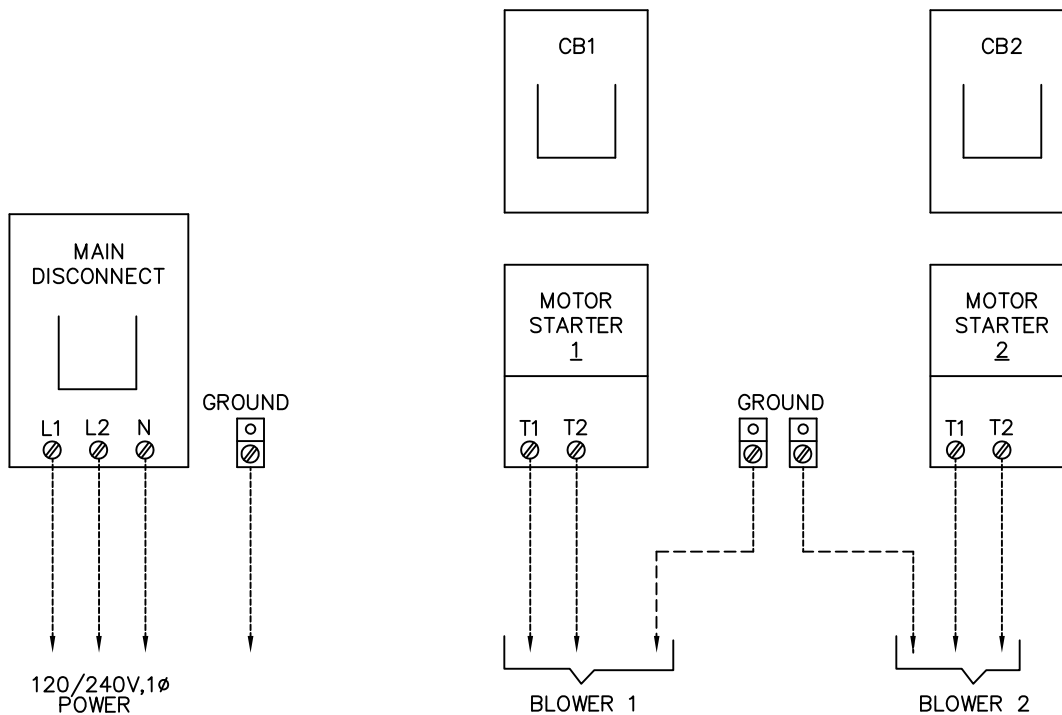

REMOVE JUMPERS & INSTALL
LOCKOUT DEVICES IF REQUIRED

IF NO OFF TIME IS REQUIRED BETWEEN
ALTERNATION, REMOVE JUMPER FROM
TERMINALS ⑤ AND ⑥. PLACE JUMPER ACROSS
TERMINALS ⑦ AND ⑧. NOW AERATORS WILL RUN
CONTINUOUSLY. SET 1 PIN IN AT THE TIME YOU
WISH THE AERATORS TO ALTERNATE.
ALL REMAINING PINS SHOULD BE PUSHED OUT.

	Drawing Title							
	EXTERNAL CONNECTIONS							
DATE 1/25/06		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	BY C. RACHAL	ECN	DATE	BY
	Project Title	COX			P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER		
	DUPLEX BLOWER CONTROL PANEL	Research and Technology, Inc.			Ph. (225)756-3271 Fax (225)755-1030	DRAWING NUMBER CP-2293		
						SHEET NUMBER 4		

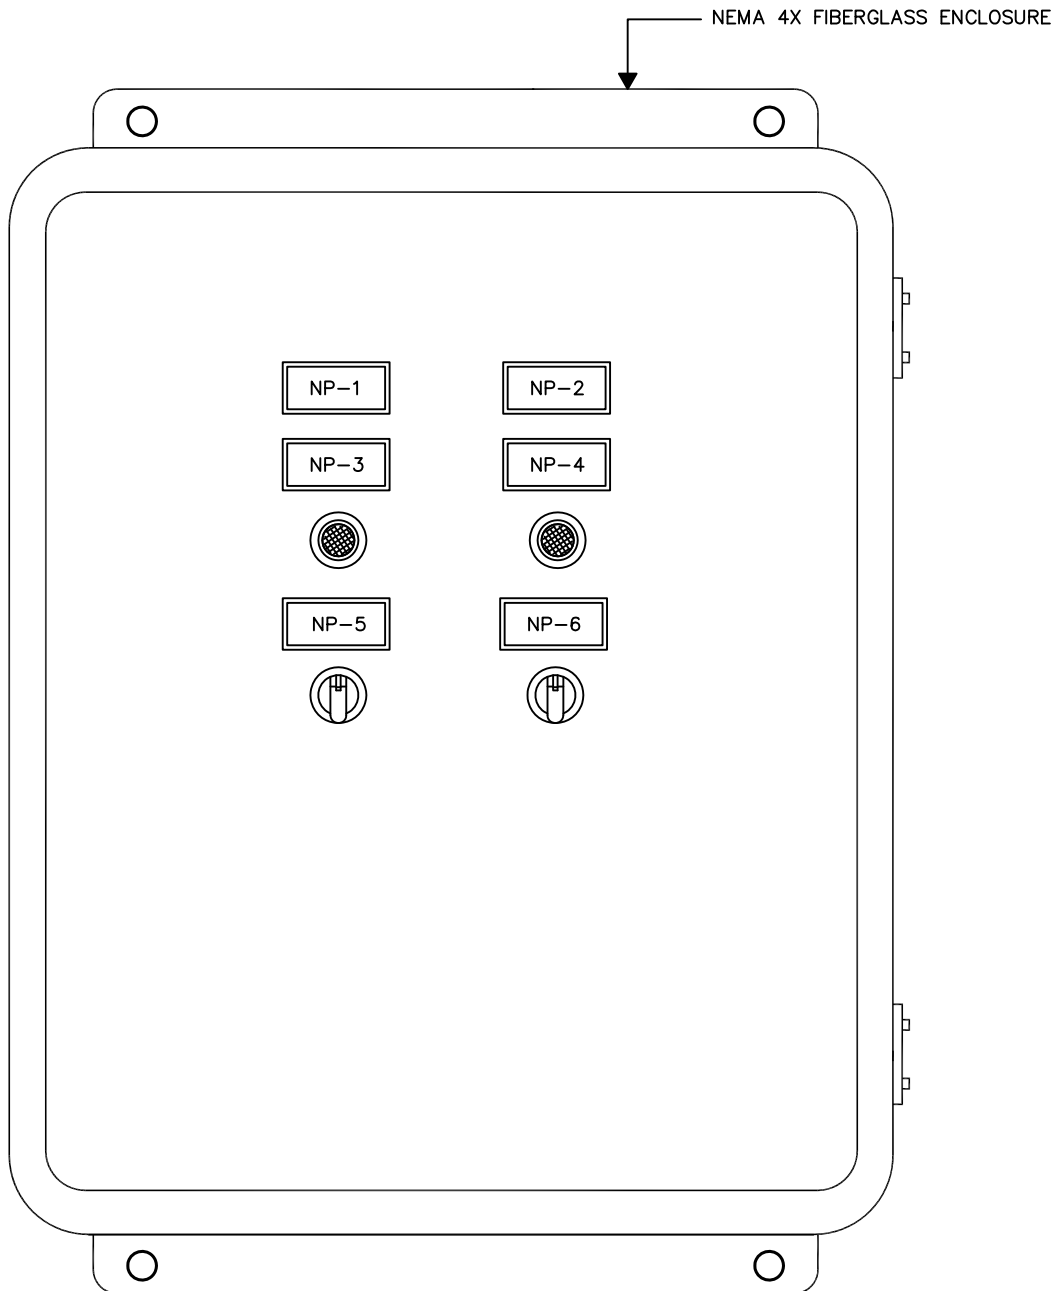

VIEW OF FRONT OF ENCLOSURE

NAMEPLATE SCHEDULE

NP-1	BLOWER 1
NP-2	BLOWER 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA

NOTE:

SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

	Drawing Title <	
--	--	--

BILL OF MATERIAL

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPL	ENCLOSURE
2	1	STAHLIN	BP1816AL	BACKPLATE
3	2	ABB	A30-30-10-84	STARTER
4	2	ABB	TA25DU32	O.L. (24-32A)
5	2	SQUARE D	QOU260	CIRCUIT BREAKER 1,2
6	1	ABB	OT63E3	DISC. SWITCH
7	2	ACI	JR22P3M20B	H.O.A. SWITCH
8	2	ACI	JR22FR	RED PILOT LIGHTS
9	1	TIMEMARK	261DT120	ALTERNATING RELAY
10	1	SQUARE D	QOU110	CIRCUIT BREAKER 3
11	1	GRASSLIN	FM/1 STUZH-L	TIMER
12	1	MARATHON	1323580	DISTRIBUTION BLOCK

	Drawing Title							
	BILL OF MATERIALS							
DATE 1/25/06		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
						APPROVED BY	DATE	
	Project Title	<div style="border-top: 3px double black; border-bottom: 3px double black; padding: 5px;"> COX Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030		PURCHASE ORDER NUMBER DRAWING NUMBER CP-2293 SHEET NUMBER 6	
	DUPLEX BLOWER CONTROL PANEL							