
COX

Research and Technology, Inc.

NEAL CONSTRUCTION
DUPLEX PUMP
CONTROL PANEL
2HP

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP2113

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	1/60	
NO. MOTORS	2	
HP	2	
FLA	12	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	Meyers	
CATALOG NUMBER	WGL 20-21	

CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	Yes	(Yes, No)
CAPACITOR WIRING FIGURE	M	
THERM. & SEAL FAIL WIRING FIGURE	1, 6, 8	

OPTIONS:


SEAL FAIL LIGHTS	X	(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER		
ELAPSED TIME METER		
PHASE MONITOR		
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION	X	

SOLD TO: Delta Process -Denham Springs, LA

TAG : NEAL CONSTRUCTION

SHIP TO: Delta Process - Denham Springs, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 10/30/03		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	APPROVED BY	DATE
	Project Title	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER DRAWING NUMBER CP-2113 SHEET NUMBER 1
	DUPLEX PUMP CONTROL PANEL						

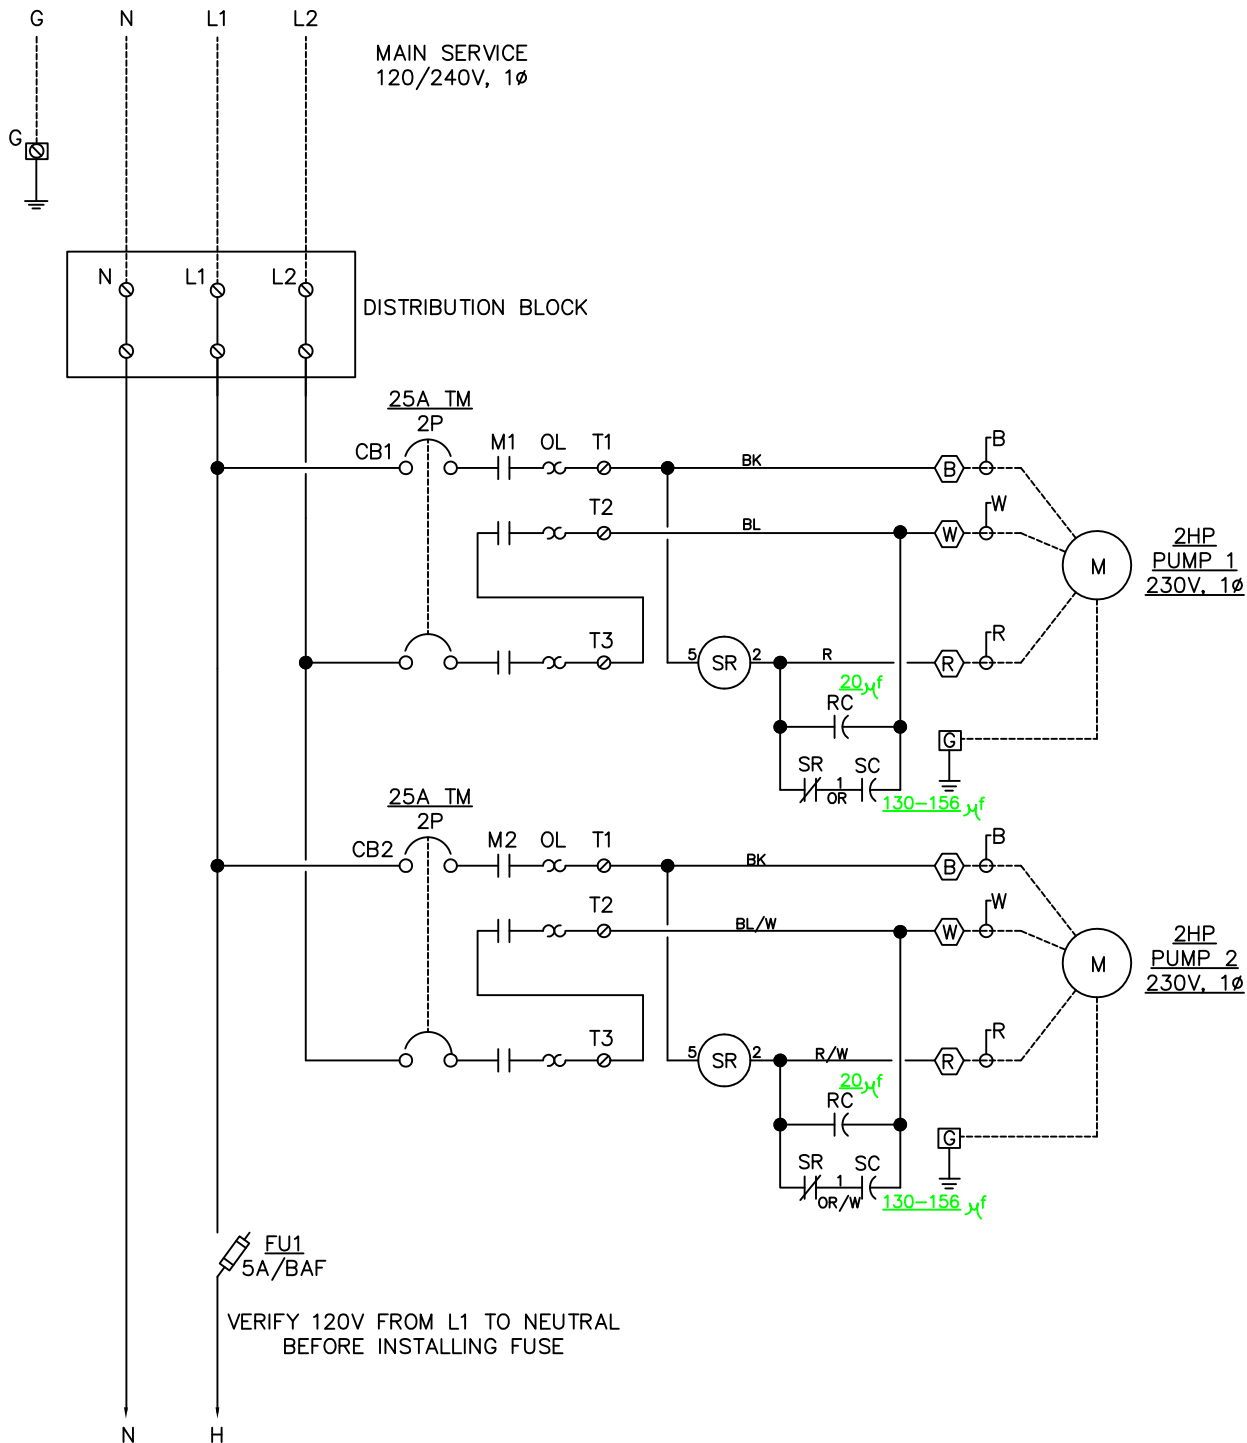


	Drawing Title								
	POWER DIAGRAM								
DATE 10/30/03		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY		
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	APPROVED			
	Project Title					PURCHASE ORDER NUMBER			
	DUPLEX PUMP CONTROL PANEL					DRAWING NUMBER CP-2113			
						SHEET NUMBER			

COX

Research and Technology, Inc.


P.O. Box 77808
Baton Rouge, LA
70809

Ph. (225)756-3271
Fax (225)756-1030

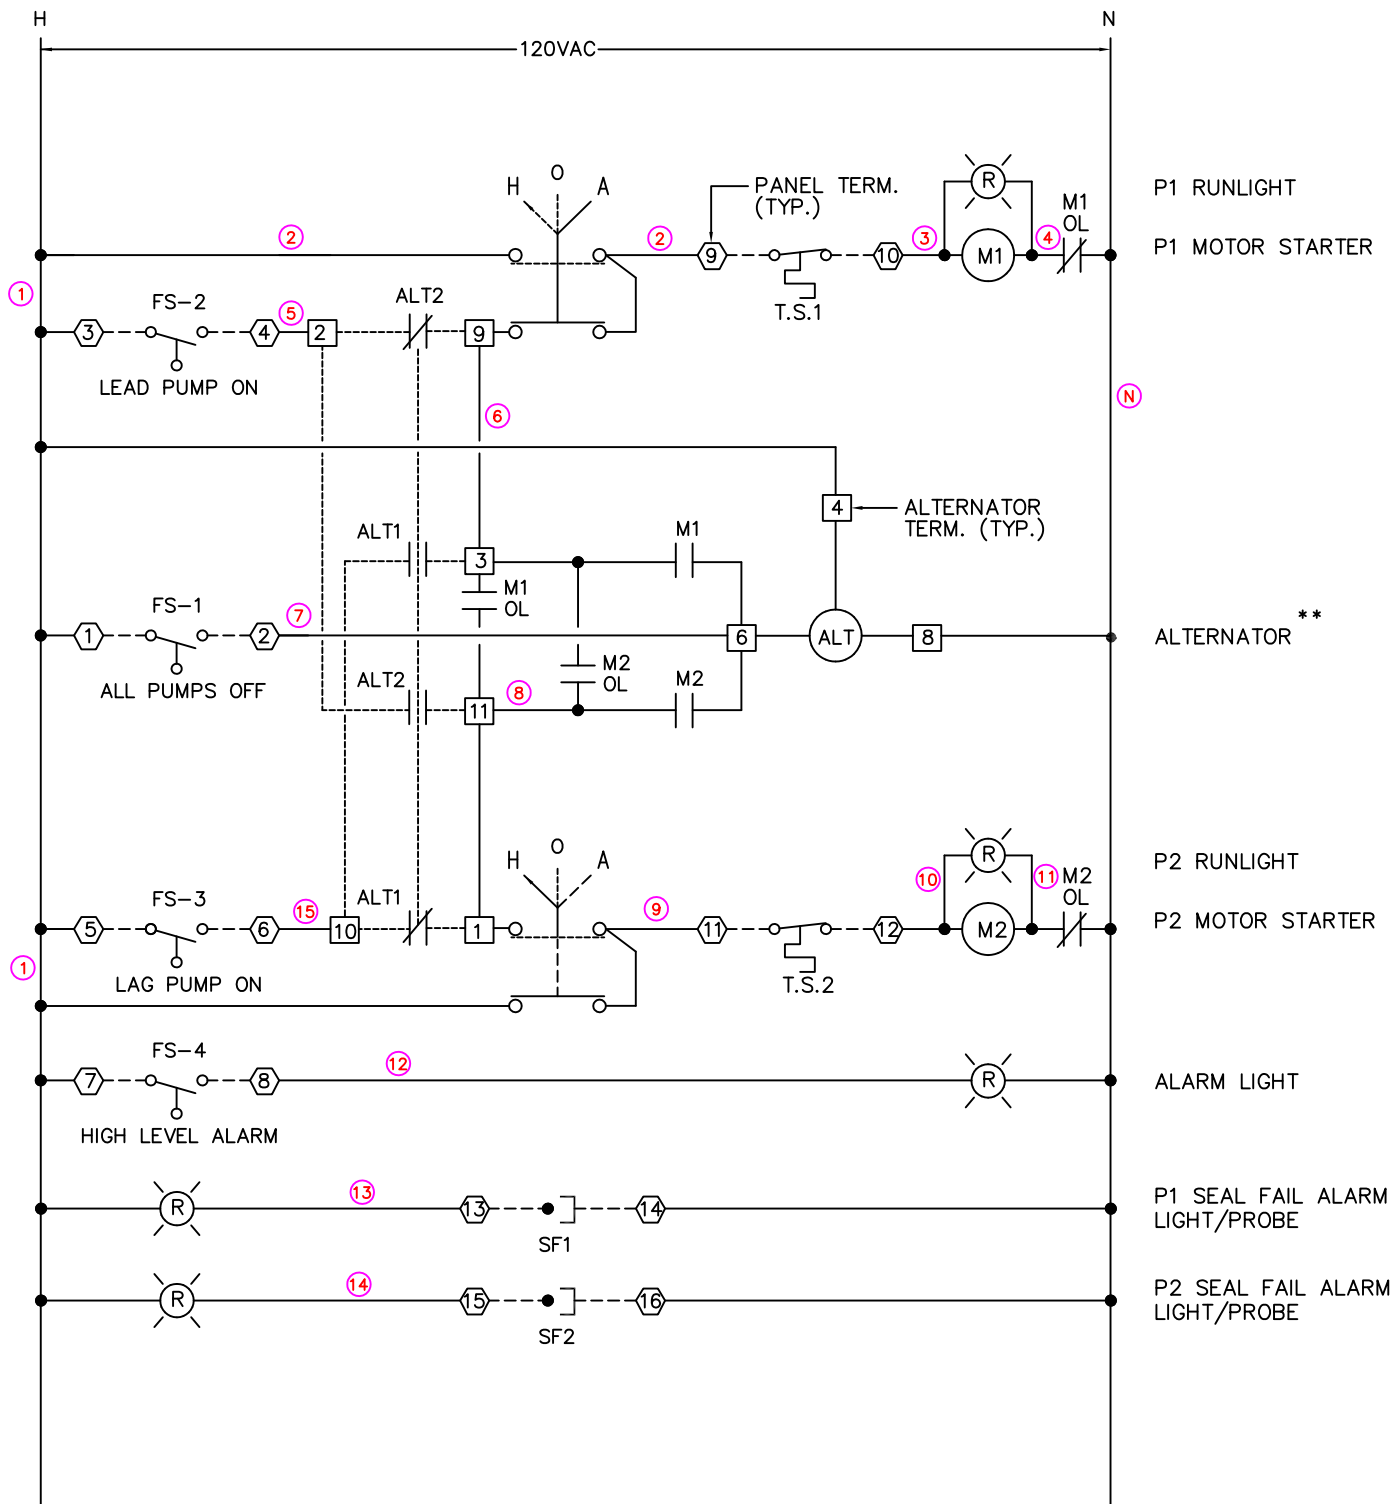

** DIVERSIFIED ALTERNATOR

Drawing Title							
CONTROL DIAGRAM							
DATE 6/30/05	REFERENCE DRAWING		NO.		REVISION-LOCATION		ECN
	S/N		Sales Engineer C.C.		Application Engineer R.C.		DATE
Project Title		DRAWN		APPROVED		BY	
DUPLIX PUMP CONTROL PANEL		BY C. RACHAL				DATE	
		P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER			
		Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-2113			
				SHEET NUMBER		3	

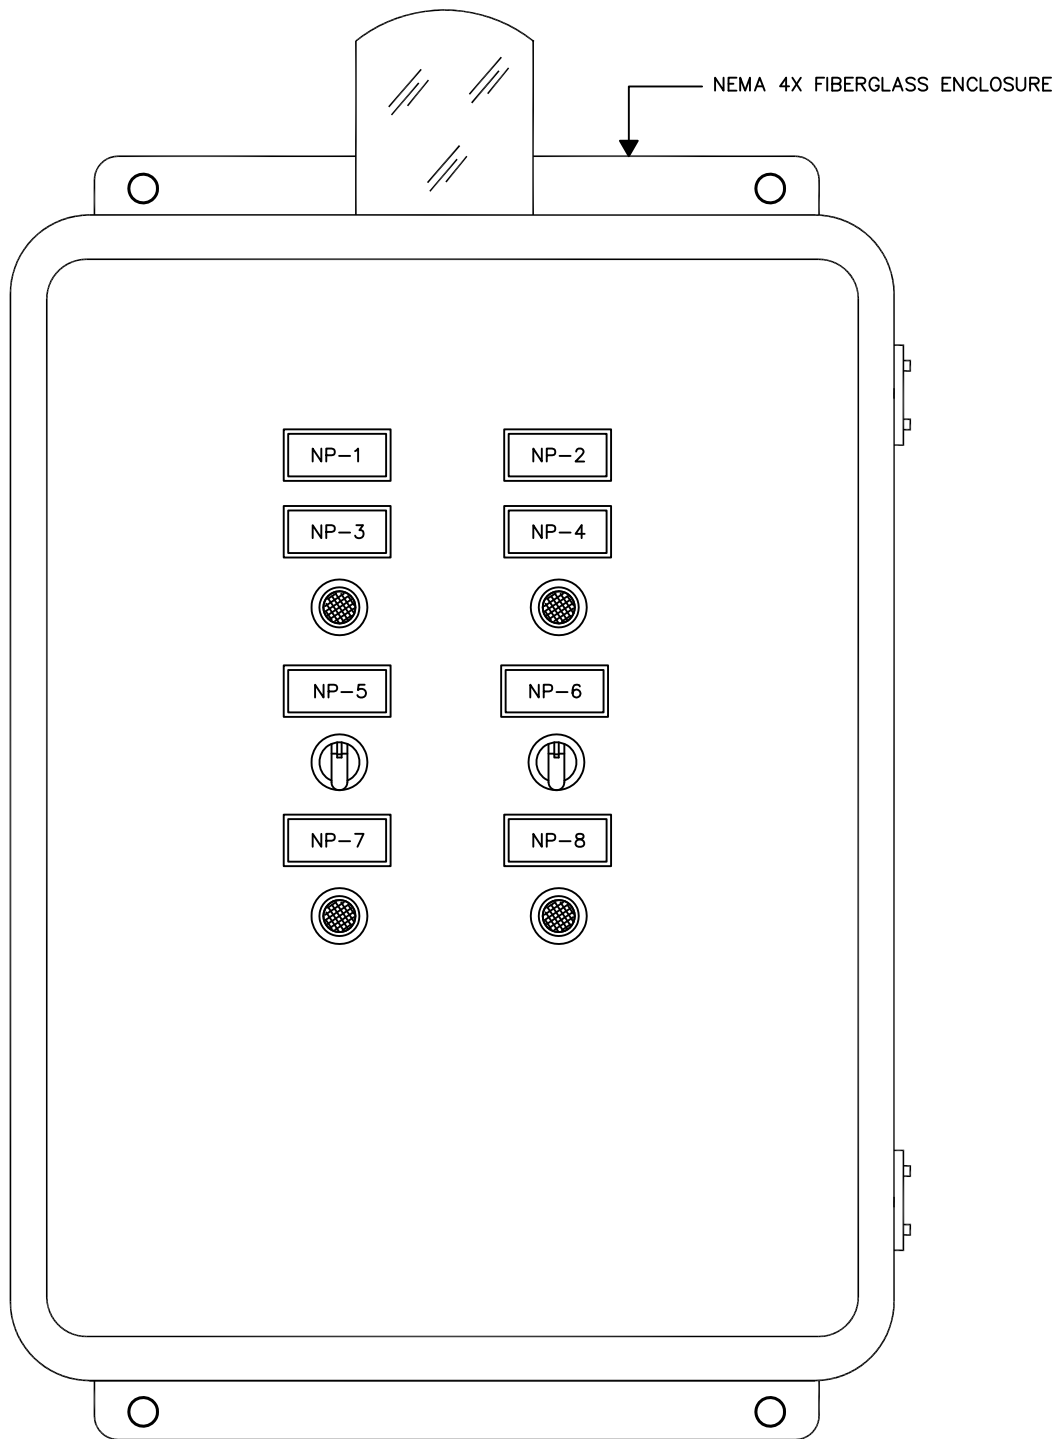

VIEW OF FRONT OF PANEL

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL

NOTE:

SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

	Drawing Title 	
--	---	--

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1614HPL	ENCLOSURE
1a	1	STAHLIN	BP1614AL	BACKPLATE
2	2	ABB	A16-30-10-84	MOTOR STARTER
3	2	ABB	TA25DU14	O.L. RELAY (10-14A)
4	2	SQUARE D	QOU225	CB1, CB2
5	1	DIVERSIFIED	ARB-120-ADA	ALTERNATING RELAY
6	4	ACI	JR22FR	RED PILOT LIGHT
7	2	ACI	JR22P3M20B	HOA SWITCH
8	1	INGRAM	MX-15	ALARM LIGHT
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title							
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>							
DATE 10/30/03		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
		<div style="border-top: 3px double black; border-bottom: 3px double black; padding: 5px 0;"> <h1 style="margin: 0;">COX</h1> <p style="margin: 0;">Research and Technology, Inc.</p> </div>		<p>P.O. Box 77808 Baton Rouge, LA 70809</p> <p>Ph. (225)756-3271 Fax (225)756-1030</p>		<p>PURCHASE ORDER NUMBER</p> <hr/> <p>DRAWING NUMBER CP-2113</p> <hr/> <p>SHEET NUMBER</p>		
	Project Title	<div style="border-top: 3px double black; border-bottom: 3px double black; padding: 5px 0;"> <h1 style="margin: 0;">COX</h1> <p style="margin: 0;">Research and Technology, Inc.</p> </div>			<p>P.O. Box 77808 Baton Rouge, LA 70809</p> <p>Ph. (225)756-3271 Fax (225)756-1030</p>		5	
	DUPLEX PUMP CONTROL PANEL							