


MAIN SERVICE  
120/240V, 1Ø

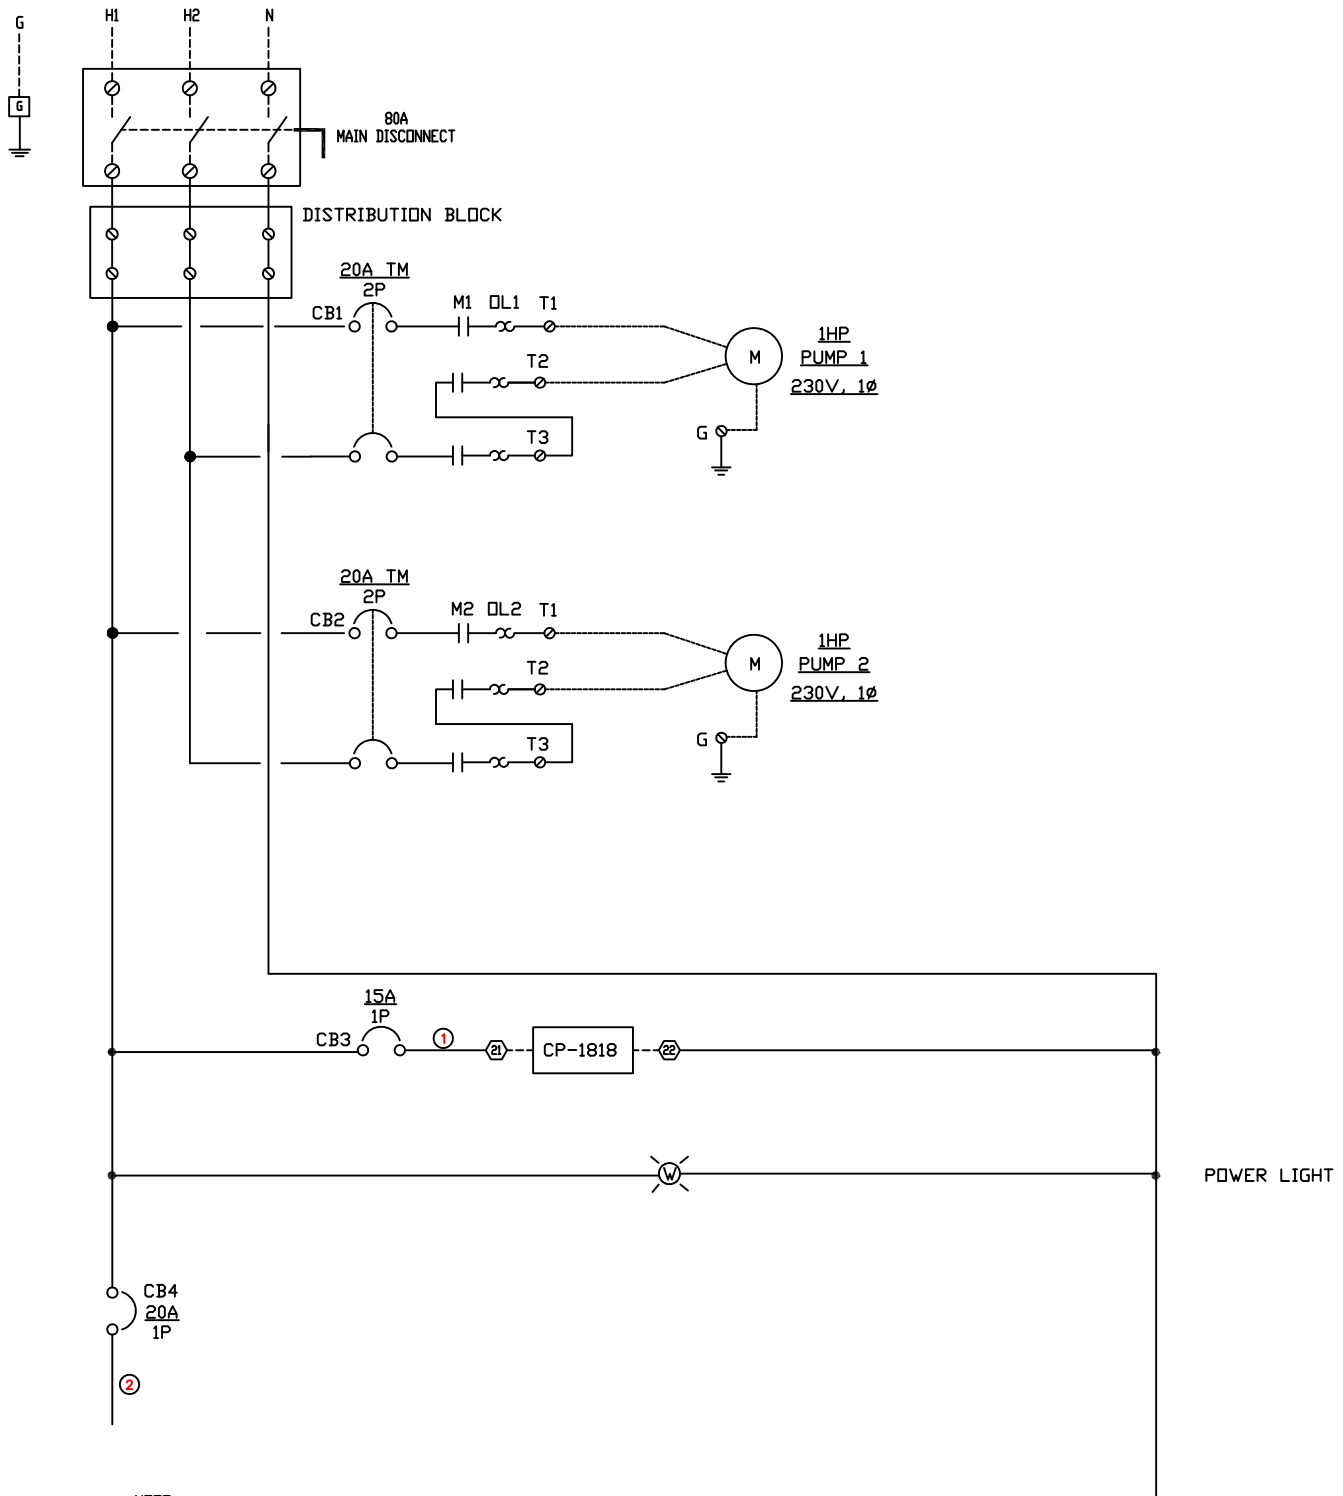

LEGEND

— WIRING BY VENDOR  
- - - WIRING BY CUSTOMER

NOTE

1. INTERNAL PUMP THERMAL OVERLOAD IS RECOMMENDED.
2. PLC WILL INDICATE NUMBER OF HIGH LEVEL ALARMS AND NUMBER OF TIMES A PUMP IS TURNED TO HAND POSITION.

PROGRAM  
PULSE 6 FIELDS W/O  
BACKWASH VALVE r1 FOR  
PANEL CP-1811



Delta Environmental Products, Inc.  
P.O. Box 969 Denham Springs, LA 70727

# Schematic Diagram Filter System


DWN BY:  
C.RACHAL

DATE:  
6/09/04

SCALE:  
N.T.S.

DWG. NO.:  
1 OF 6

JOB NO.:  
CP-1811

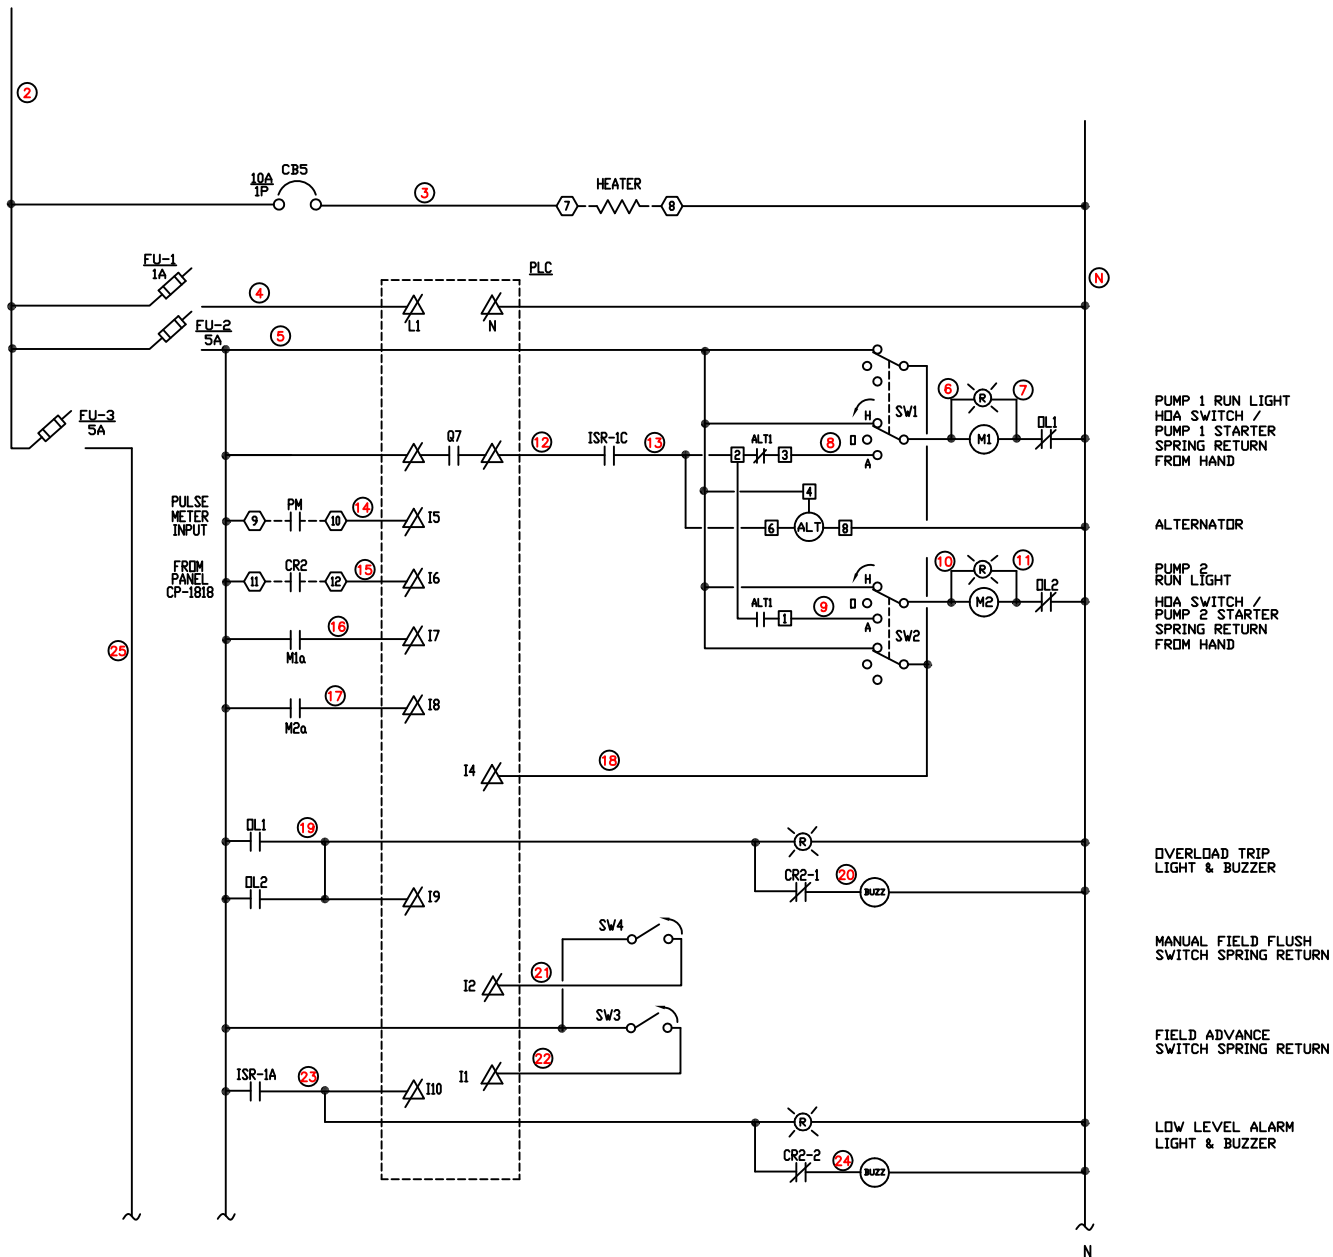

Delta Environmental Products, Inc.  
P.O. Box 969 Denham Springs, LA 70727

DWN BY:  
C.RACHAL


DATE:  
6/09/04

SCALE:  
N.T.S.

DWG. NO.:  
2 OF 6

JOB NO.:  
CP-1811

## Schematic Diagram Filter System

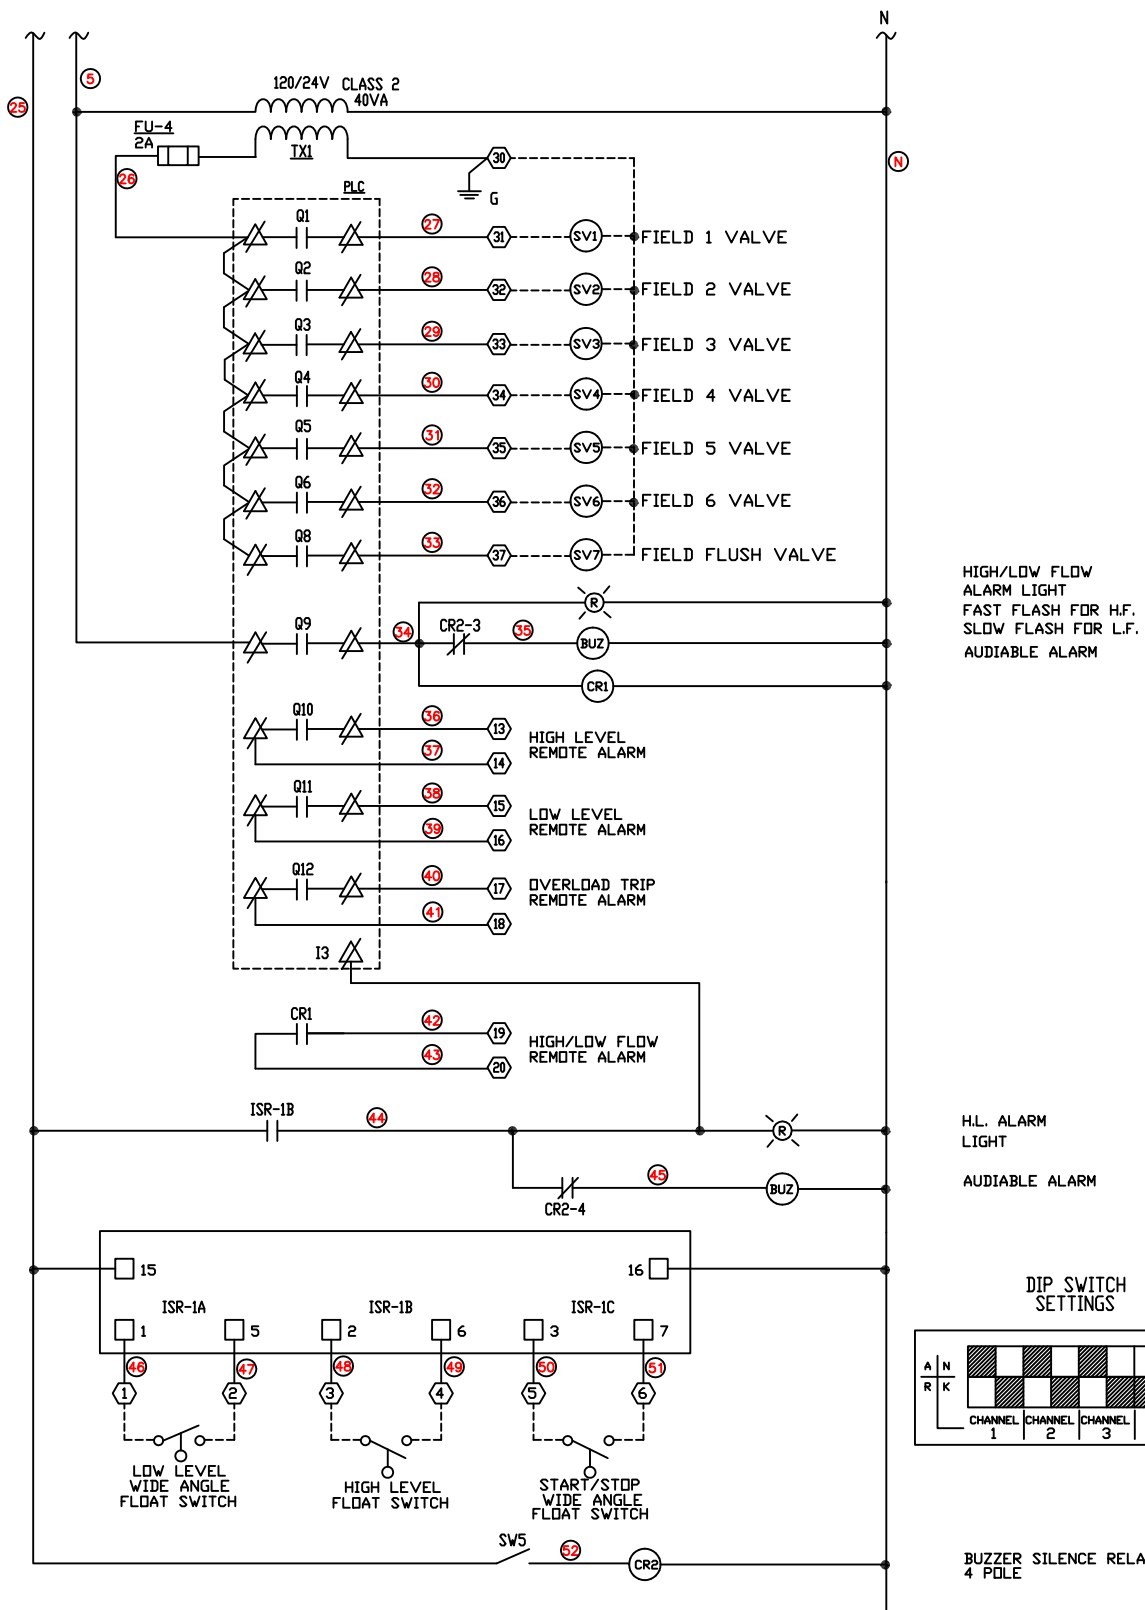

PROGRAM  
PULSE 6 FIELDS W/O  
BACKWASH VALVE r1 FOR  
PANEL CP-1811



Delta Environmental Products, Inc.  
P.O. Box 969 Denham Springs, LA 70727

DWN BY:  
C.RACHAL

DATE:  
6/09/04


SCALE:  
N.T.S.

DWG. NO.:  
3 OF 6


JOB NO.:  
CP-1811

## Schematic Diagram Filter System



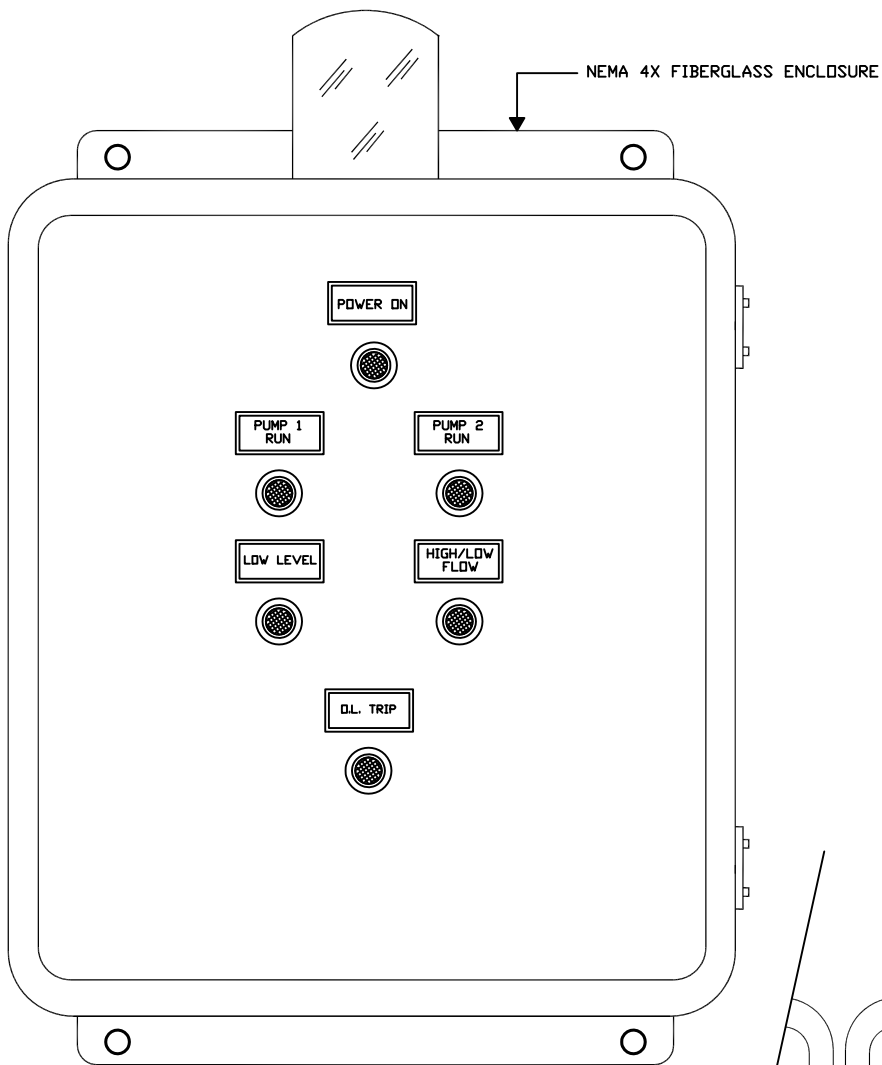

VIEW OF FRONT OF ENCLOSURE

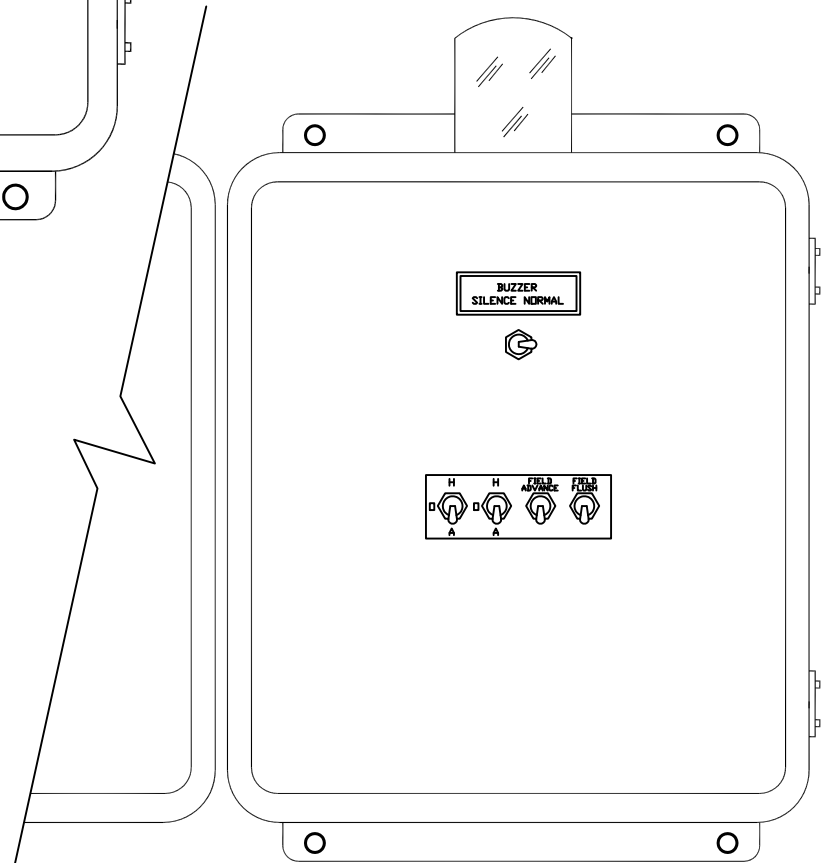

VIEW OF SWING PANEL



Delta Environmental Products, Inc.  
P.O. Box 969 Denham Springs, LA 70727

DWN BY:  
C.RACHAL


DATE:  
6/09/04

SCALE:  
N.T.S.

DWG. NO.:  
5 OF 6

JOB NO.:  
CP-1811

## ENCLOSURE Filter System

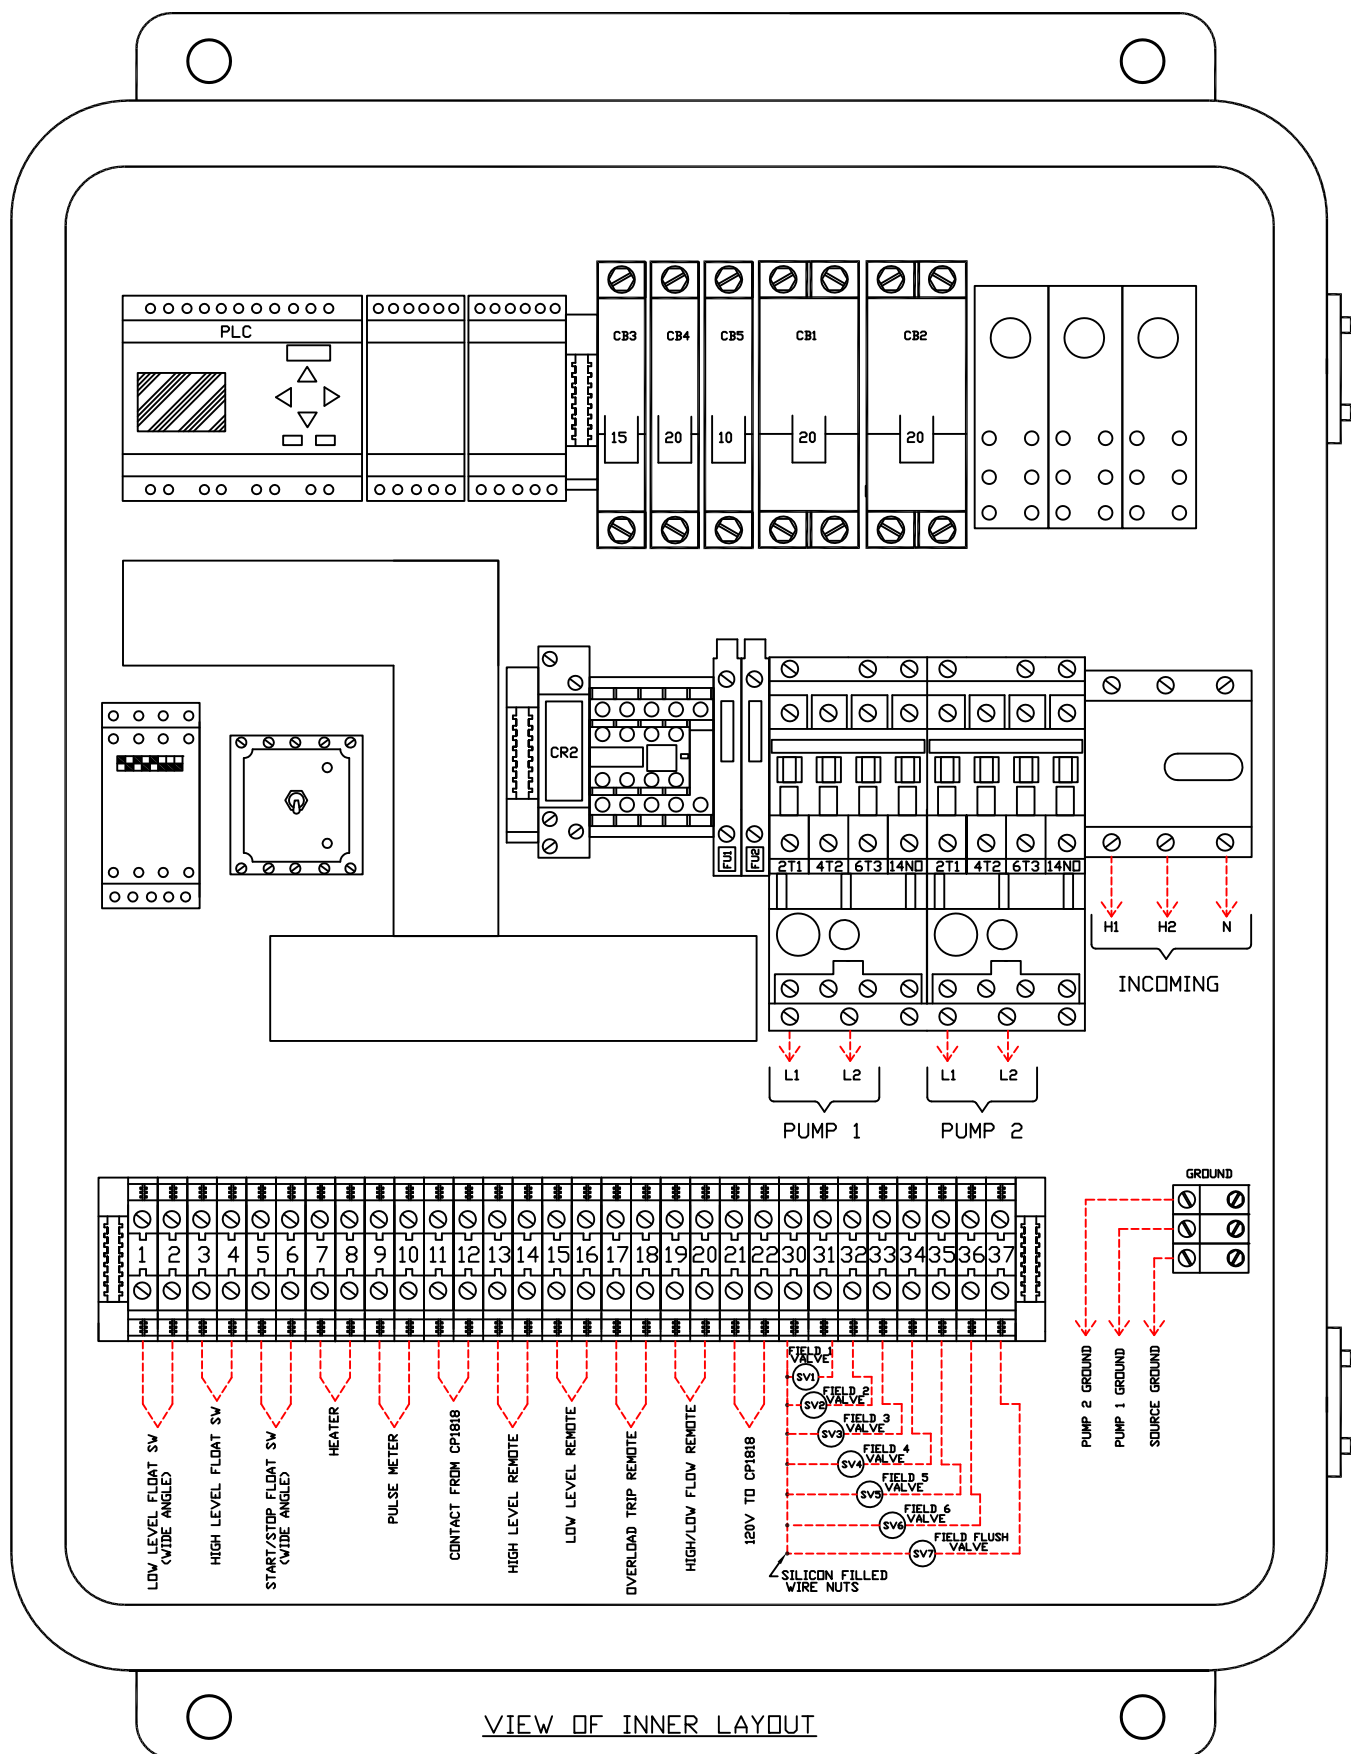

Delta Environmental Products, Inc.  
P.O. Box 969 Denham Springs, LA 70727

DWN BY:  
C.RACHAL

DATE:  
6/09/04

SCALE:  
N.T.S.

DWG. NO.:  
6 OF 6

JOB NO.:  
CP-1811

## ENCLOSURE Filter System