
COX

Research and Technology, Inc.

WEST RIDGE SUBDIVISION
DUPLEX PUMP
CONTROL PANEL

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-1679

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	1/60	
NO. MOTORS	2	
HP	2.7 HP	
FLA	11.9	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	GR	
CATALOG NUMBER	JSV 3A60-E 2.7	

CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	Yes	(Yes, No)
CAPACITOR WIRING FIGURE	G	
THERM. & SEAL FAIL WIRING FIGURE	5	


OPTIONS:

SEAL FAIL LIGHTS		(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN	X	(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER	X	
ELAPSED TIME METER		
PHASE MONITOR		
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION	X	


SOLD TO: Delta Process - Ruston, LA
TAG : WEST RIDGE SUBDIVISION

SHIP TO: Delta Process - Ruston, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 10/17/03		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	APPROVED BY	DATE
	Project Title	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER DRAWING NUMBER CP-1679 SHEET NUMBER 1
	DUPLEX PUMP CONTROL PANEL						

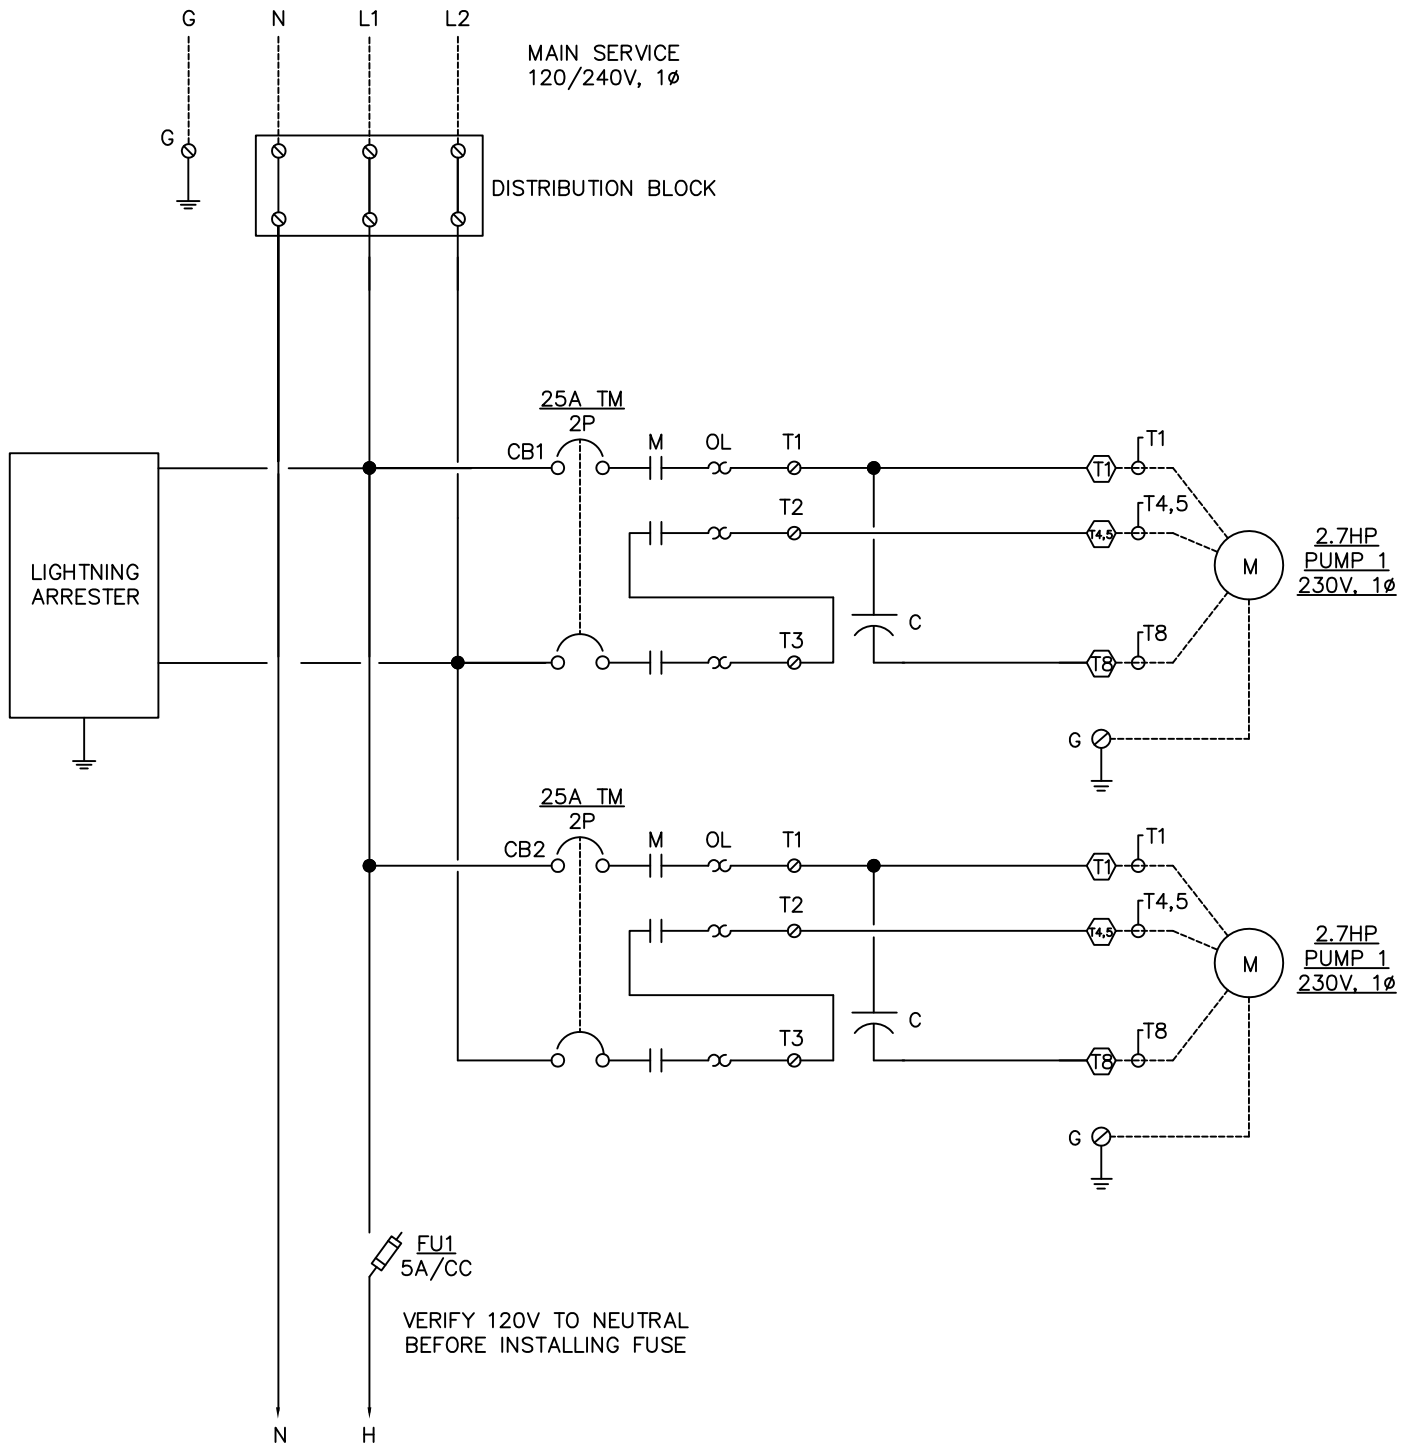

	Drawing Title							
	POWER DIAGRAM							
DATE 10/17/03		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
	Project Title	COX			P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER		
	DUPLEX PUMP CONTROL PANEL	Research and Technology, Inc.			Ph. (225)756-3271 Fax (225)756-1030	DRAWING NUMBER CP-1679		
						SHEET NUMBER 2		

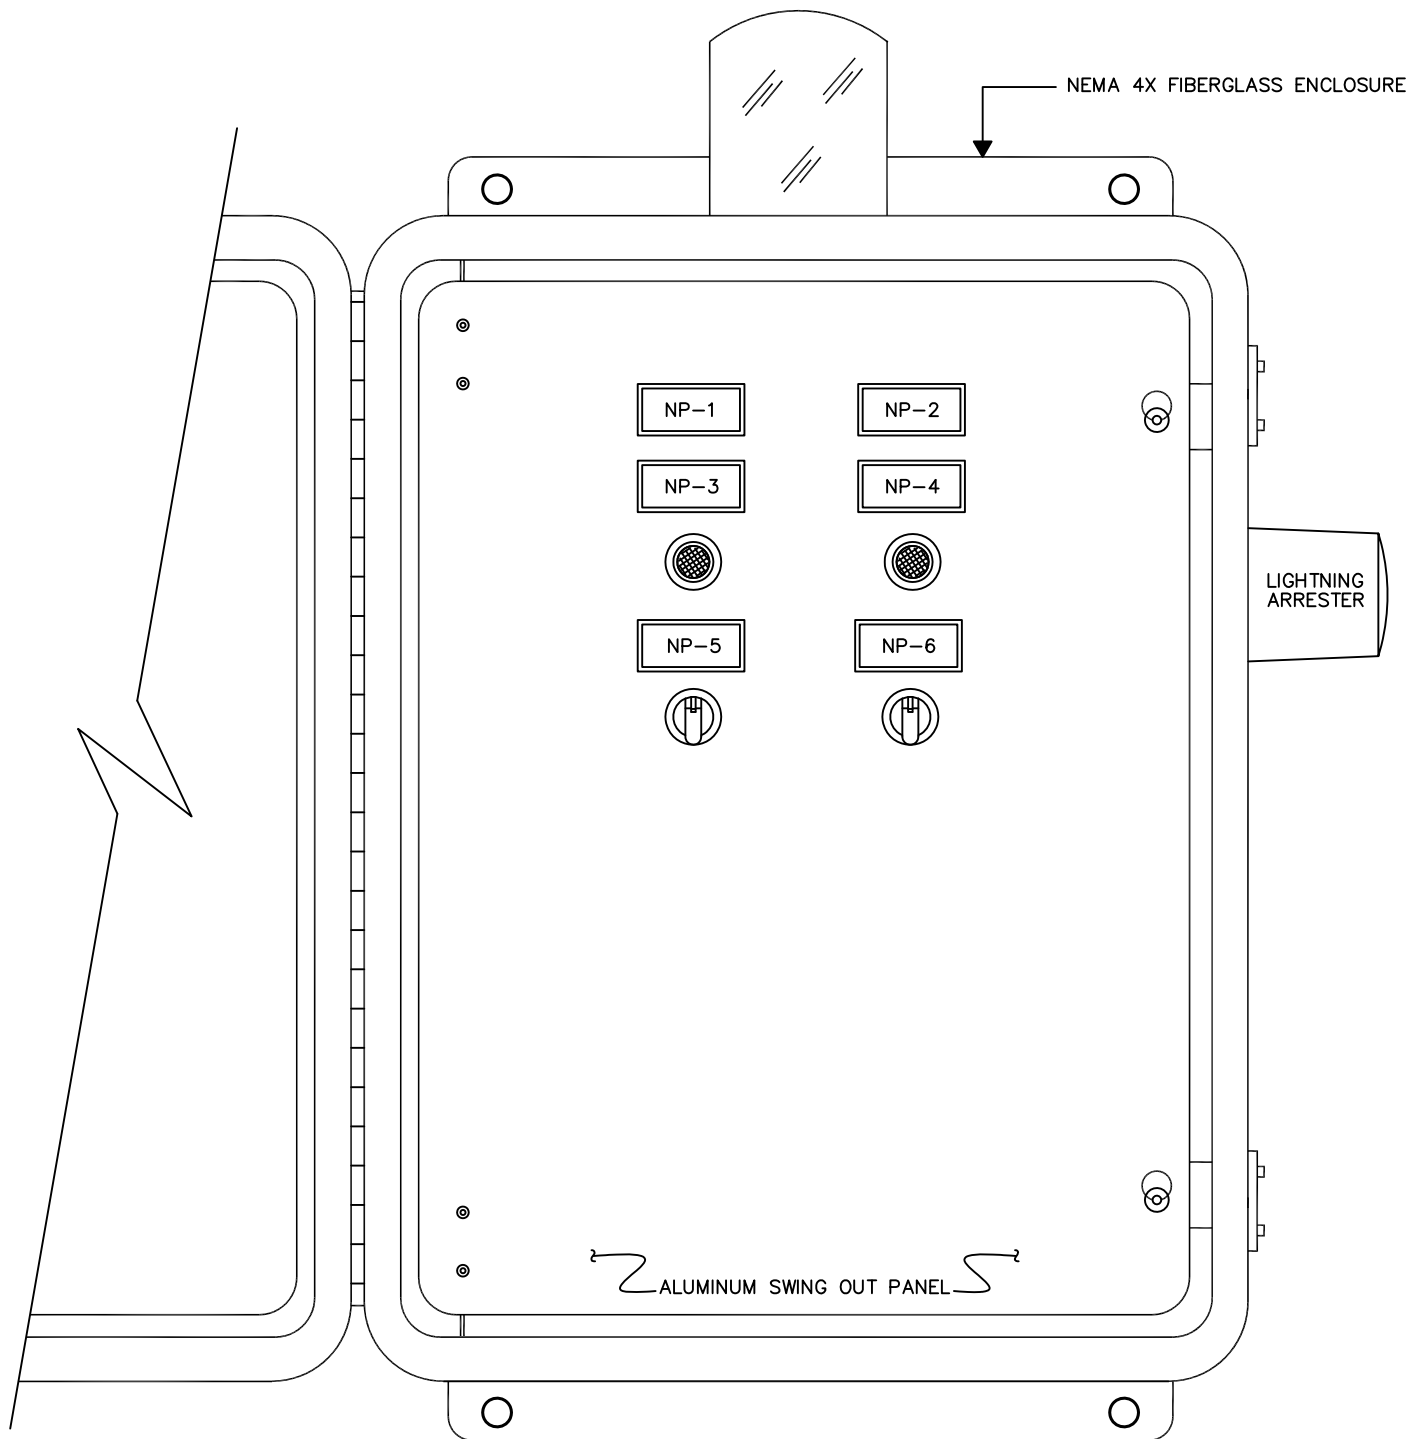

NOTE:
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA

DATE 10/17/03	Drawing Title							
	ENCLOSURE							
		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	APPROVED	DATE	
	Project Title				P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER		
	DUPLEX PUMP CONTROL PANEL	<div>COX</div> <div>Research and Technology, Inc.</div>			Ph. (225)756-3271 Fax (225)756-1030	DRAWING NUMBER CP-1679		
						SHEET NUMBER 4		

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	VYNCKIER	VJ1816HPLDF	ENCLOSURE
1a	1	VYNCKIER	MP1816AL	BACKPLATE
2	2	ABB	A16-30-10-84	MOTOR STARTER
3	2	ABB	TA25DU14	O.L. RELAY (10-14A)
4	2	SQUARE D	QOU225	CB1, CB2
5	1	TIMEMARK	261DT120	ALTERNATING RELAY
6	2	ACI	JR22FR	RED PILOT LIGHT
7	2	ACI	JR22P3M20B	HOA SWITCH
8	1	AC/DC	BL5-R-120	ALARM LIGHT
9	1	CH	CHSA01	LIGHTNING ARRESTER
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title						
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>						
DATE 10/17/03		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL	APPROVED BY	DATE
	Project Title	<div style="border-top: 3px double black; border-bottom: 3px double black; padding: 5px;"> <h1 style="margin: 0;">COX</h1> <p style="margin: 0;">Research and Technology, Inc.</p> </div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER DRAWING NUMBER <div style="text-align: right;">CP-1679</div> SHEET NUMBER <div style="text-align: right;">5</div>
	DUPLEX PUMP CONTROL PANEL						