





Delta Process Equipment, Inc.

OGVF2022AU
CONTROL PANEL

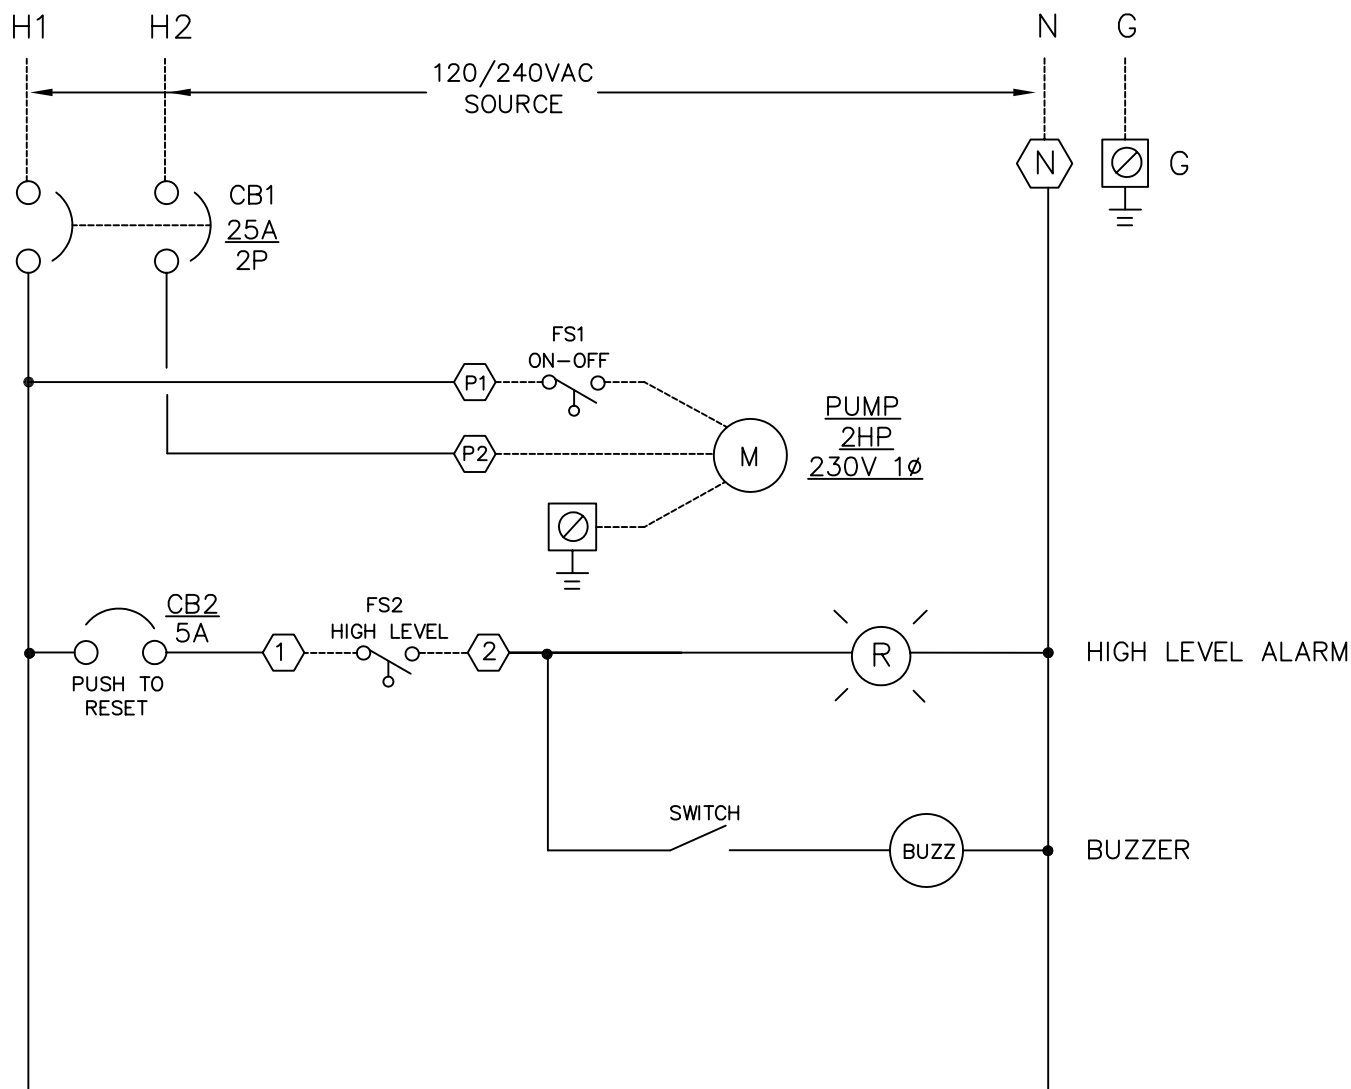


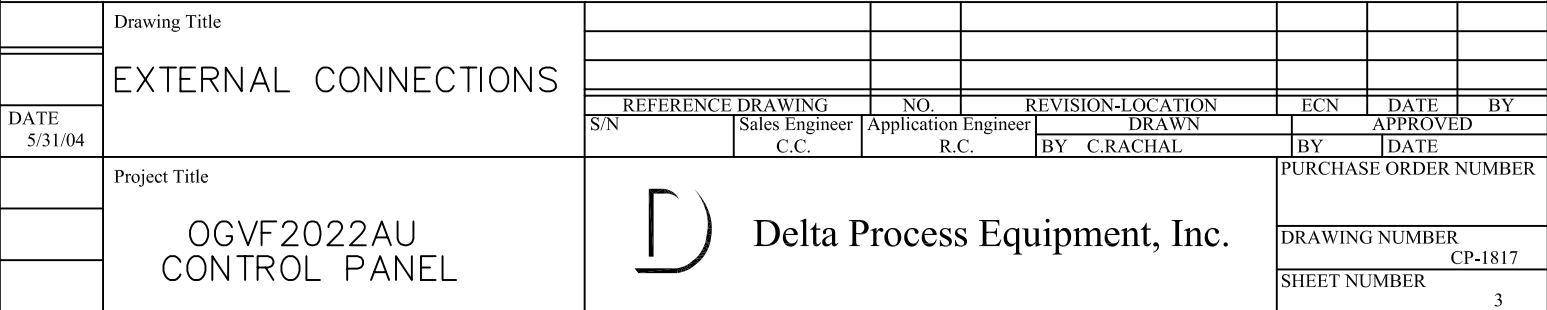
PUMP INTERNAL THERMAL OVERLOAD IS REQUIRED

	Drawing Title							
	POWER DIAGRAM							
3/23/04 5/31/04		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	
		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL	APPROVED BY	DATE	
	Project Title	<div><div></div><div>Delta Process Equipment, Inc.</div></div>				PURCHASE ORDER NUMBER		
	OGVF2022AU CONTROL PANEL					DRAWING NUMBER CP-1817		
						SHEET NUMBER 1		

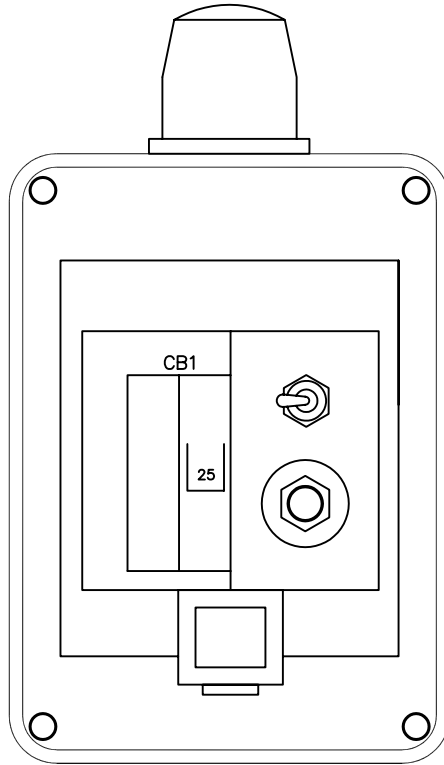


NOTE:
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

	Drawing Title						
	ENCLOSURE						
DATE 5/31/04		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN BY CTR	DATE APPROVED	BY
	Project Title	 Delta Process Equipment, Inc.				PURCHASE ORDER NUMBER	
	OGVF2022AU CONTROL PANEL					DRAWING NUMBER CP-1817	
						SHEET NUMBER 2	



BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	ABB	12644	ENCLOSURE
2	1	JOMEX	5A	CB2
3	1	U.S. CONTROLS		BUZZER
4	1	C.D.I.	R10-S-10	ALARM LIGHT
5	5	WEIDMULLER	WDU	TERMINAL BLOCKS
6	1	SQUARE D	QOU225	CB1
7				
8				
9				
10				

	Drawing Title						
	BILL OF MATERIALS						
DATE 5/31/04		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN BY C. RACHAL	DATE BY	BY DATE
	Project Title	 Delta Process Equipment, Inc.				PURCHASE ORDER NUMBER	
	OGVF2022AU CONTROL PANEL					DRAWING NUMBER CP-1817	
						SHEET NUMBER 4	