
COX

Research and Technology, Inc.

ELMWOOD MARINE SERVICE
WAGGEMAN
DUPLEX BLOWER
CONTROL PANEL

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-2039r1

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	1/60	
NO. MOTORS	2	
HP	1 1/2	
FLA	10.5	
TYPE OF PUMP	Blower	(Self-Priming, Submersible)
MANUFACTURER	Baldor	
CATALOG NUMBER	L1321T	

CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR		(Floats, Bubbler, Other)
CAPACITORS		(Yes, No)
CAPACITOR WIRING FIGURE		
THERM. & SEAL FAIL WIRING FIGURE		


OPTIONS:

SEAL FAIL LIGHTS		(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN		(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT		
LIGHT PANEL MTD		
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER		
ELAPSED TIME METER		
PHASE MONITOR		
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		


SOLD TO: Delta Environmental Equipment, Inc., New Orleans
TAG : Elmwood Marine Service
Waggeman

SHIP TO: Delta Environmental Equipment, Inc. - Denham Springs, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 7/07/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030	PURCHASE ORDER NUMBER	
	DUPLEX BLOWER CONTROL PANEL				DRAWING NUMBER CP-2039r1		
					SHEET NUMBER 1		

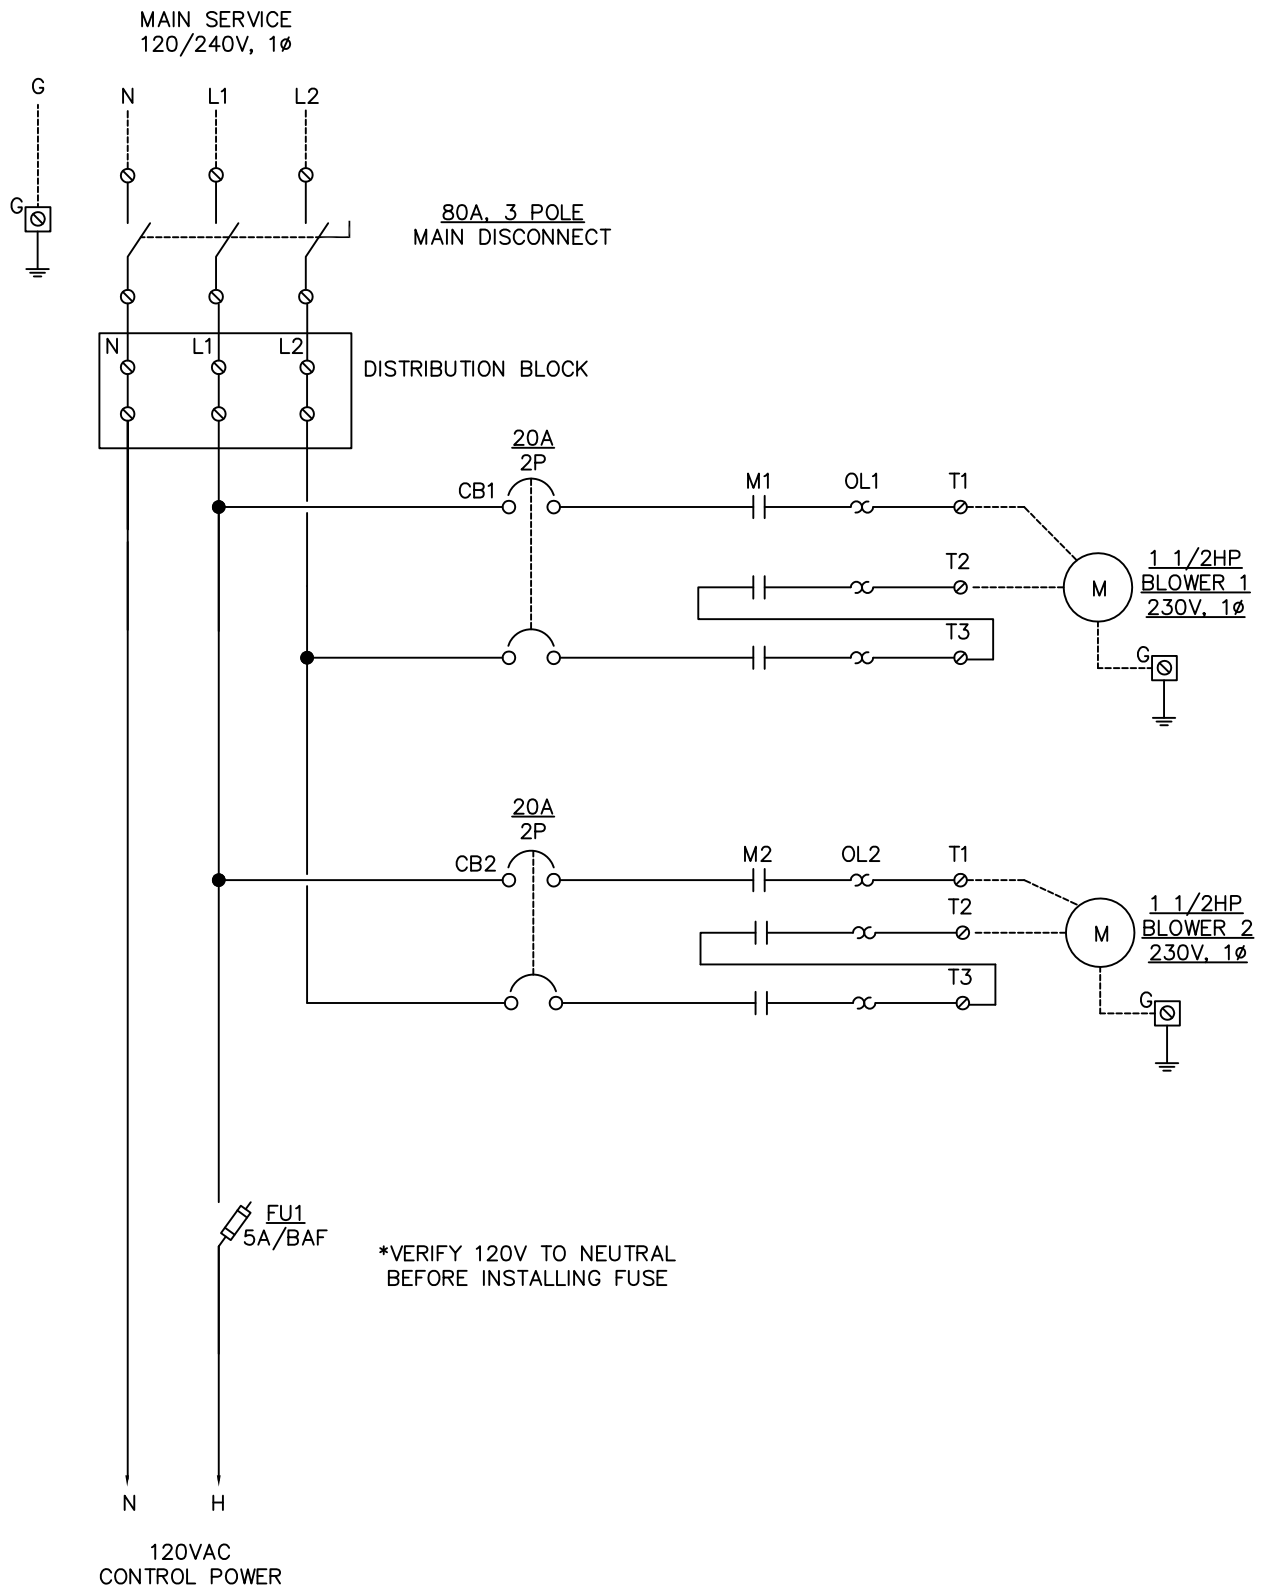

	Drawing Title							
	POWER DIAGRAM							
DATE 7/07/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN	DATE	BY	
	Project Title	DRAWN BY C. RACHAL			APPROVED BY			
	DUPLEX BLOWER CONTROL PANEL	PURCHASE ORDER NUMBER			DRAWING NUMBER CP-2039r1			
		SHEET NUMBER			2			

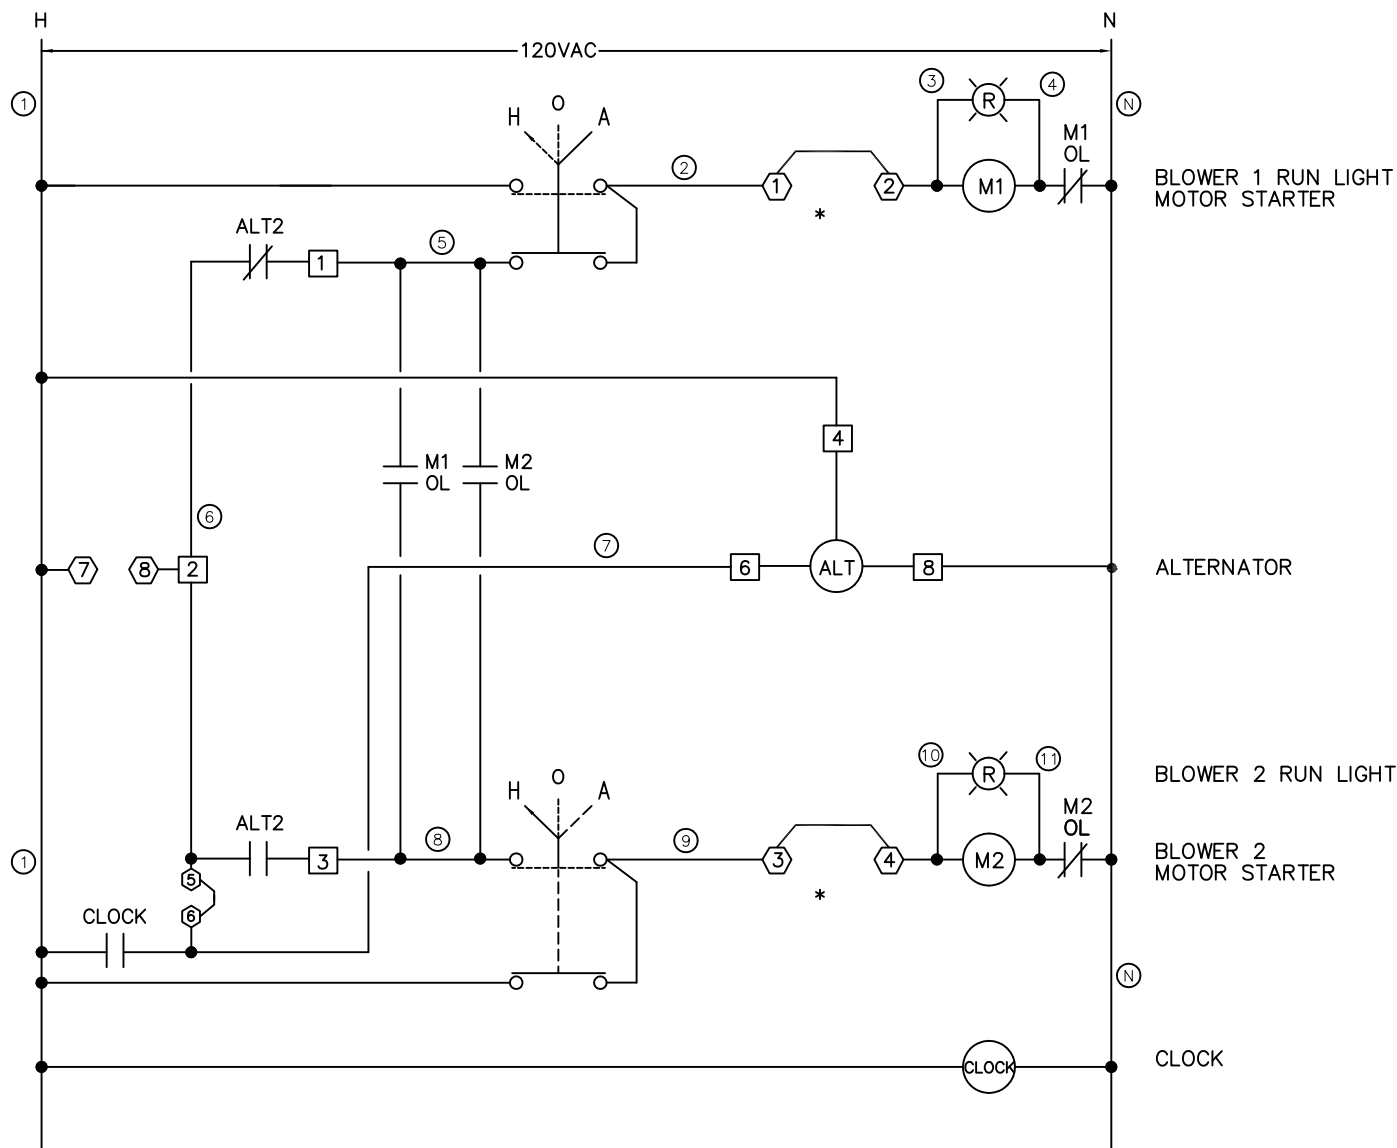


PANEL IS DESIGNED TO RUN BLOWERS WITH A MINIMUM OF 15 MINUTES OF OFF TIME BETWEEN ALTERNATION. PINS PUSHED OUT ON CLOCK INDICATE RUN TIME. PINS PUSHED IN INDICATE OFF TIME. EACH PIN IS EQUAL TO 15 MINUTES.

IF NO OFF TIME IS REQUIRED BETWEEN ALTERNATION, REMOVE JUMPER FROM TERMINALS ⑤ AND ⑥. PLACE JUMPER ACROSS TERMINALS ⑦ AND ⑧. NOW BLOWERS WILL RUN CONTINUOUSLY. SET 1 PIN IN AT THE TIME YOU WISH THE BLOWERS TO ALTERNATE. ALL REMAINING PINS SHOULD BE PUSHED OUT.

* REMOVE JUMPERS AND INSTALL LOCKOUT DEVICES IF REQUIRED

	Drawing Title CONTROL DIAGRAM							
DATE 7/07/05			REFERENCE DRAWING S/N		NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.		DRAWN BY C. RACHAL
	Project Title DUPLEX BLOWER CONTROL PANEL		<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030		PURCHASE ORDER NUMBER DRAWING NUMBER CP-2039r1 SHEET NUMBER
								3



IF NO OFF TIME IS REQUIRED BETWEEN
ALTERNATION, REMOVE JUMPER FROM
TERMINALS ⑤ AND ⑥. PLACE JUMPER ACROSS
TERMINALS ⑦ AND ⑧. NOW BLOWERS WILL RUN
CONTINUOUSLY. SET 1 PIN IN AT THE TIME YOU
WISH THE BLOWERS TO ALTERNATE.
ALL REMAINING PINS SHOULD BE PUSHED OUT.

NAMEPLATE SCHEDULE

NOTE:
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

NP-1	BLOWER	1
NP-2	BLOWER	2
NP-3	RUN	
NP-4	RUN	
NP-5	HOA	
NP-6	HOA	

5

BILL OF MATERIAL

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1614HPL	ENCLOSURE
2	1	STAHLIN	BP1614AL	BACKPLATE
3	2	ABB	A16-30-10-84	STARTER
4	2	ABB	TA25DU11	O.L. (7.5-11A)
5	2	SQUARE D	QOU220	CIRCUIT BREAKER 1,2
6	1	MARATHON	1323580	DISTRIBUTION BLOCK
7	2	ACI	JR22P3M20B	H.O.A. SWITCH
8	2	ACI	JR22FR	RED PILOT LIGHTS
9	1	TIMEMARK	261DT120	ALTERNATING RELAY
10	1	GRASSLIN	FM1/STUZZL	TIMER
11	1	ABB	OT63E3	MAIN DISCONNECT
12				

	Drawing Title						
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>						
DATE 7/07/05		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL	APPROVED BY	DATE
	Project Title	<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 150px;"> <h3 style="margin: 0;">COX</h3> <p style="margin: 0; font-size: small;">Research and Technology, Inc.</p> </div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030		PURCHASE ORDER NUMBER DRAWING NUMBER CP-2039r1 SHEET NUMBER <div style="text-align: right;">6</div>
	DUPLEX BLOWER CONTROL PANEL						