
COX

Research and Technology, Inc.

DUPLEX PUMP
CONTROL PANEL
MOORE CONSTRUCTION

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-1979

VOLTAGE	120/208V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	3/60	
NO. MOTORS	2	
HP	2	
FLA	11.0	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	Barnes	
CATALOG NUMBER	SGVF2062L	

CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	No	(Yes, No)
CAPACITOR WIRING FIGURE	N/A	
THERM. & SEAL FAIL WIRING FIGURE		

OPTIONS:


SEAL FAIL LIGHTS	X	(Submersible Only)
SEAL FAIL RELAYS	X	(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER	X	
ELAPSED TIME METER		
PHASE MONITOR		
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		

SOLD TO: Delta Process - Ruston, LA


TAG : Moore Construction

SHIP TO: Delta Process - Ruston, LA


	Drawing Title						
	PANEL DESCRIPTION						
DATE 1/19/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	APPROVED BY	DATE
	Project Title	<div style="text-align: center;"> COX Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1979
							SHEET NUMBER 1

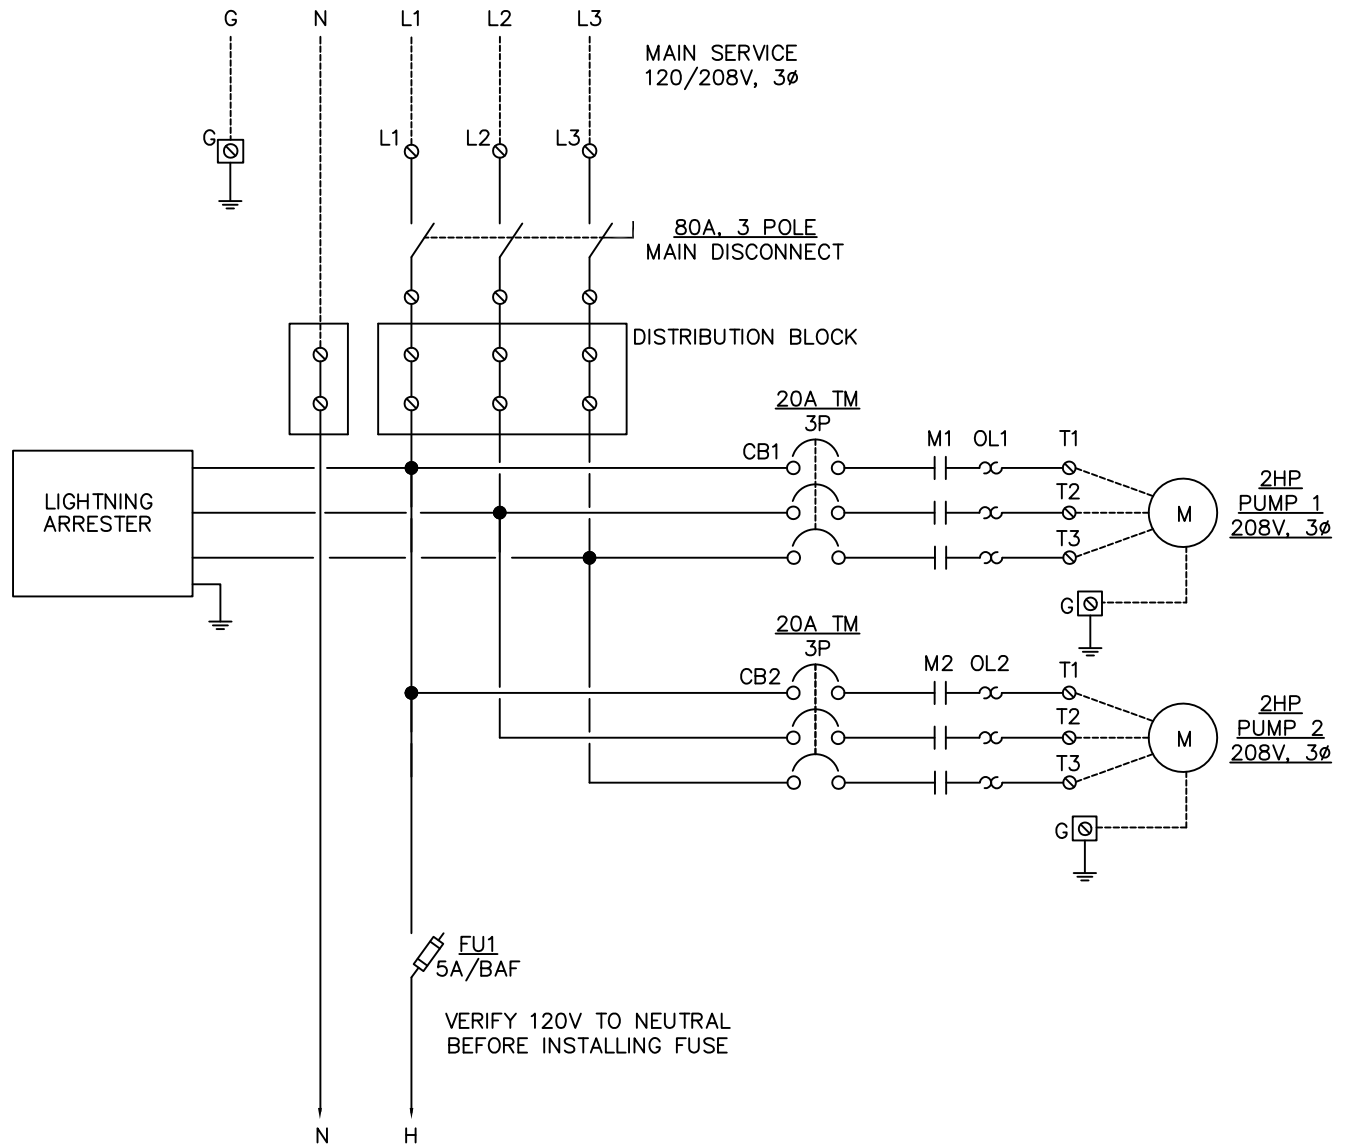

	Drawing Title							
	POWER DIAGRAM							
DATE 1/19/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
	Project Title	COX			P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER		
	DUPLEX PUMP CONTROL PANEL	Research and Technology, Inc.			Ph. (225)756-3271 Fax (225)756-1030	DRAWING NUMBER CP-1979		
						SHEET NUMBER 2		

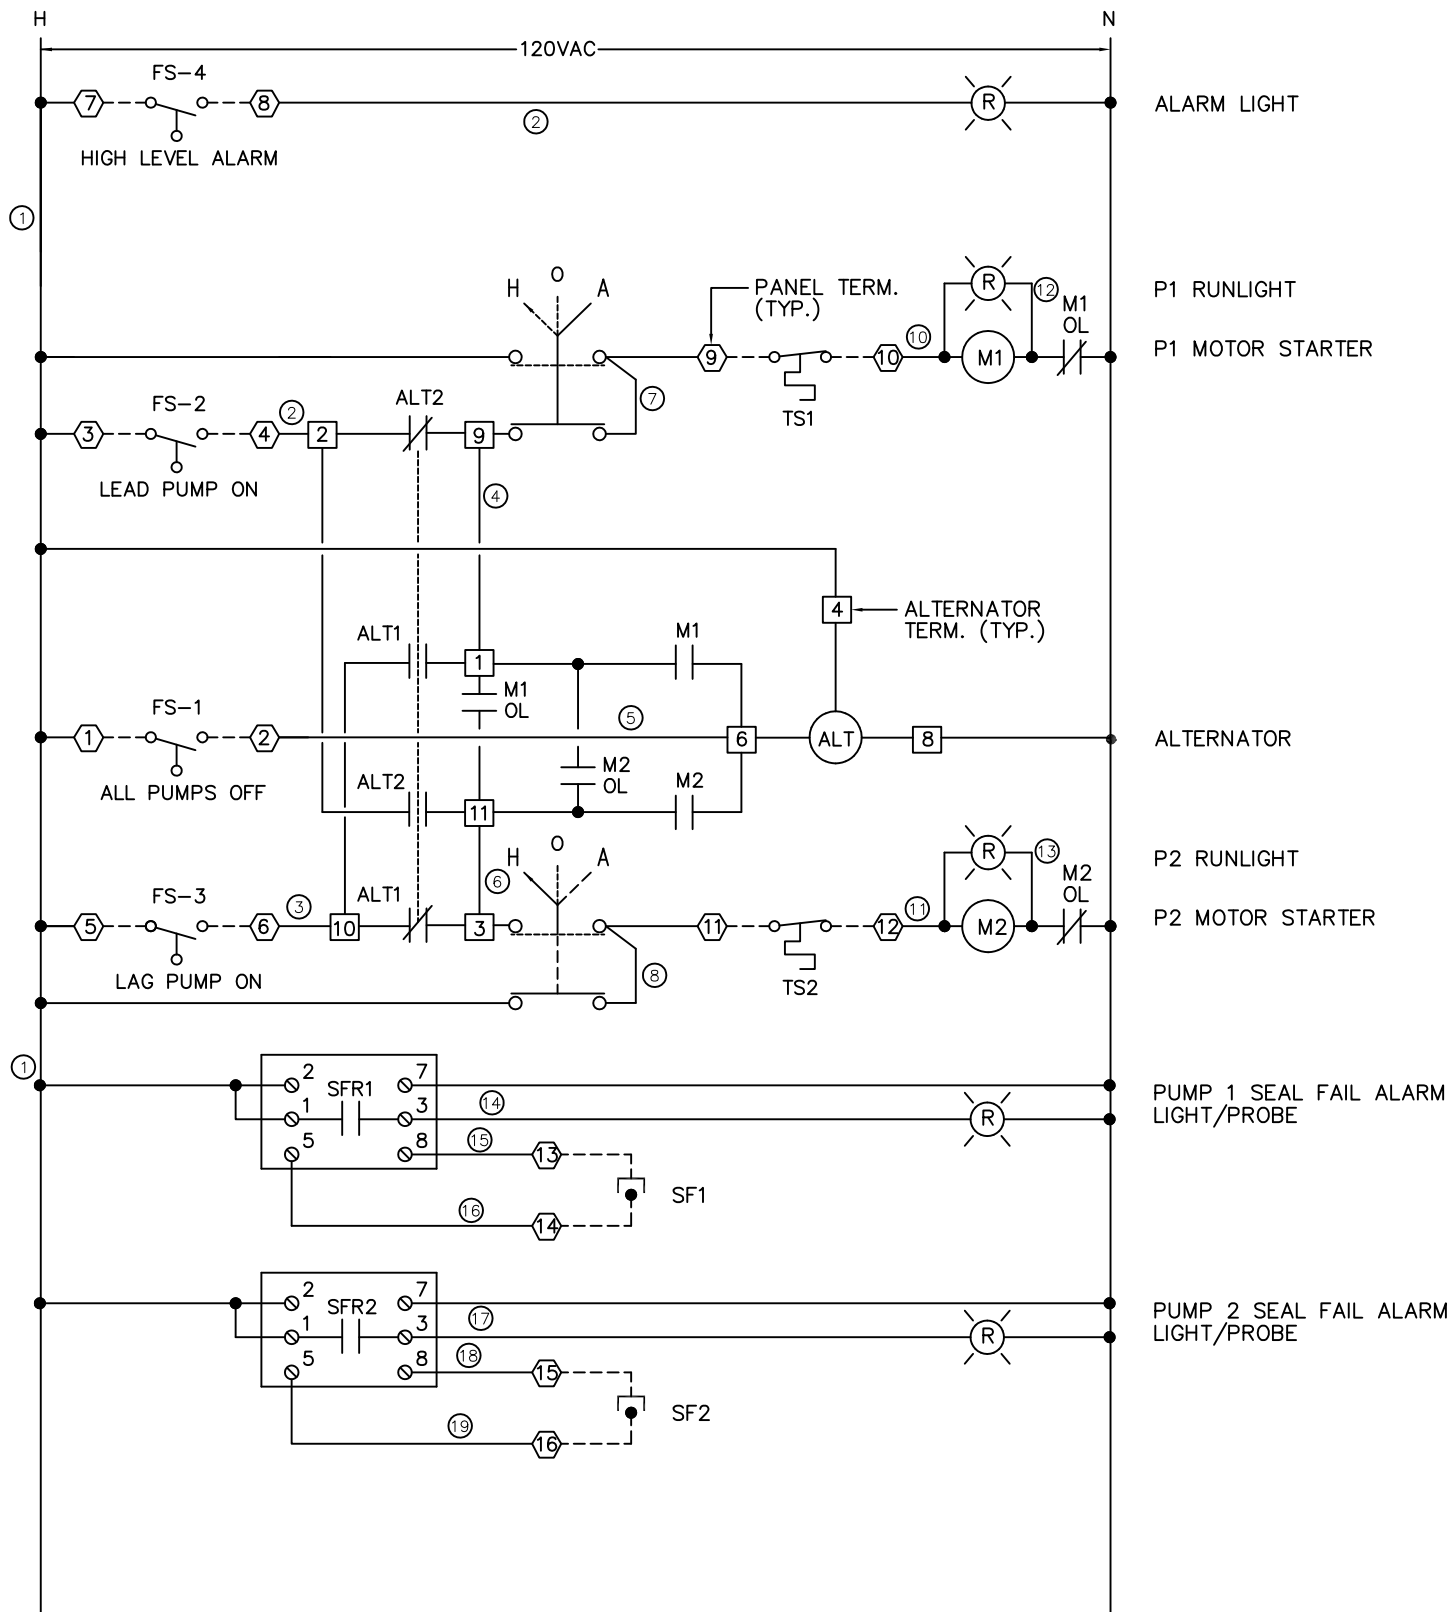

Drawing Title	CONTROL DIAGRAM					
DATE 1/19/05						
Project Title	DUPLEX PUMP CONTROL PANEL					
REFERENCE DRAWING		NO.	REVISION-LOCATION		ECN	DATE
S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL		APPROVED BY	
					DATE	
					PURCHASE ORDER NUMBER	
					DRAWING NUMBER CP-1979	
					SHEET NUMBER 3	

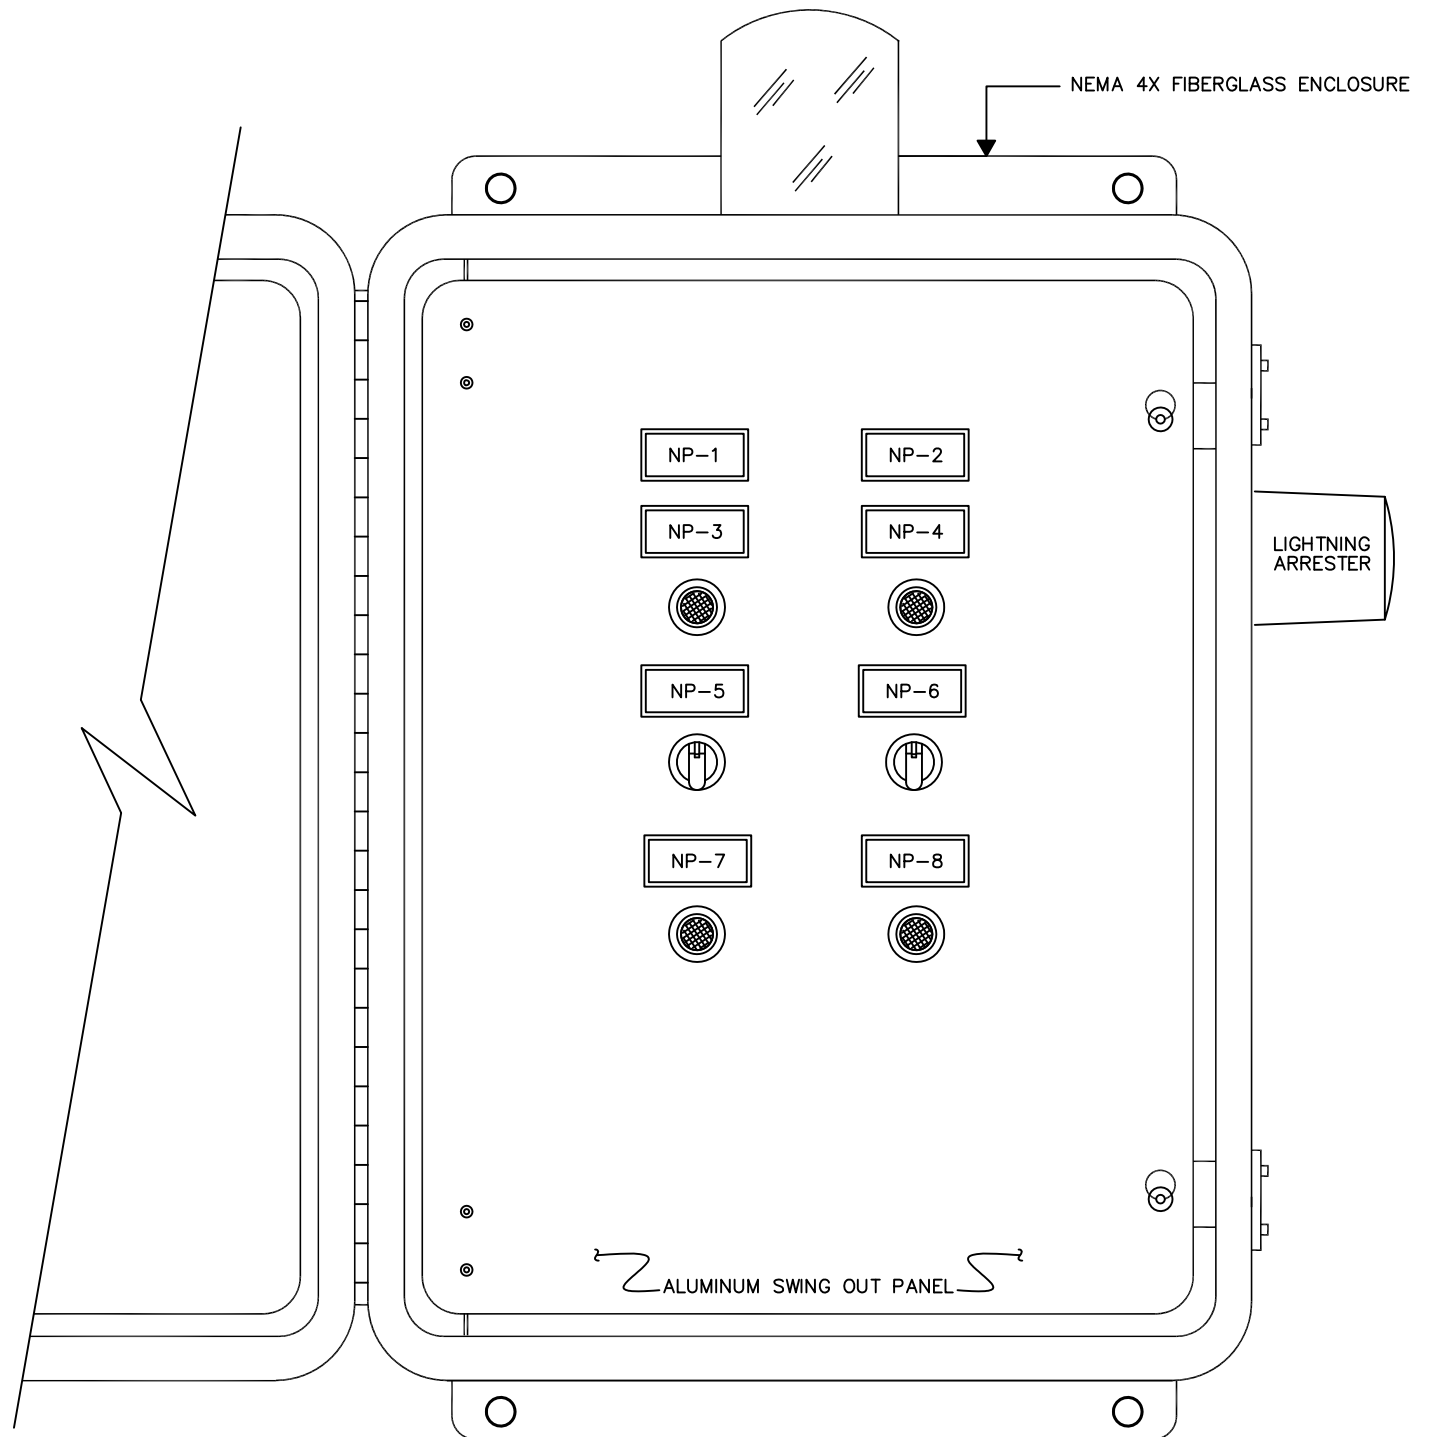

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL

NOTE:
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

DATE 1/19/05	Drawing Title								
	ENCLOSURE								
	Project Title		REFERENCE DRAWING		NO.		REVISION-LOCATION		ECN
	DUPLIX PUMP CONTROL PANEL		S/N		Sales Engineer C.C.		Application Engineer R.C.		DATE
							DRAWN BY C. RACHAL		BY
									DATE
									PURCHASE ORDER NUMBER
									DRAWING NUMBER
									CP-1979
									SHEET NUMBER
									4

COX

Research and Technology, Inc.

P.O. Box 77808
Baton Rouge, LA
70809

Ph. (225)756-3271
Fax (225)756-1030

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	1	ABB	OT63E3	MAIN DISC. SWITCH
3	2	ABB	A16-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU14	O.L. RELAY (10-14A)
5	2	SQUARE D	QOU320	CB1, CB2
6	1	TIMEMARK	261DT120	ALTERNATING RELAY
7	4	ACI	JR22FR	RED PILOT LIGHT
8	2	ACI	JR22P3M20B	HOA SWITCH
9	1	AC/DC	BL5-R-120	ALARM LIGHT
10	1	MARATHON	1323580	DISTRIBUTION BLOCK
11	1	MARATHON	1321580	NEUTRAL BLOCK
12	1	DELTA	LA603	LIGHTNING ARRESTER
13	2	SSAC	LLC54AA	SEAL FAIL RELAY
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title							
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>							
DATE 1/19/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
		<div style="display: flex; justify-content: space-around; align-items: center;"> <div style="text-align: center;"> <h1 style="margin: 0;">COX</h1> <p style="margin: 0;">Research and Technology, Inc.</p> </div> <div style="text-align: left;"> <p>P.O. Box 77808 Baton Rouge, LA 70809</p> <p>Ph. (225)756-3271 Fax (225)756-1030</p> </div> </div>			APPROVED BY DATE		PURCHASE ORDER NUMBER	
	<h2 style="margin: 0;">DUPLEX PUMP CONTROL PANEL</h2>					DRAWING NUMBER CP-1979		
						SHEET NUMBER 5		