

---

---

# COX

Research and Technology, Inc.

---

---

COASTAL CONSTRUCTION  
CHENEYVILLE  
DUPLEX PUMP  
CONTROL PANEL

Cox Research and Technology, Inc.  
14697 S. Harrells Ferry Road  
Baton Rouge, LA. 70816  
(225) 756-3271 Fax (225) 755-1030


CP-1683

CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	Yes	(Yes, No)
CAPACITOR WIRING FIGURE	M	
THERM. & SEAL FAIL WIRING FIGURE	1, 6, 8	

SEAL FAIL LIGHTS	X	(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER	X	
LIGHTNING ARRESTER		
ELAPSED TIME METER		
PHASE MONITOR		
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		

SHIP TO: Delta Process - Denham Springs, LA  
\_\_\_\_\_

	Drawing Title								
	PANEL DESCRIPTION								
DATE 10/27/03		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY	
	Project Title					P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER		
	DUPLEX PUMP CONTROL PANEL	<b>COX</b>  Research and Technology, Inc.				Ph. (225)756-3271 Fax (225)756-1030	DRAWING NUMBER CP-1683		
							SHEET NUMBER 1		

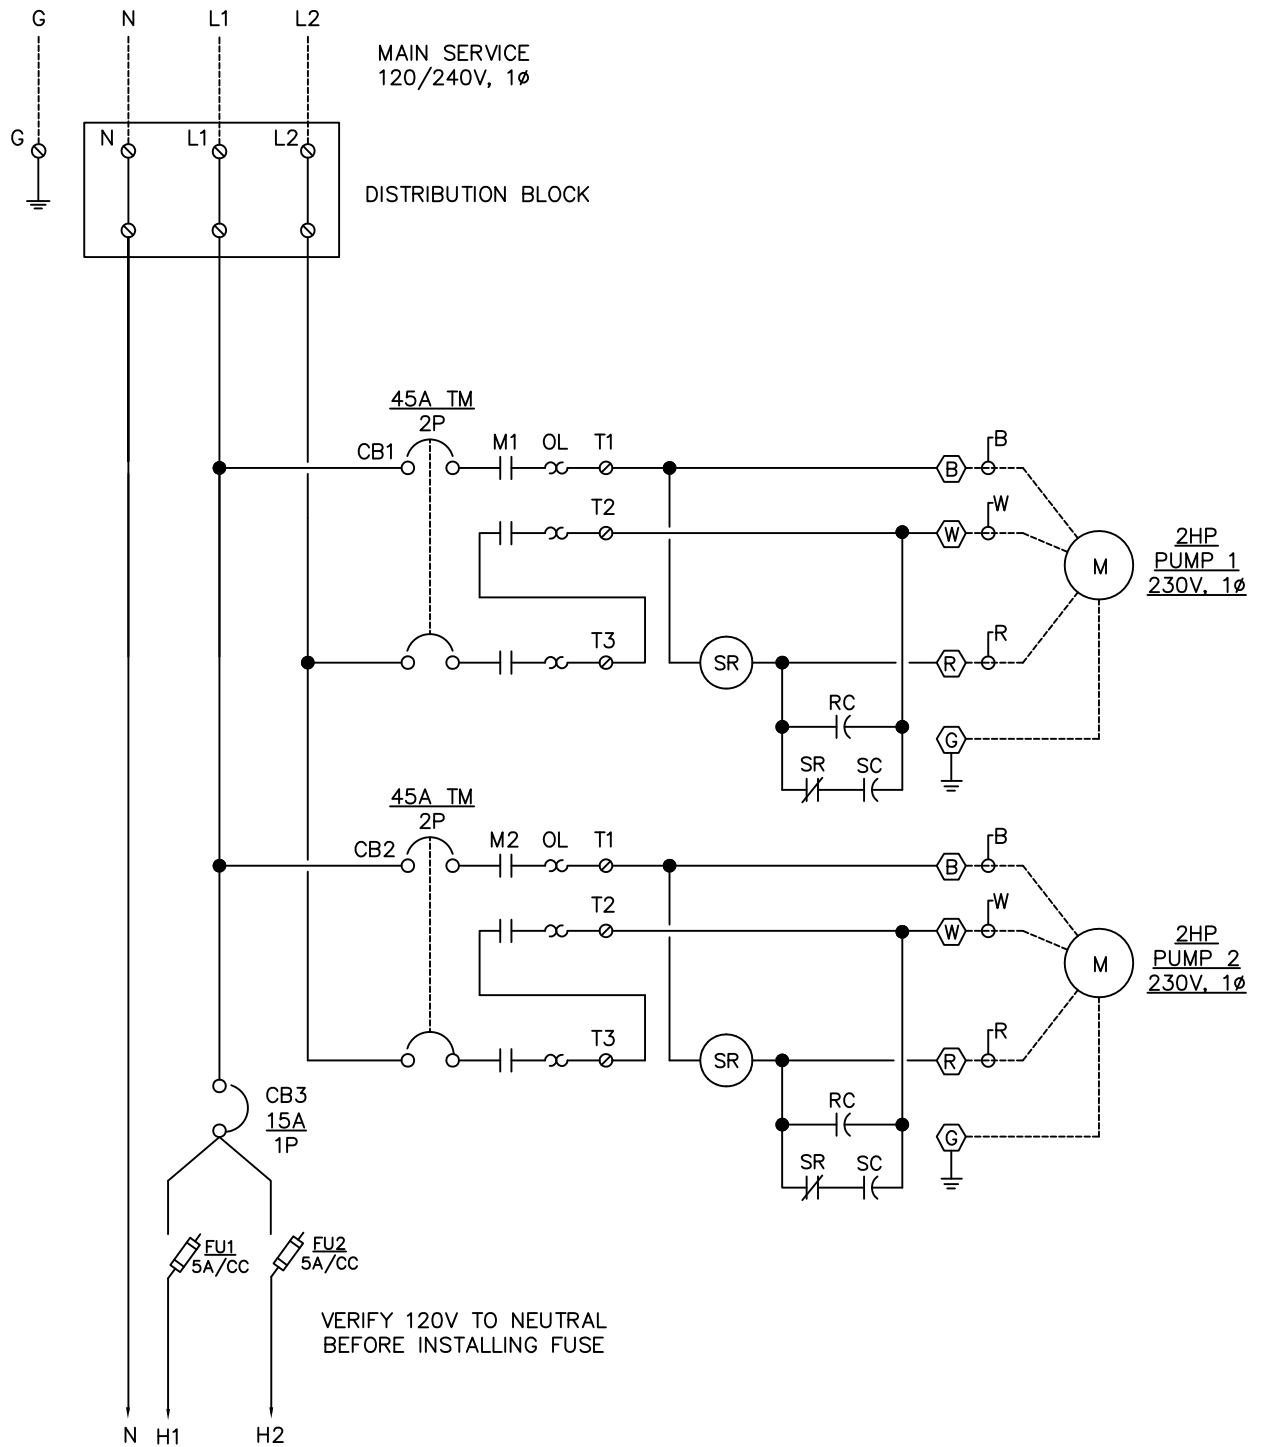

	Drawing Title								
	POWER DIAGRAM								
DATE 10/27/03		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY	APPROVED
	Project Title	PURCHASE ORDER NUMBER							
	DUPLEX PUMP CONTROL PANEL	DRAWING NUMBER CP-1683							
		SHEET NUMBER							


**COX**

Research and Technology, Inc.

P.O. Box 77808  
Baton Rouge, LA  
70809

Ph. (225)756-3271  
Fax (225)756-1030



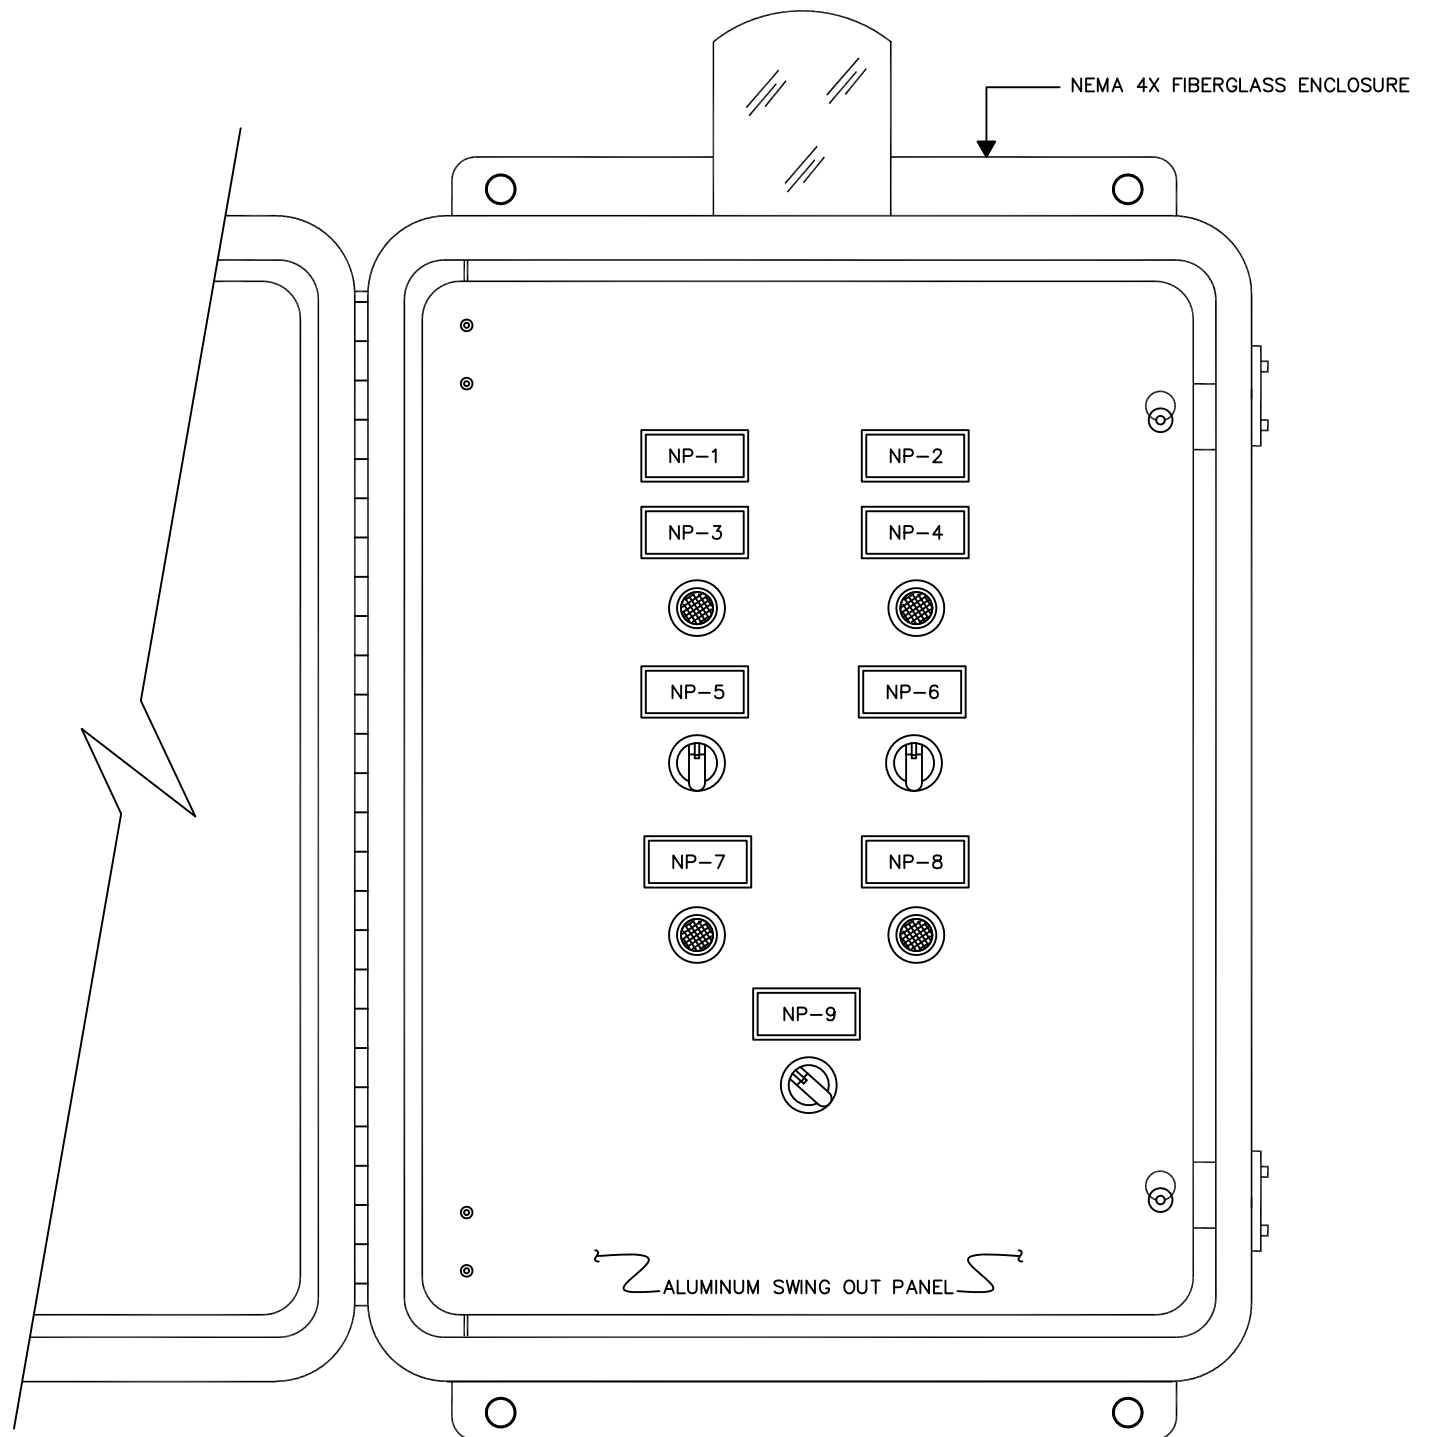

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL
NP-9	NORMAL/TEST

NOTE:

SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.  
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE  
PANEL TO PREVENT ENTRY OF GASSES.

DATE 10/27/03	Drawing Title								
	ENCLOSURE								
		REFERENCE DRAWING		NO.	REVISION-LOCATION		ECN	DATE	BY
		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL		APPROVED BY		DATE
	Project Title				P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER		
	DUPLEX PUMP CONTROL PANEL	<div style="text-align: center;"> <b>COX</b>  Research and Technology, Inc. </div>			Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1683		
							SHEET NUMBER 4		

# BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	VYNCKIER	VJ1816HWPLDF	ENCLOSURE
1a	1	VYNCKIER	MP1816AL	BACKPLATE
2	1	MARATHON	1323580	DISTRIBUTION BLOCK
3	2	ABB	A26-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU25	O.L. RELAY (18-25A)
5	2	SQUARE D	QOU245	CB1, CB2
6	1	DIVERSIFIED	ARB120ADA	ALTERNATING RELAY
7	2	ACI	JR22FR	RED PILOT LIGHT
8	2	ACI	JR22P3M20B	HOA SWITCH
9	1	AC/DC	BL5-R-120	ALARM LIGHT
10	2	ACI	JR22FY	AMBER PILOT LIGHT
11	1	OMRON	G2R1SAC120	CR1
12	1	ACI	JR22P2M11B	NORMAL-TEST SWITCH
13	1	SSAC	FS126	FLASHER
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title						
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>						
DATE 10/27/03		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN	DATE	BY
	Project Title	<div style="border-top: 3px double black; border-bottom: 3px double black; padding: 5px 0;"> <h1 style="margin: 0;">COX</h1> <p style="margin: 0;">Research and Technology, Inc.</p> </div>			P.O. Box 77808 Baton Rouge, LA 70809  Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER  DRAWING NUMBER CP-1683 SHEET NUMBER <div style="text-align: right;">5</div>
	<h2 style="margin: 0;">DUPLEX PUMP CONTROL PANEL</h2>						