




Delta Process Equipment, Inc.

HIGH LEVEL ALARM
CONTROL PANEL

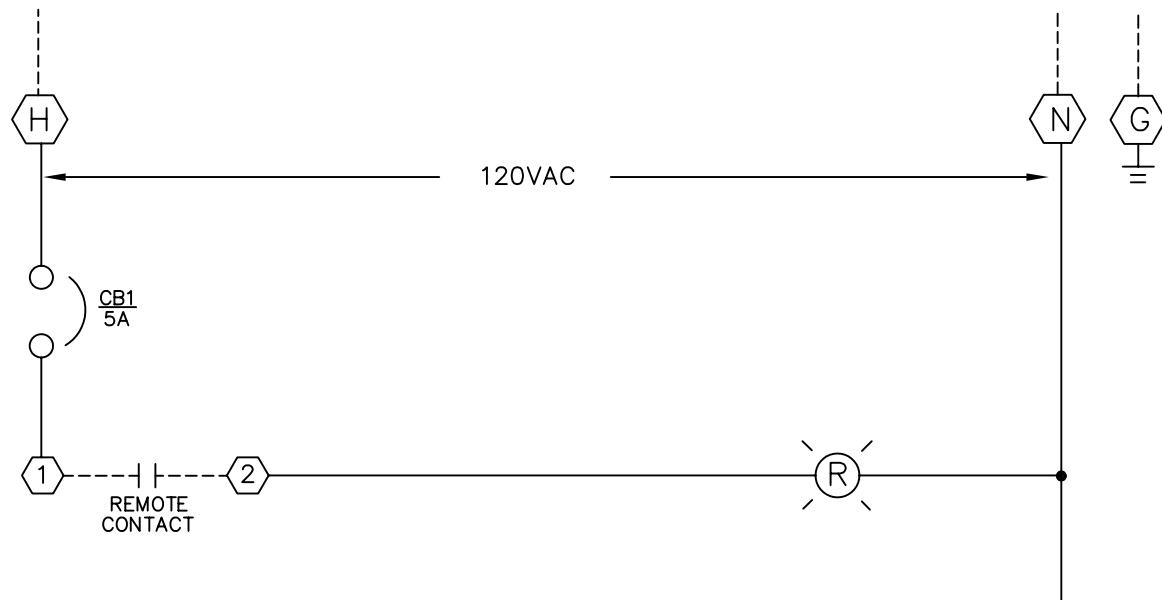

Drawing Title

POWER DIAGRAM

3/23/04
5/27/04

REFERENCE DRAWING	NO.	REVISION-LOCATION		ECN	DATE	BY
		S/N	Sales Engineer	Application Engineer	DRAWN	APPROVED
			C.C.	R.C.	BY C. RACHAL	BY DATE

Project Title

HIGH LEVEL ALARM
CONTROL PANEL

D

Delta Process Equipment, Inc.


PURCHASE ORDER NUMBER

DRAWING NUMBER

CP-1816

SHEET NUMBER


1

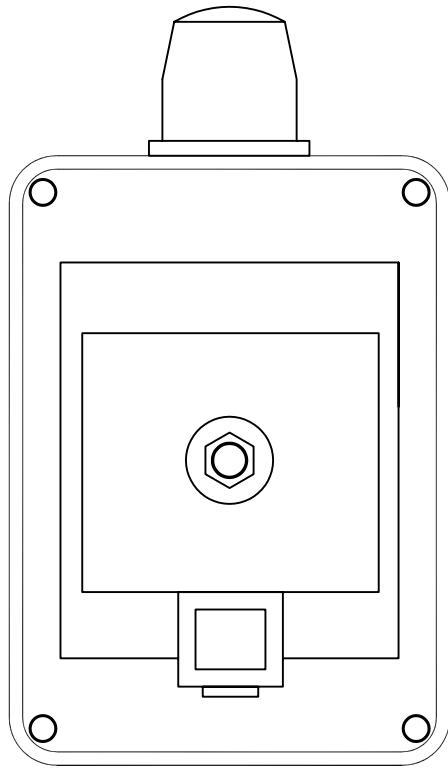

NOTE:

SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

	Drawing Title ENCLOSURE								
		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY		
DATE 5/27/04	S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY CTR		APPROVED BY	DATE BY		
	Project Title HIGH LEVEL ALARM CONTROL PANEL	D Delta Process Equipment, Inc.							PURCHASE ORDER NUMBER
									DRAWING NUMBER CP-1816
									SHEET NUMBER 2

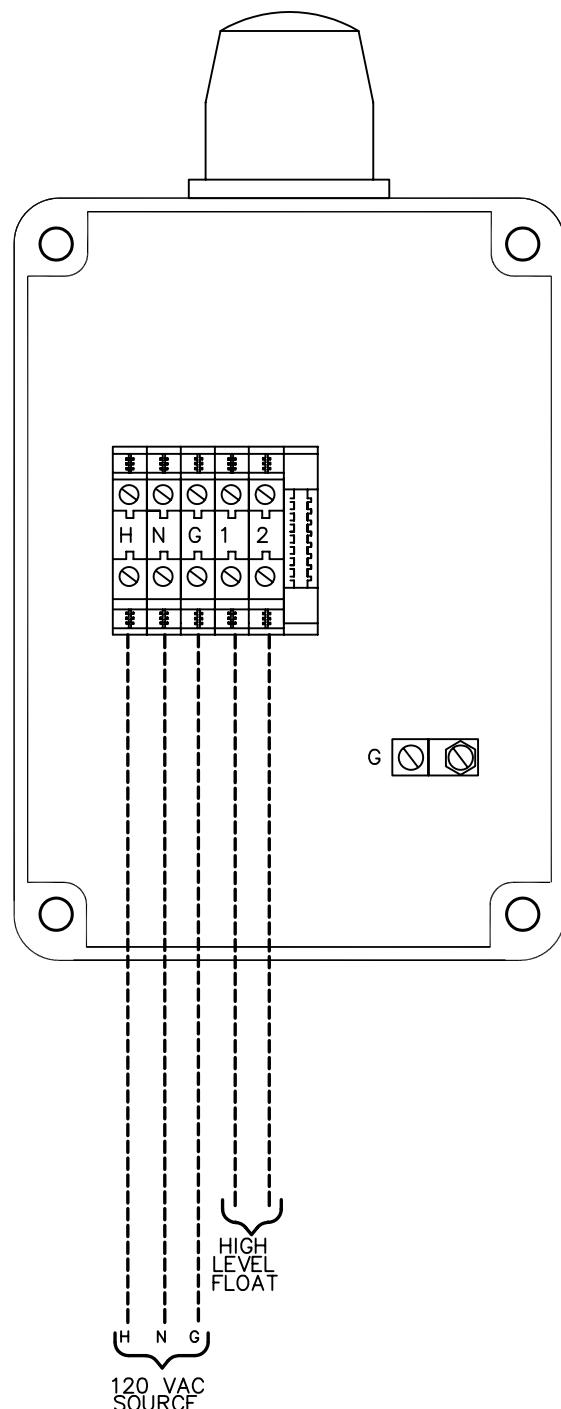

	Drawing Title						
	EXTERNAL CONNECTIONS						
DATE 5/27/04	REFERENCE DRAWING S/N	DRAWING Sales Engineer C.C.	NO. Application Engineer R.C.	REVISION-LOCATION DRAWN BY C.RACHAL	ECN APPROVED BY	DATE APPROVED BY	BY
	Project Title HIGH LEVEL ALARM CONTROL PANEL	D	Delta Process Equipment, Inc.		PURCHASE ORDER NUMBER		
					DRAWING NUMBER CP-1816		
					SHEET NUMBER 3		

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	ABB	12644	ENCLOSURE
2	1	JOMEX	5A	CB1
3	1	C.D.I.	R10-S-10	ALARM LIGHT
4	5	WEIDMULLER	WDU	TERMINAL BLOCKS
5				
6				
7				
8				
9				
10				

Drawing Title BILL OF MATERIALS							
	REFERENCE DRAWING S/N		NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN DRAWN BY C. RACHAL	DATE APPROVED BY	BY
DATE 5/2704							
Project Title HIGH LEVEL ALARM CONTROL PANEL							
	D Delta Process Equipment, Inc.						PURCHASE ORDER NUMBER
							DRAWING NUMBER CP-1816
							SHEET NUMBER 4