
COX

Research and Technology, Inc.

DUPLEX PUMP
CONTROL PANEL
CITY OF HAUGHTON
OWL LANE

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-1710

VOLTAGE	<u>120/240V</u>	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	<u>1/60</u>	
NO. MOTORS	<u>2</u>	
HP	<u>2</u>	
FLA	<u>15</u>	
TYPE OF PUMP	<u>Submersible</u>	(Self-Priming, Submersible)
MANUFACTURER	<u>Barnes</u>	
CATALOG NUMBER	<u></u>	
CONTROL VOLTAGE	<u>120V</u>	(120V, Other)
ENCLOSURE	<u>NEMA 4X</u>	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	<u>Fiberglass</u>	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	<u>Floats</u>	(Floats, Bubbler, Other)
CAPACITORS	<u>Yes</u>	(Yes, No)
CAPACITOR WIRING FIGURE	<u>M</u>	
THERM. & SEAL FAIL WIRING FIGURE	<u></u>	


OPTIONS:

SEAL FAIL LIGHTS	<u>X</u>	(Submersible Only)
SEAL FAIL RELAYS	<u></u>	(Submersible Only)
SEAL FAIL PUMP SHUTDOWN	<u></u>	(Submersible Only)
HT PUMP SHUTDOWN	<u>X</u>	(Self-Primer, Submersible)
ALARM HORN	<u></u>	
ALARM LIGHT	<u>X Strobe</u>	
LIGHT PANEL MTD	<u>X</u>	
LIGHT REMOTE MTD	<u></u>	
LIGHT FLASHER	<u></u>	
LIGHTNING ARRESTER	<u>X</u>	
ELAPSED TIME METER	<u>X</u>	
PHASE MONITOR	<u></u>	
NEMA RATED STARTERS	<u></u>	
GROUND FAULT RECPT.	<u>X</u>	
GREEN RUN LIGHTS VS. RED	<u></u>	
POLE, BOX, SEAL	<u></u>	
INTRINSICALLY SAFE RELAYS	<u></u>	
HIGH TEMP. LOCKOUT, MANUAL RESET	<u></u>	
ECONOMY VERSION	<u></u>	


SOLD TO: Delta Process - Bossier City, LA

TAG : Haughton-Owl Lane


SHIP TO: Delta Process - Shreveport, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
12/08/03		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL		APPROVED BY
	Project Title	<div style="text-align: center;">  COX Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1710
							SHEET NUMBER 1

2

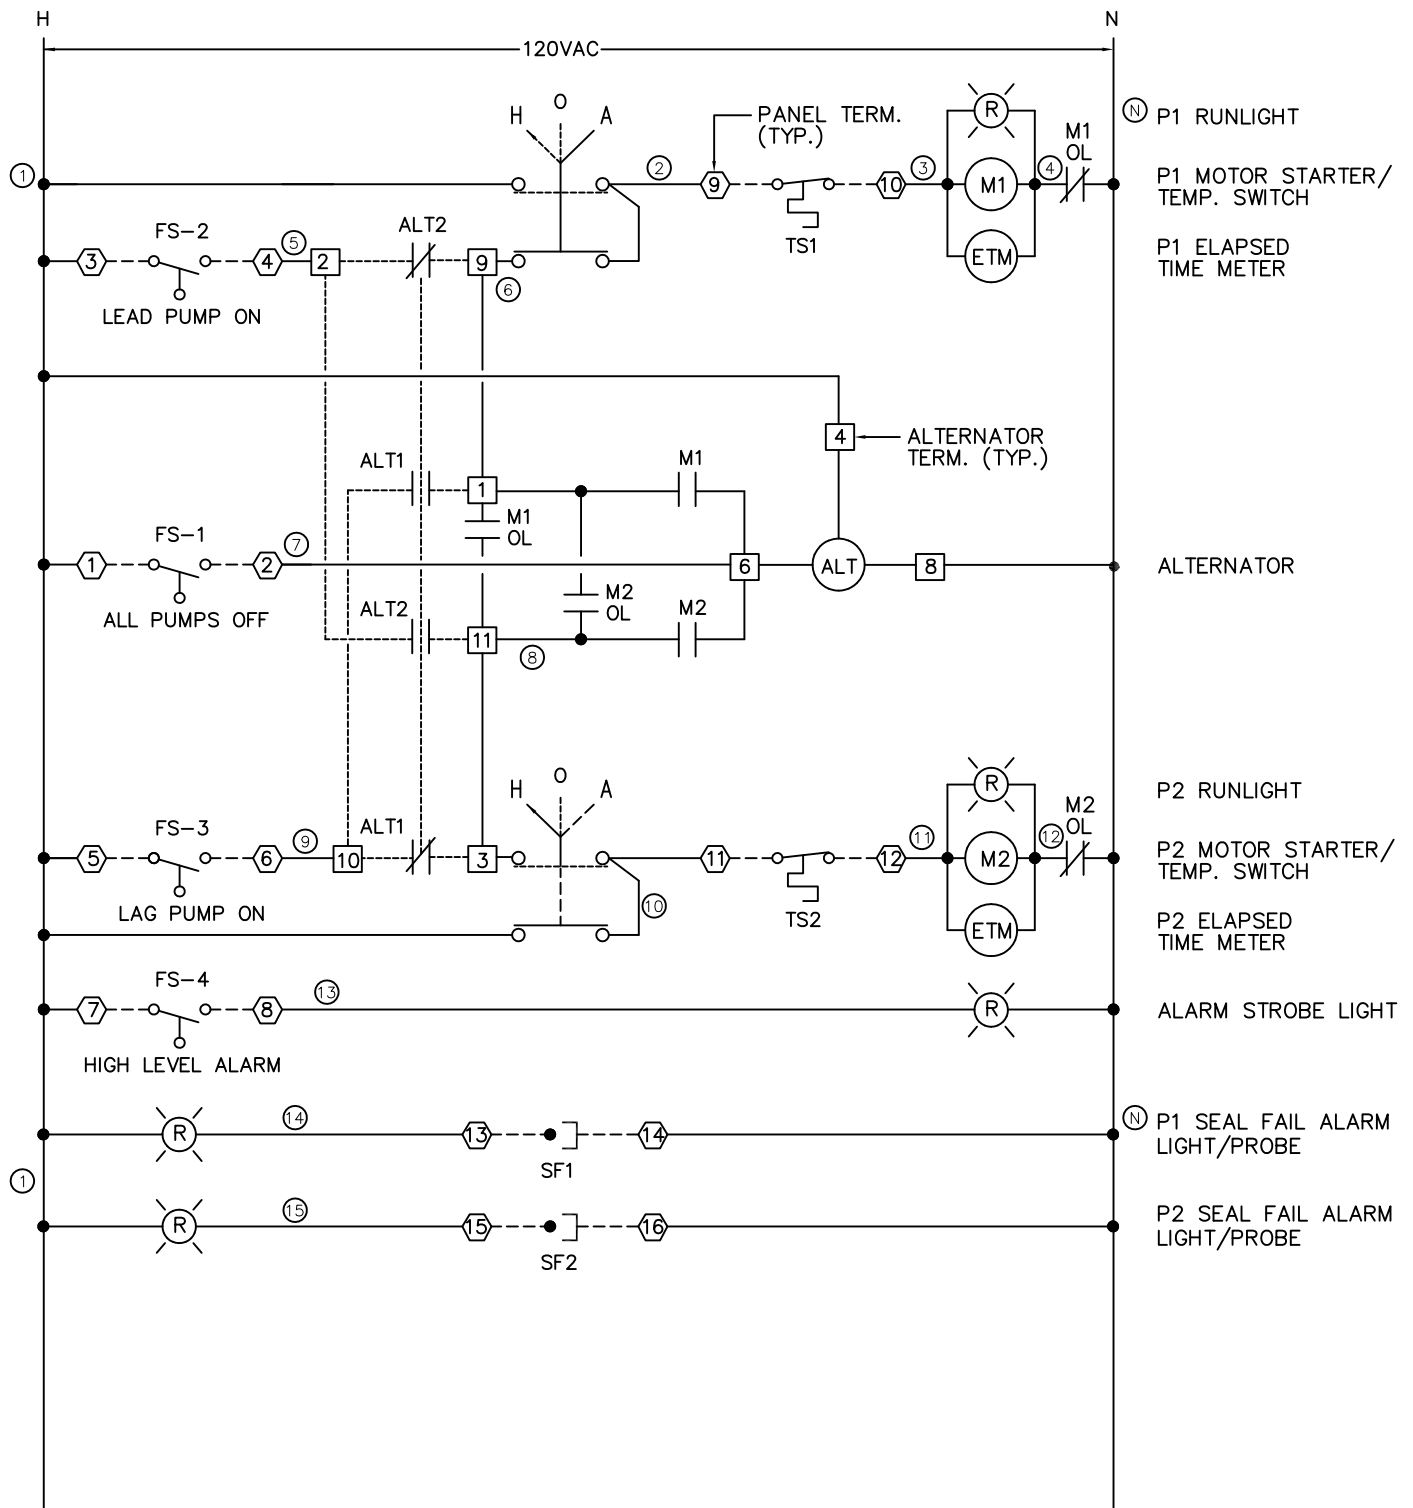

	Drawing Title CONTROL DIAGRAM								
DATE 12/08/03			REFERENCE DRAWING		NO.	REVISION-LOCATION		ECN	DATE
	S/N	Sales Engineer C.C.	Application Engineer R.C.		DRAWN BY C. RACHAL		APPROVED BY DATE		
	Project Title		<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER	
	DUPLEX PUMP CONTROL PANEL					Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1710	
						SHEET NUMBER			
								3	

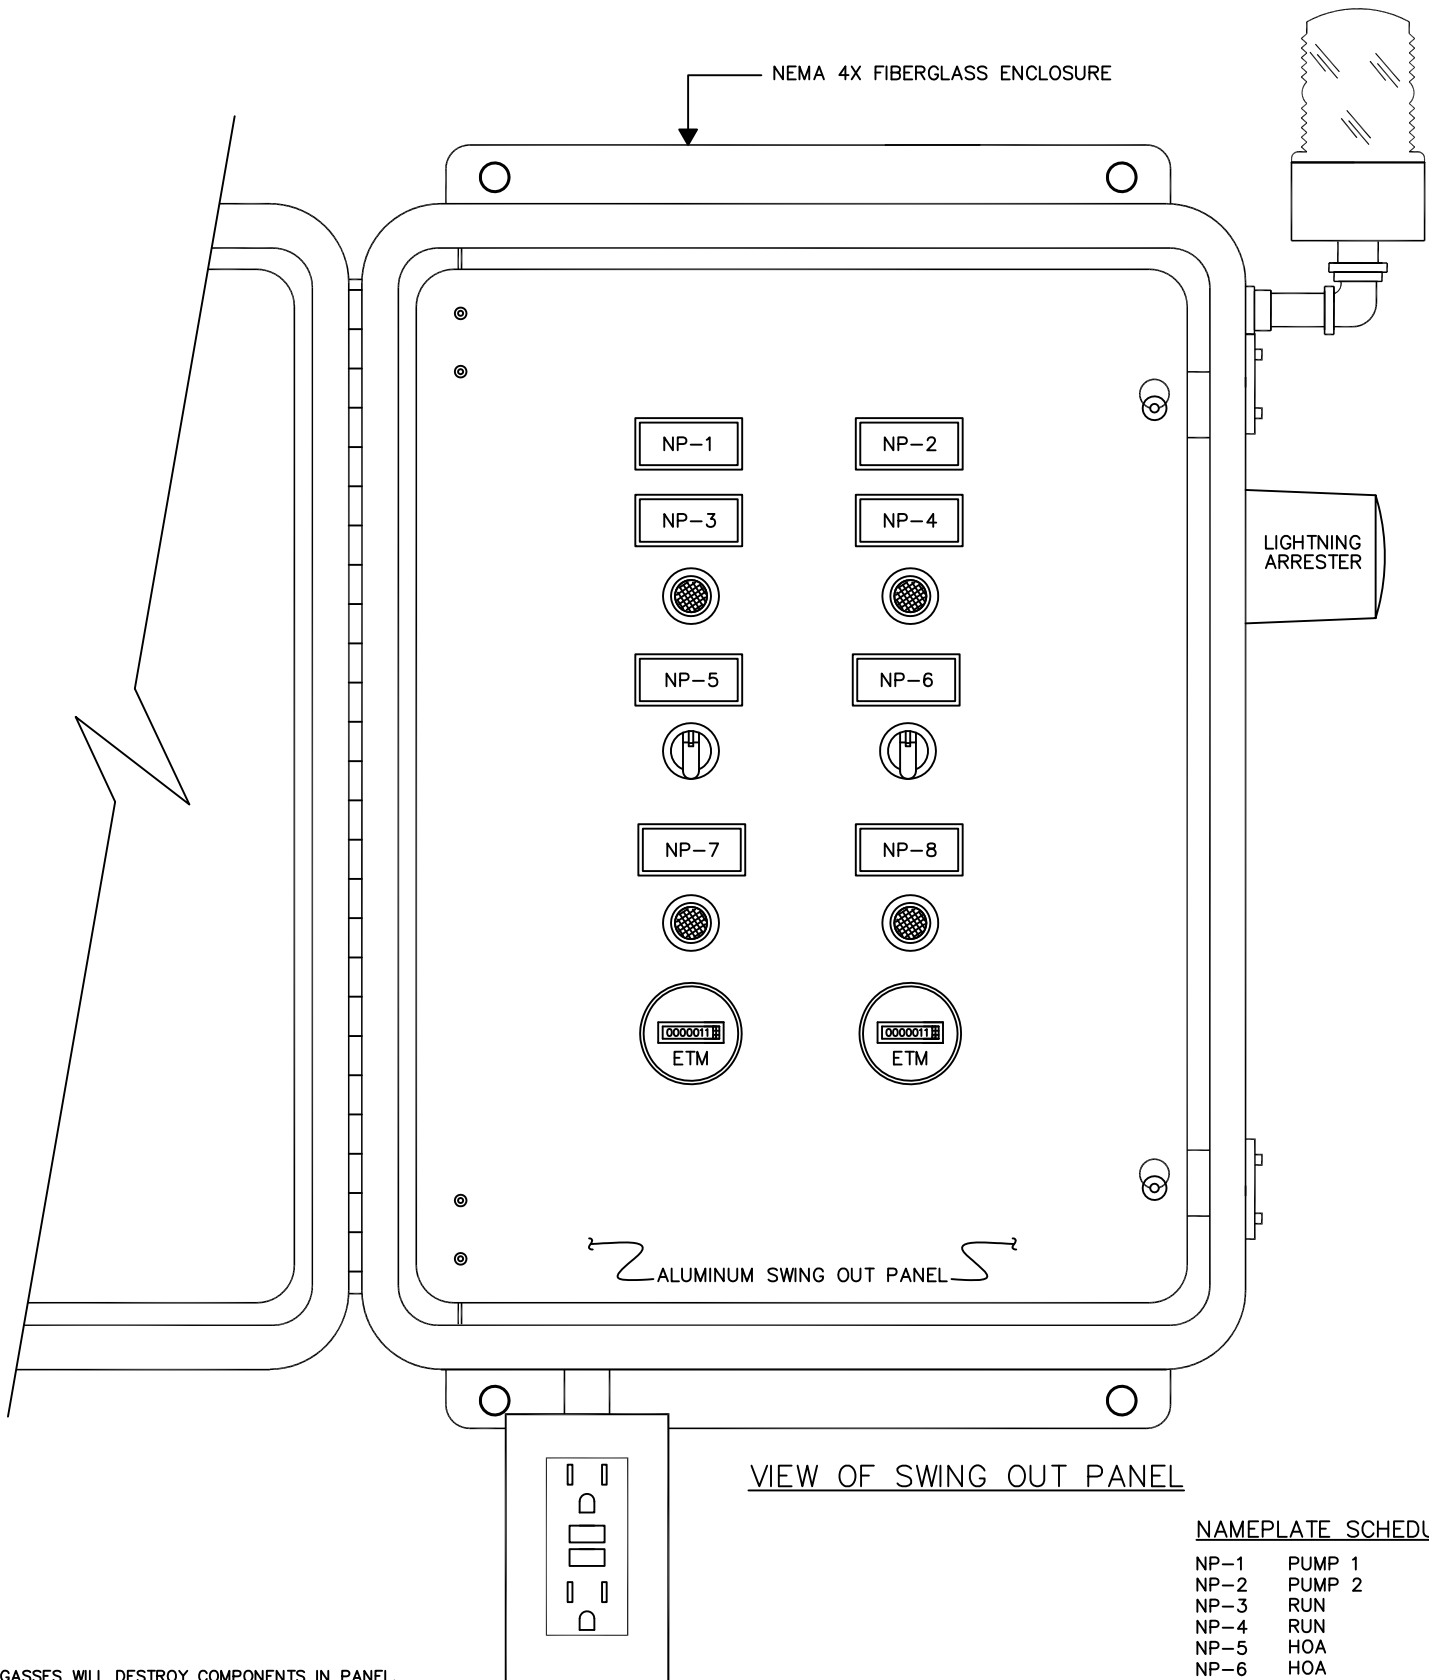

NOTE:
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL

DATE 12/08/03	Drawing Title								
	ENCLOSURE								
	Project Title		COX		P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER		
	DUPLEX PUMP CONTROL PANEL		Research and Technology, Inc.		Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1710		
								SHEET NUMBER	
								4	

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	VYNCKIER	VJ1816HWPLDF	ENCLOSURE
1a	1	VYNCKIER	MP1816AL	BACKPLATE
2	1	ABB	OT63E3	MAIN DISC. SWITCH
3	2	ABB	A16-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU19	O.L. RELAY (13-19A)
5	2	SQUARE D	QOU230	CB1, CB2
6	1	TIMEMARK	261DT120	ALTERNATING RELAY
7	4	ACI	JR22FR	RED PILOT LIGHT
8	2	ACI	JR22P3M20B	HOA SWITCH
9	1	TOMAR	490S-120-R	ALARM LIGHT
10	1	C-H	CHSA01	LIGHTNING ARRESTER
11	2	GRASSLIN	UWZ52E	ELAPSED TIME METER
12	1	STOCK		GFI RECEPTACLE
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title							
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>							
DATE 12/08/03		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
		<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 100px;"> <h1 style="margin: 0;">COX</h1> <p style="margin: 0; font-size: small;">Research and Technology, Inc.</p> </div>		<p style="margin: 0; font-size: small;">P.O. Box 77808 Baton Rouge, LA 70809</p> <p style="margin: 0; font-size: small;">Ph. (225)756-3271 Fax (225)756-1030</p>		<p style="margin: 0; font-size: small;">PURCHASE ORDER NUMBER</p> <hr/> <p style="margin: 0; font-size: small;">DRAWING NUMBER CP-1710</p> <hr/> <p style="margin: 0; font-size: small;">SHEET NUMBER 5</p>		
	Project Title	<h2 style="margin: 0;">DUPLEX PUMP CONTROL PANEL</h2>						