





CP-2205/SP  
CONTROL PANEL

Delta Treatment Systems  
9125 Comar Drive  
Walker, LA 70785  
(225) 665-6162 Fax (800) 219-9183

CP-2205/SP/1 & CP-2205/SP/2

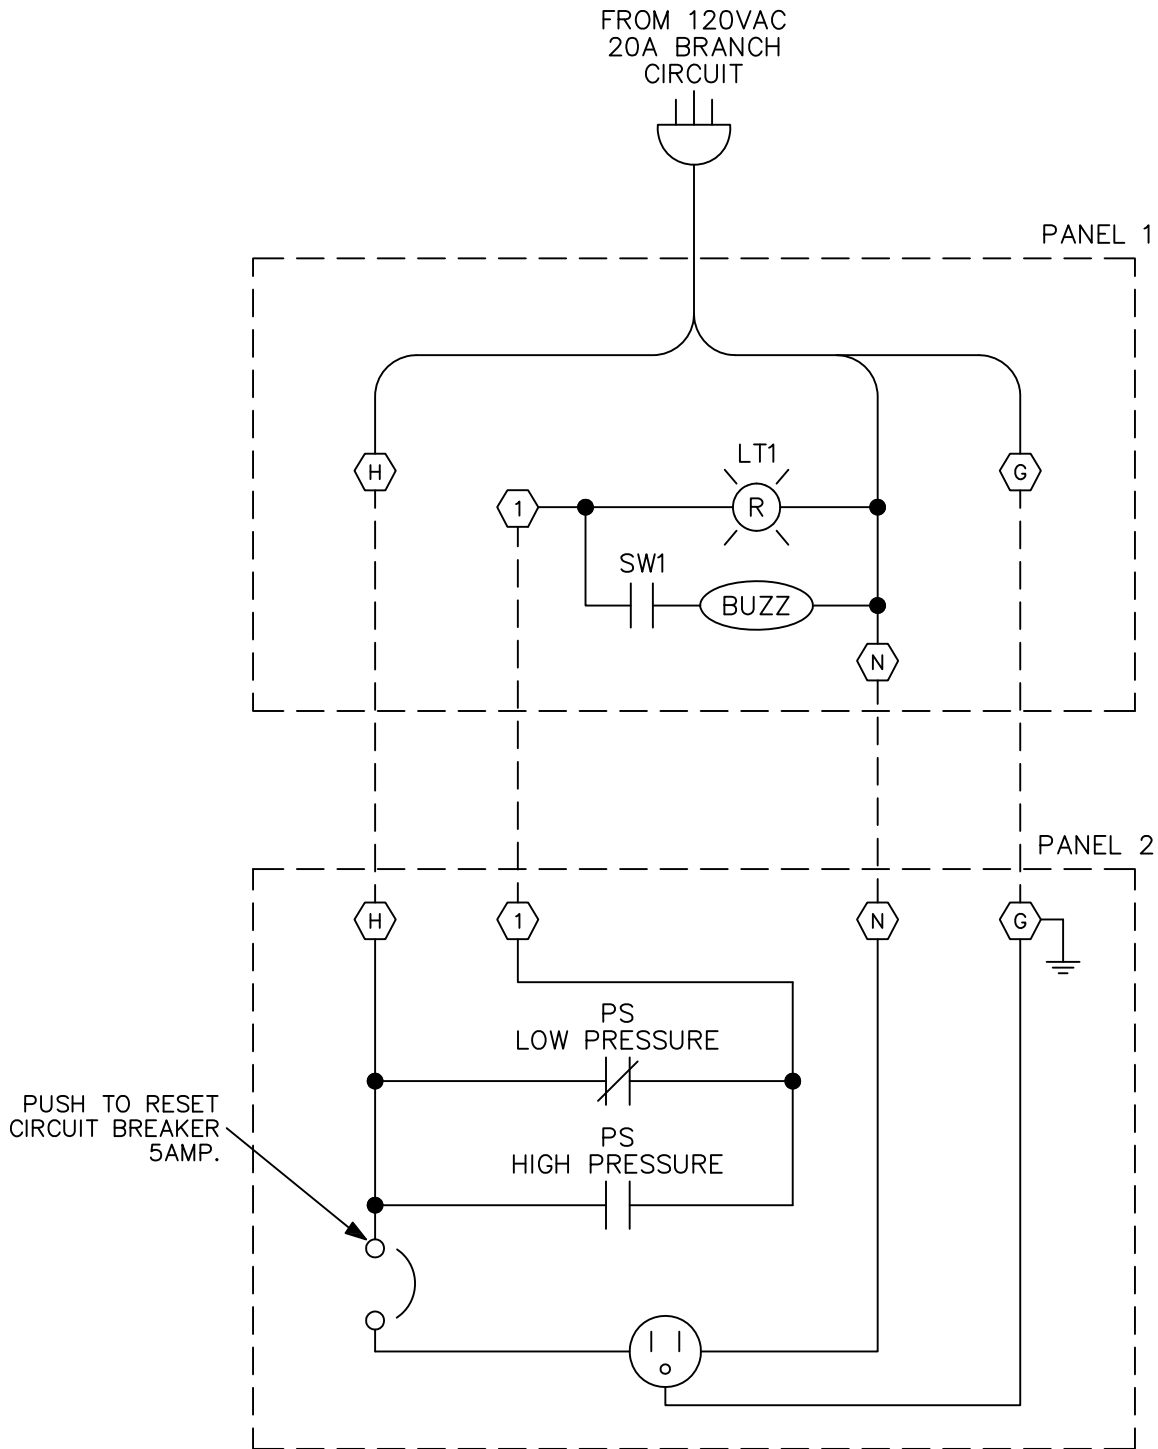


CP-2205/SP CONTROL PANEL

					9125 Comar Drive Walker, LA 70785 Ph. (225) 665-6162 Fax (800)219-9183	SCHEMATIC DIAGRAM						
-	-	-	-									
-	-	-	-									
REV.	DATE	REVISION DESCRIPTION	BY									
COMPANY CONFIDENTIAL: INFORMATION CONTAINED HEREIN IS CONFIDENTIAL, IT IS THE PROPERTY OF PENTAIR PUMP GROUP, IT IS TO BE USED SOLELY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF PENTAIR PUMP GROUP.												
PLOT SCALE NTS				DRAWING NUMBER CP-2205/SP/1 & CP-2205/SP/2		DRAWN BY NCR		DATE 09/29/22		SHEET OF 1 2		REV. A

BRING PLANT TO OPERATING WATER LEVEL WITH COMPRESSOR TURNED ON.  
USING PROPERLY SIZED SCREW DRIVER, TURN HIGH LEVEL ALARM ADJUSTMENT  
SCREW CLOCKWISE UNTIL ALARM OCCURS, THEN TURN THE SCREW COUNTER-CLOCKWISE  
UNTIL ALARM STOPS.



					9125 Comar Drive Walker, LA 70785 Ph. (225) 665-6162 Fax (800)219-9183	EXTERNAL CONNECTIONS				
-		-	-							
-		-	-							
1.	DATE	REVISION	DESCRIPTION							
PANY CONFIDENTIAL: INFORMATION CONTAINED HEREIN IS CONFIDENTIAL, THE PROPERTY OF PENTAIR PUMP GROUP, IT IS TO BE USED ONLY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO ANY OTHER PARTY WITHOUT THE PRIOR WRITTEN CONSENT OF PENTAIR PUMP GROUP.					PLOT SCALE	DRAWING NUMBER	DRAWN BY	DATE	SHEET OF	REV.
					NTS	CP-2205/SP/1 & CP-2205/SP/2	NCR	09/29/22	2 2	A