
COX

Research and Technology, Inc.

DUPLEX PUMP CONTROL PANEL KINGSTON CORNERS

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

VOLTAGE	120/208V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	3/60	
NO. MOTORS	2	
HP	2	
FLA	7.8	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	Barnes	
CATALOG NUMBER	SGVF2062L	
CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	No	(Yes, No)
CAPACITOR WIRING FIGURE	N/A	
THERM. & SEAL FAIL WIRING FIGURE		


OPTIONS:

SEAL FAIL LIGHTS	X	(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER	X	
ELAPSED TIME METER	X	
PHASE MONITOR	X	
NEMA RATED STARTERS		
GROUND FAULT RECPT.	X	
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		


SOLD TO: Delta Process - Bossier City, LA
TAG : KINGSTON CORNERS

SHIP TO: Delta Process - Ruston, LA


Drawing Title	PANEL DESCRIPTION		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN	DATE	BY
						DRAWN BY C. RACHAL	APPROVED BY	DATE BY
DATE 3/02/06	Project Title DUPLEX PUMP CONTROL PANEL					P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER DRAWING NUMBER SHEET NUMBER	CP-2328 1
						Ph. (225)756-3271 Fax (225)755-1030		

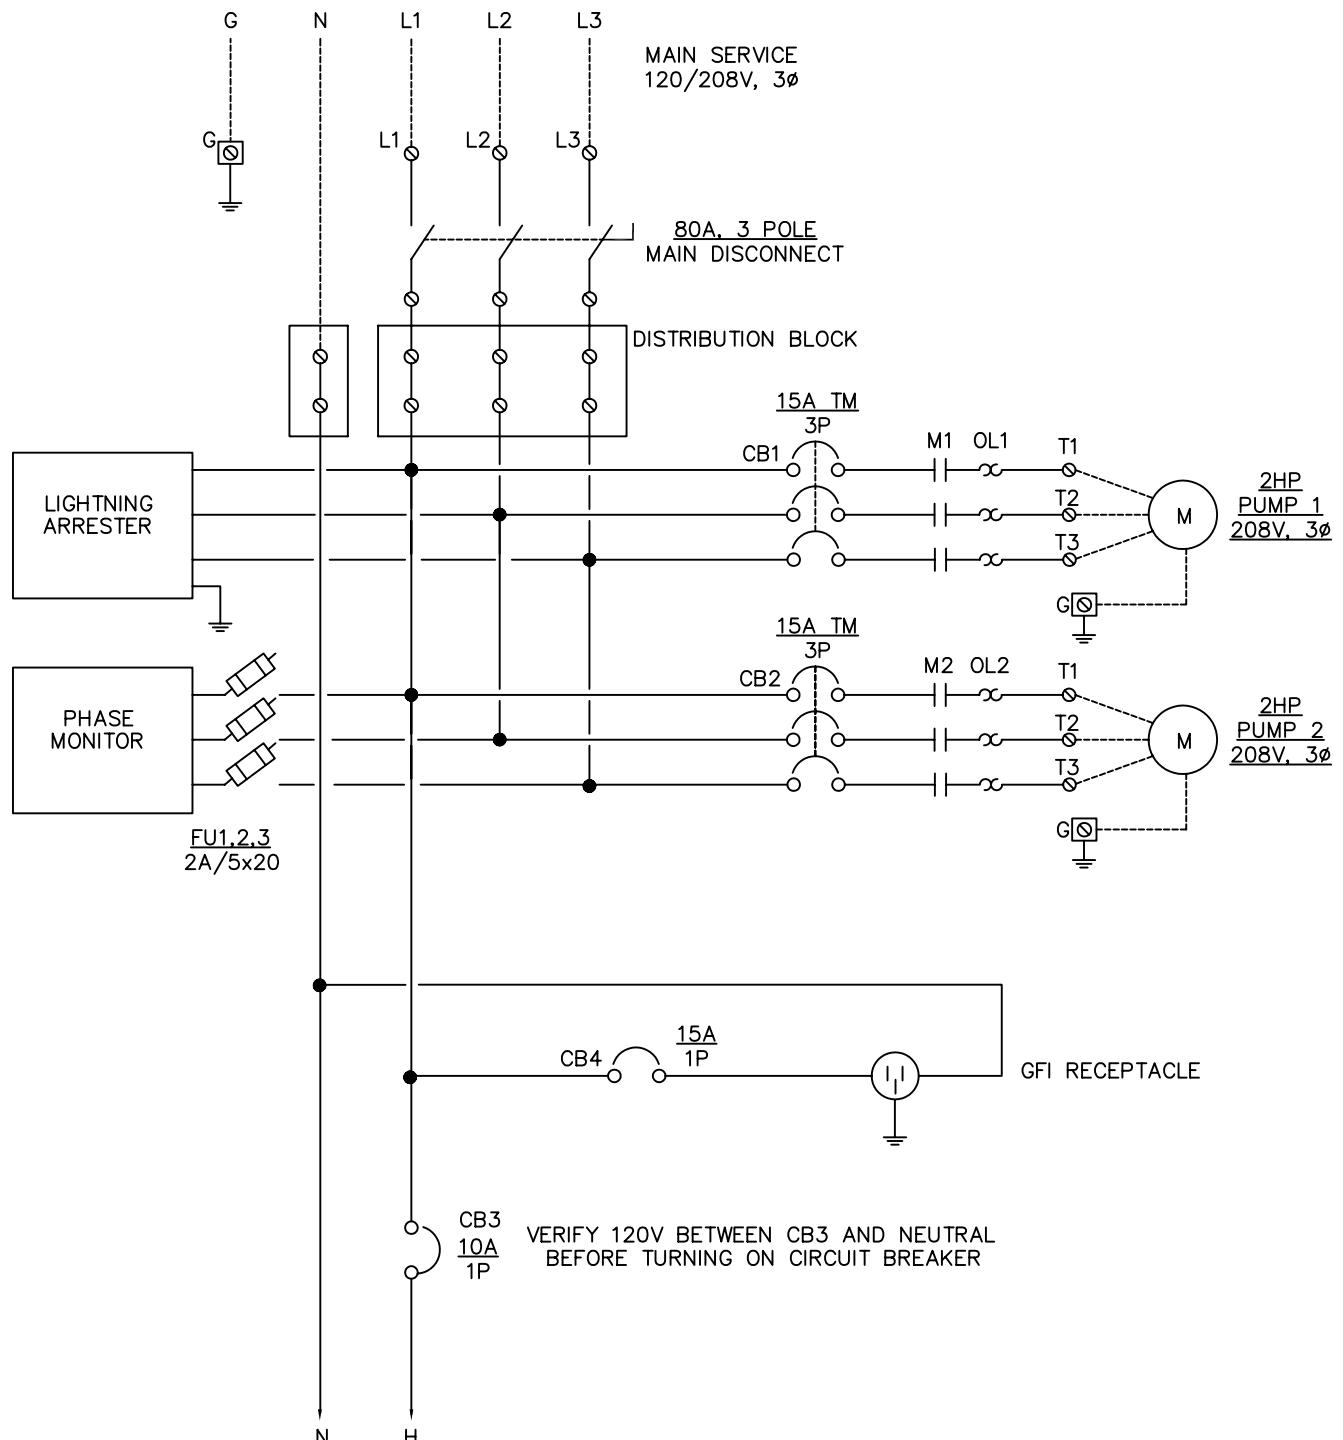

	Drawing Title POWER DIAGRAM				
		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN DRAWN BY C. RACHAL DATE APPROVED BY DATE
DATE 3/02/06					
	Project Title DUPLEX PUMP CONTROL PANEL		COX Research and Technology, Inc.	P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030	PURCHASE ORDER NUMBER DRAWING NUMBER CP-2328 SHEET NUMBER 2

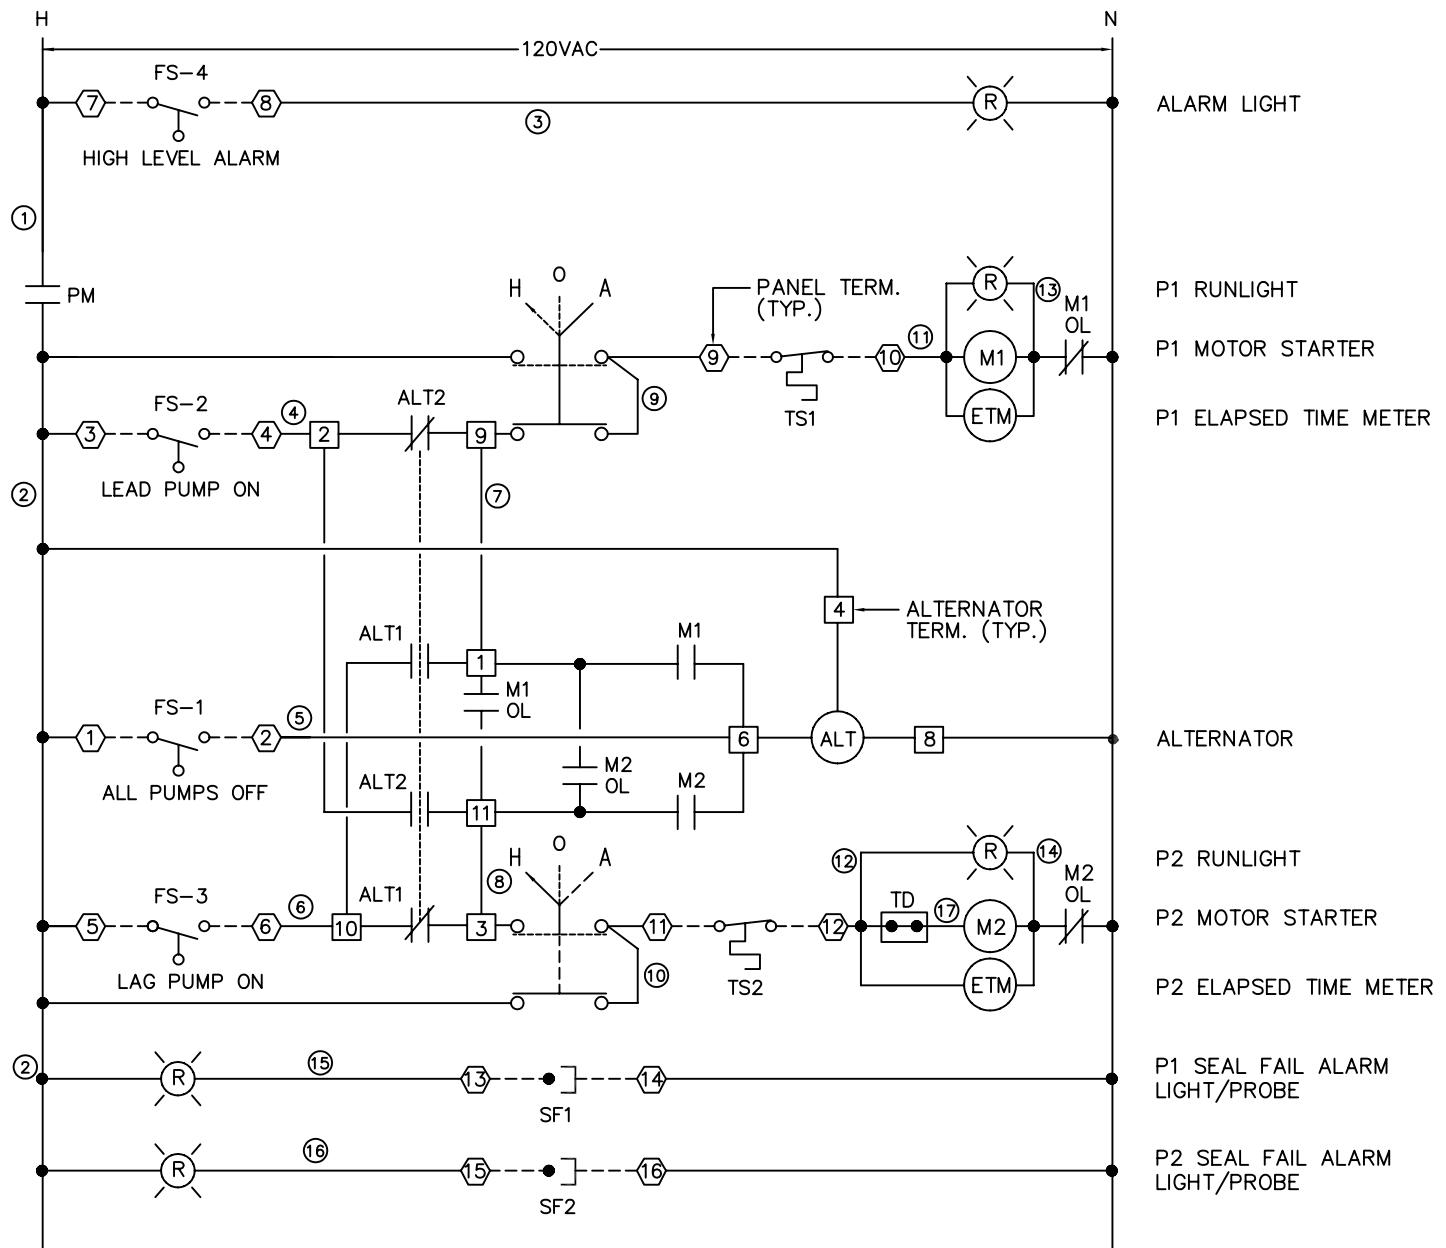

	Drawing Title CONTROL DIAGRAM				
DATE 3/02/06	REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN DRAWN BY C. RACHAL	DATE APPROVED BY DATE
Project Title DUPLEX PUMP CONTROL PANEL	COX Research and Technology, Inc.			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030	PURCHASE ORDER NUMBER DRAWING NUMBER CP-2328 SHEET NUMBER 3

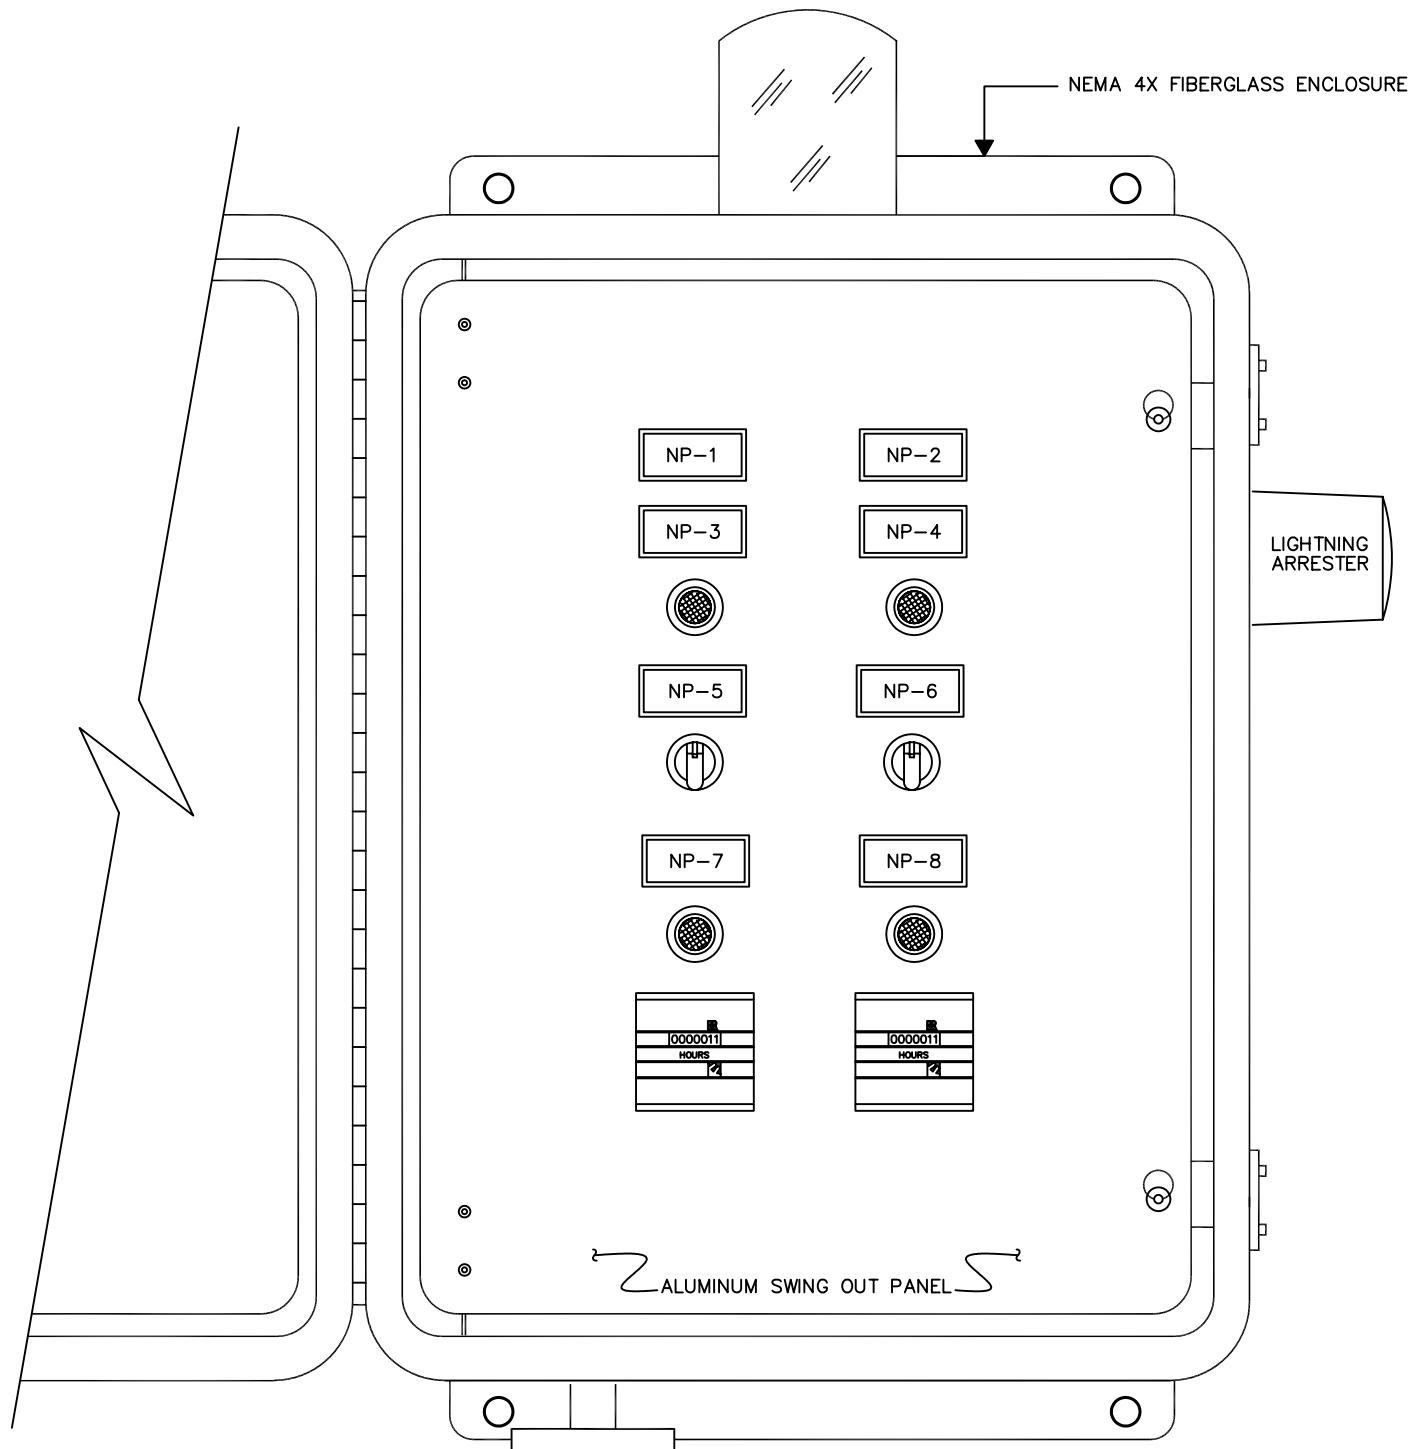

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL

NOTE:
SEWER GASES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASES.

Drawing Title						
	ENCLOSURE					
DATE 3/02/06	REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN DRAWN BY C. RACHAL	DATE APPROVED BY	BY DATE
Project Title DUPLEX PUMP CONTROL PANEL	<hr/> COX <hr/> Research and Technology, Inc. <hr/>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030	PURCHASE ORDER NUMBER DRAWING NUMBER CP-2328 SHEET NUMBER 4	