





CP-1312
CONTROL PANEL


Delta Treatment Systems
9125 Comar Drive
Walker, LA 70785
(225) 665-6162 Fax (800) 219-9183

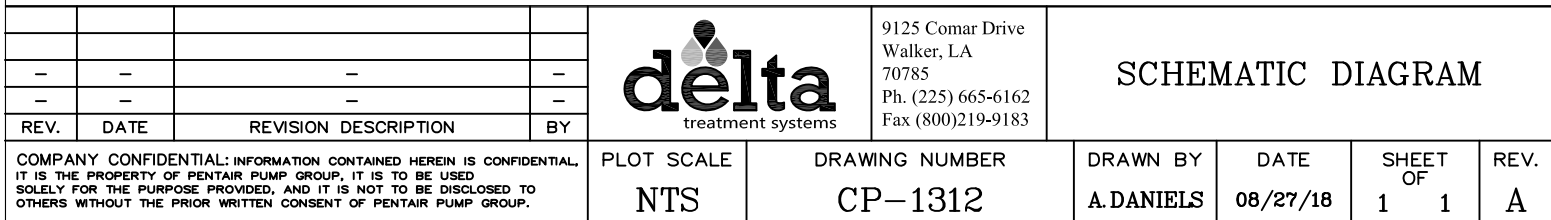

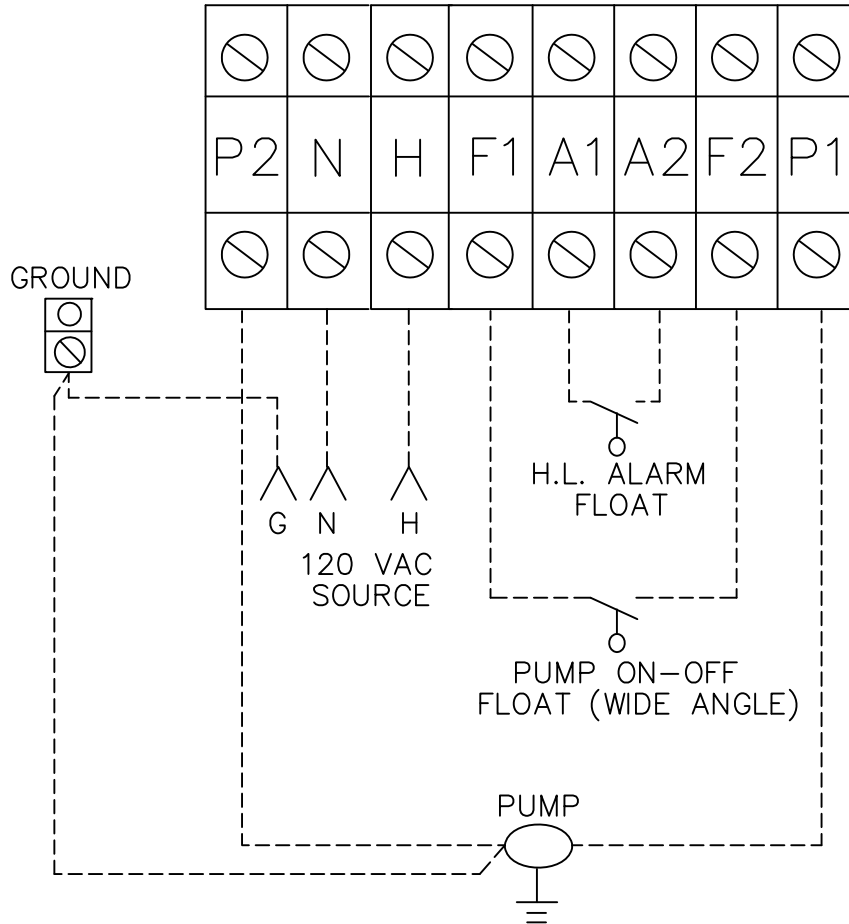

NOTES:

1. EXTERNAL DISCONNECT IS REQUIRED
2. PUMP MUST HAVE INTERNAL THERMAL OVERLOAD PROTECTION.
3. PUMP FLOAT MUST BE CAPABLE OF CARRYING FULL MOTOR CURRENT. (MAX PUMP CURRENT MUST NOT EXCEED 16 AMPS)

					9125 Comar Drive Walker, LA 70785 Ph. (225) 665-6162 Fax (800)219-9183	EXTERNAL CONNECTIONS			
-	-	-	-						
-	-	-	-						
REV.	DATE	REVISION	DESCRIPTION	BY					
COMPANY CONFIDENTIAL: INFORMATION CONTAINED HEREIN IS CONFIDENTIAL, IT IS THE PROPERTY OF PENTAIR PUMP GROUP, IT IS TO BE USED SOLELY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF PENTAIR PUMP GROUP.				PLOT SCALE NTS	DRAWING NUMBER CP-1312	DRAWN BY A.DANIELS	DATE 08/27/18	SHEET OF 2 2	REV. A