
COX

Research and Technology, Inc.

DUPLEX PUMP CONTROL PANEL

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-1485

VOLTAGE	<u>380V</u>	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	<u>3/50</u>	
NO. MOTORS	<u>2</u>	
HP	<u>1</u>	
FLA	<u>2.1A</u>	
TYPE OF PUMP	<u>Submersible</u>	(Self-Priming, Submersible)
MANUFACTURER	<u></u>	
CATALOG NUMBER	<u></u>	
CONTROL VOLTAGE	<u>110V</u>	(120V, Other)
ENCLOSURE	<u>NEMA 4X</u>	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	<u>Fiberglass</u>	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	<u>Floats</u>	(Floats, Bubbler, Other)
CAPACITORS	<u>No</u>	(Yes, No)
CAPACITOR WIRING FIGURE	<u>N/A</u>	
THERM. & SEAL FAIL WIRING FIGURE	<u></u>	


OPTIONS:


SEAL FAIL LIGHTS	<u></u>	(Submersible Only)
SEAL FAIL RELAYS	<u></u>	(Submersible Only)
SEAL FAIL PUMP SHUTDOWN	<u></u>	(Submersible Only)
HT PUMP SHUTDOWN	<u>X</u>	(Self-Primer, Submersible)
ALARM HORN	<u></u>	
ALARM LIGHT	<u>X</u>	
LIGHT PANEL MTD	<u>X</u>	
LIGHT REMOTE MTD	<u></u>	
LIGHT FLASHER	<u></u>	
LIGHTNING ARRESTER	<u></u>	
ELAPSED TIME METER	<u>X</u>	
PHASE MONITOR	<u></u>	
NEMA RATED STARTERS	<u></u>	
GROUND FAULT RECPT.	<u></u>	
GREEN RUN LIGHTS VS. RED	<u>X</u>	
POLE, BOX, SEAL	<u></u>	
INTRINSICALLY SAFE RELAYS	<u></u>	
HIGH TEMP. LOCKOUT, MANUAL RESET	<u></u>	
ECONOMY VERSION	<u></u>	

SOLD TO: Delta Environmental - Denham Springs, LA


TAG :

SHIP TO: Delta Environmental - Denham Springs, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 11/07/02		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div style="text-align: center;">  COX Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1485
							SHEET NUMBER 1

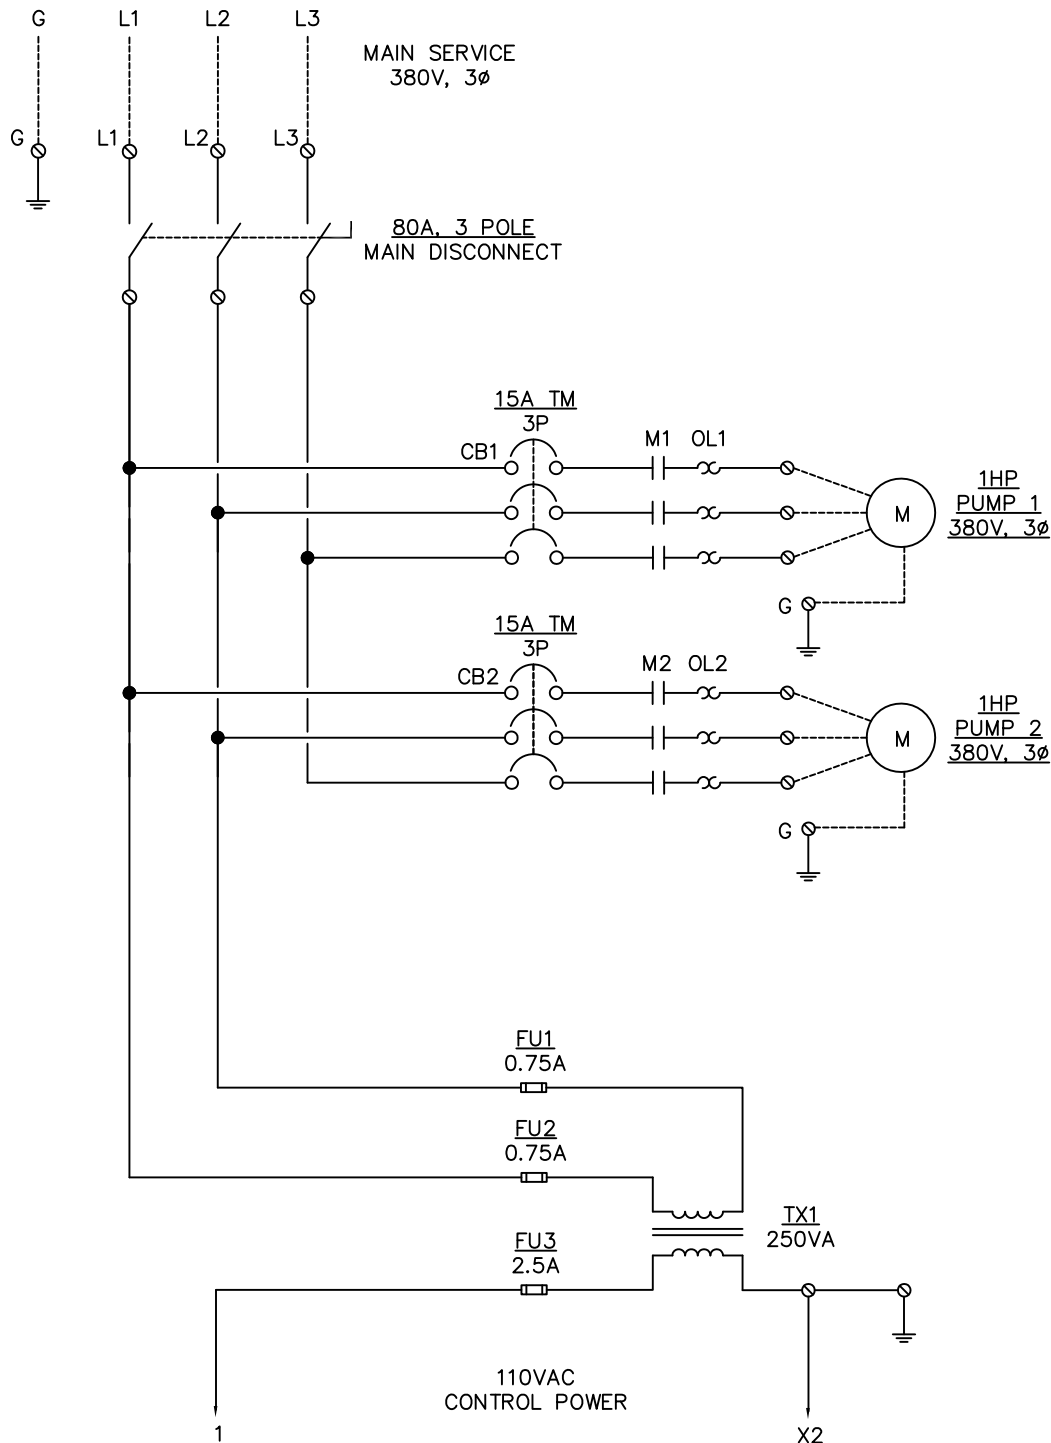

	Drawing Title							
	POWER DIAGRAM							
DATE		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	
11/07/02		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	APPROVED		
	Project Title				PURCHASE ORDER NUMBER			
	DUPLEX PUMP CONTROL PANEL	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1485	
					SHEET NUMBER			2

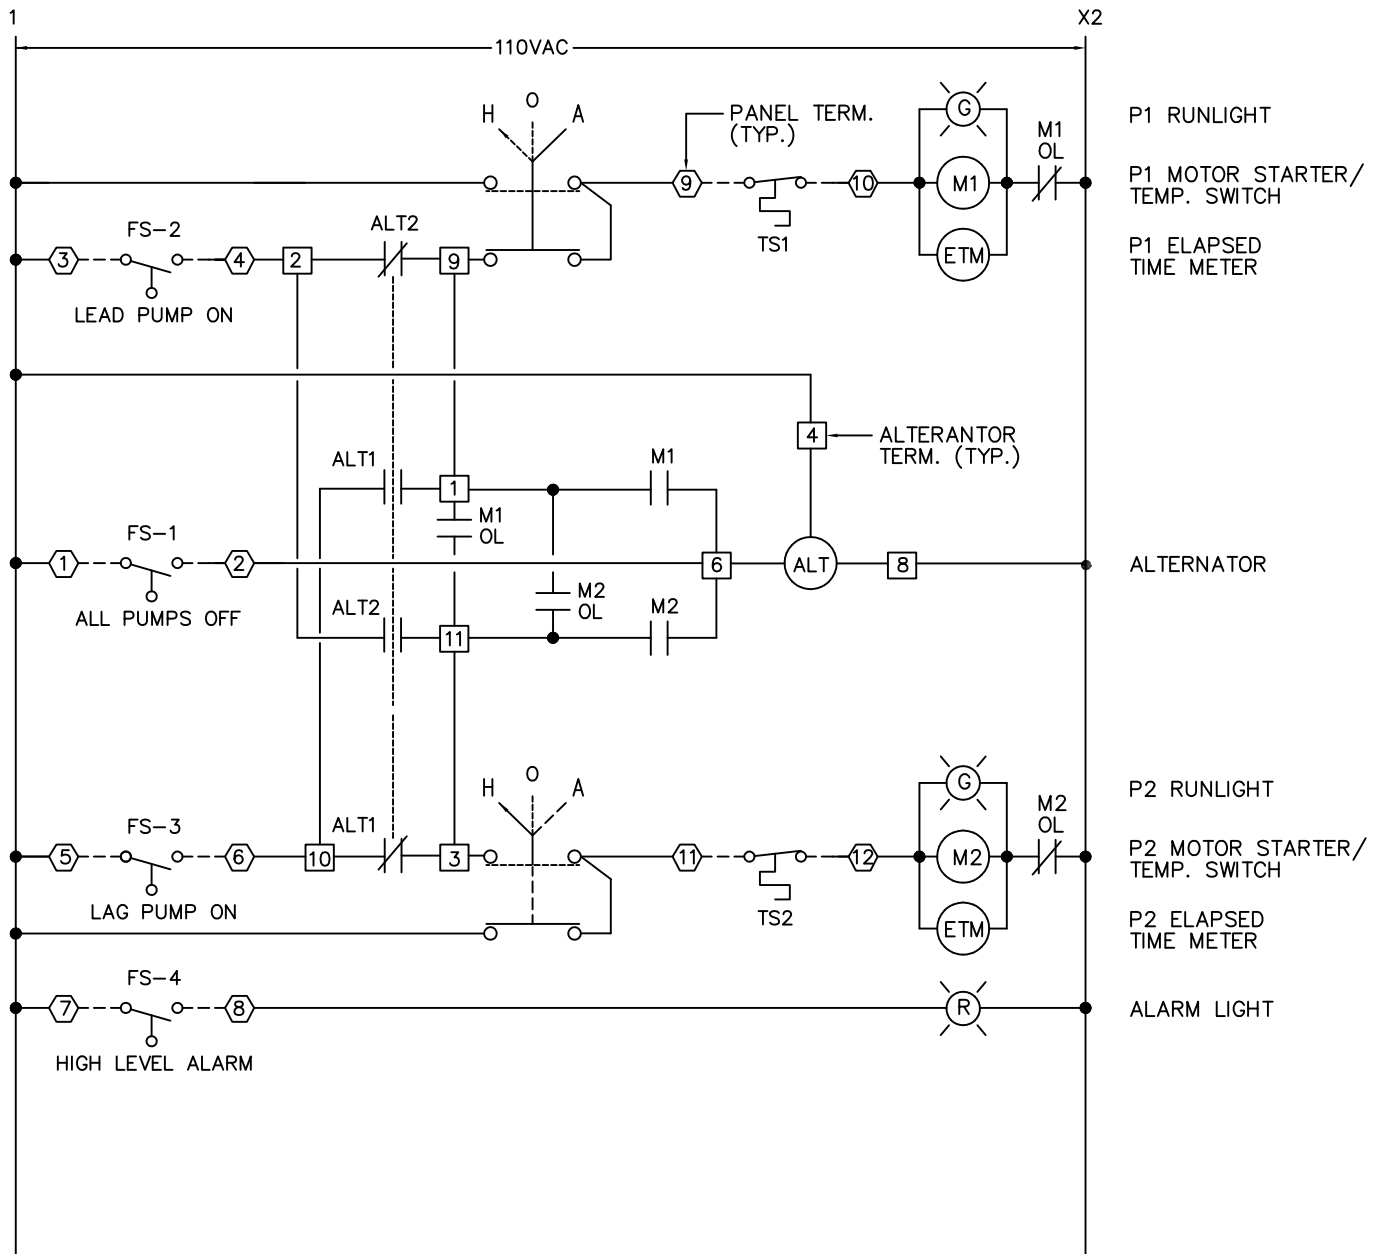


Drawing Title							
CONTROL DIAGRAM							
DATE 11/07/02	REFERENCE DRAWING		NO.	REVISION-LOCATION		ECN	DATE
	S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL		BY	DATE
Project Title				PURCHASE ORDER NUMBER			
DUPLEX PUMP CONTROL PANEL				DRAWING NUMBER CP-1485			
				SHEET NUMBER			

COX

Research and Technology, Inc.

P.O. Box 77808
Baton Rouge, LA
70809

Ph. (225)756-3271
Fax (225)756-1030

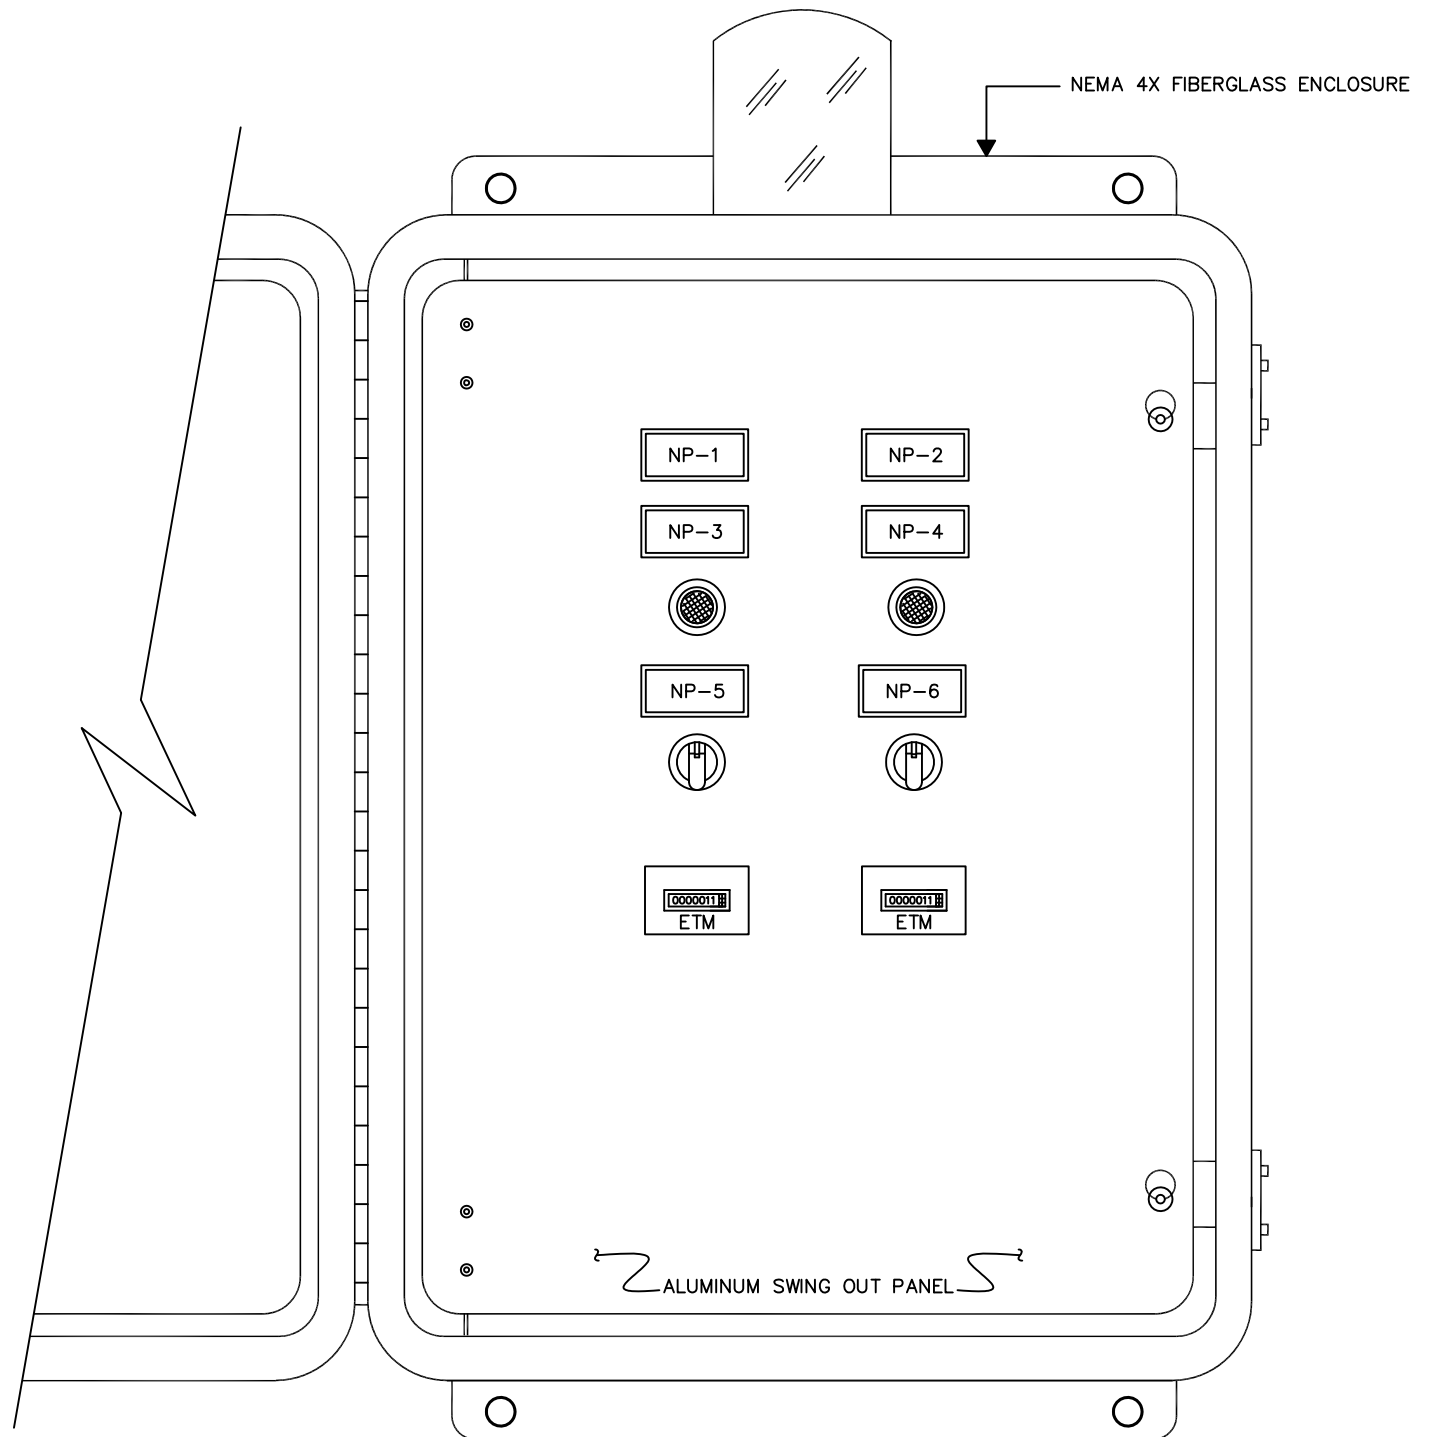

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA

NOTE:


SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

DATE 11/07/02	Drawing Title								
	ENCLOSURE								
	Project Title		REFERENCE DRAWING		NO.		REVISION-LOCATION		ECN
	DUPLIX PUMP CONTROL PANEL		S/N		Sales Engineer C.C.		Application Engineer R.C.		DATE
							DRAWN BY C. RACHAL		BY
									DATE
									PURCHASE ORDER NUMBER
									DRAWING NUMBER
									CP-1485
									SHEET NUMBER
									4

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	1	ABB	OT63E3	MAIN DISC. SWITCH
3	2	ABB	A16-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU2.4	O.L. RELAY (1.7-2.4A)
5	2	ABB	S1N015TL	CB1, CB2
6	1	TIMEMARK	261DT120	ALTERNATING RELAY
7	2	ACI	JR22FG	GREEN PILOT LIGHT
8	2	ACI	JR22P3M20B	HOA SWITCH
9	1	DONGAN	50-0250-058	TRANSFORMER
10	1	AC/DC	BL5-R-120	ALARM LIGHT
11	2	GRASSLIN	FWZ 55K 120/50	ELAPSED TIME METER
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title						
	<h3 style="margin: 0;">BILL OF MATERIALS</h3>						
DATE 11/07/02		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL	APPROVED BY	DATE
	Project Title	<div style="border-top: 3px double black; border-bottom: 3px double black; padding: 5px;"> <h2 style="margin: 0;">COX</h2> <p style="margin: 0;">Research and Technology, Inc.</p> </div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER DRAWING NUMBER <div style="text-align: right;">CP-1485</div> SHEET NUMBER <div style="text-align: right;">5</div>
	DUPLEX PUMP CONTROL PANEL						

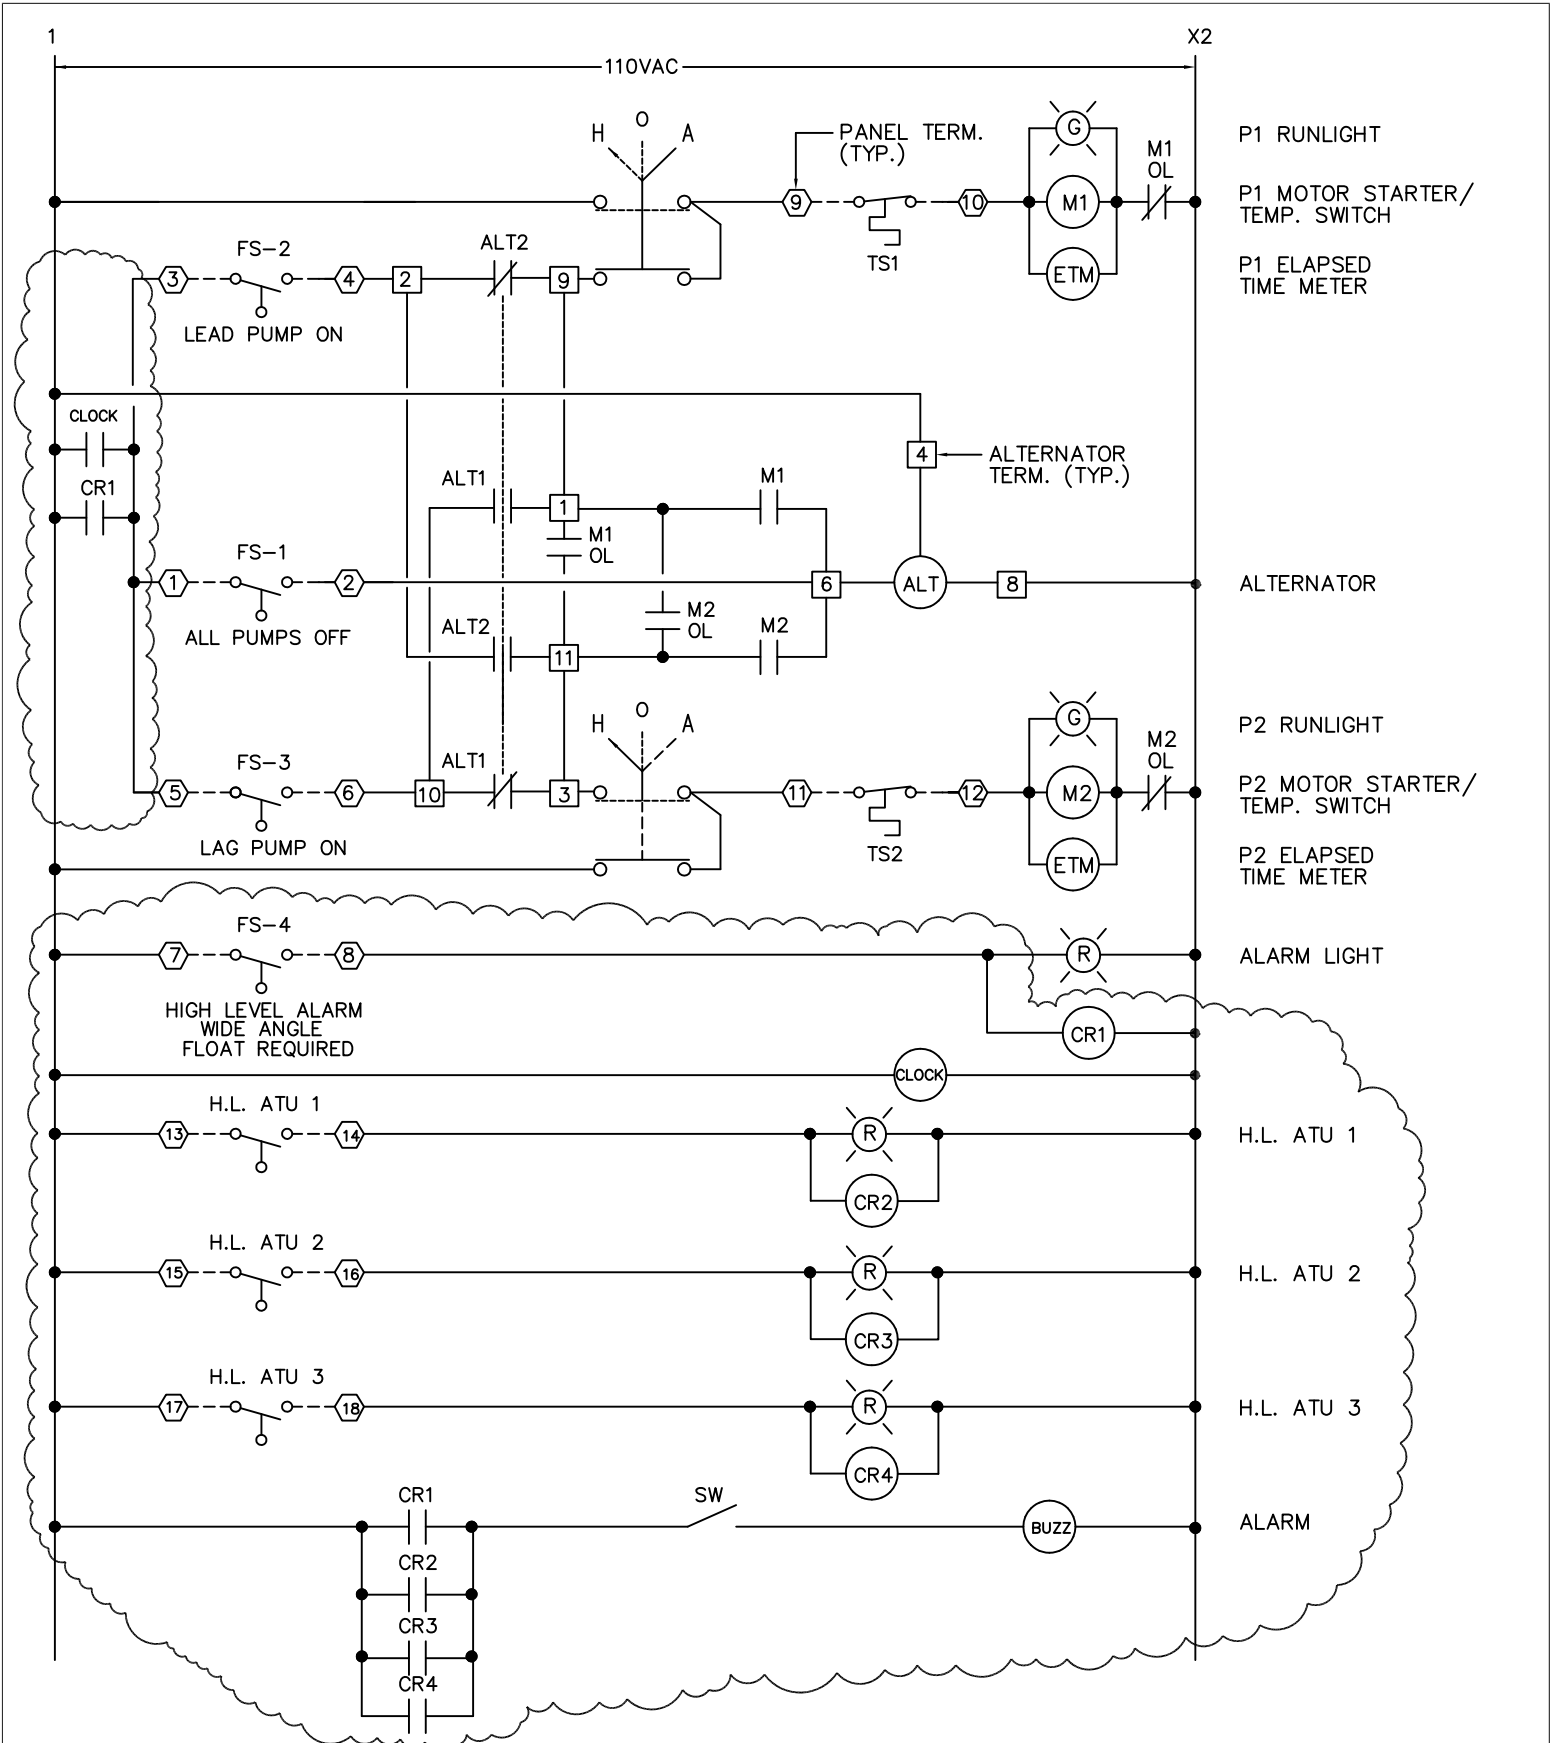

Drawing Title									
CONTROL DIAGRAM									
DATE 11/07/02	REFERENCE DRAWING		NO.		REVISION-LOCATION		ECN	DATE	BY
	S/N		Sales Engineer C.C.		Application Engineer R.C.		DRAWN BY C. RACHAL		APPROVED BY
Project Title		COX		P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER			
DUPLIX PUMP CONTROL PANEL REVISION W/CLOCK & CLOCK OR		Research and Technology, Inc.		Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1485			
						SHEET NUMBER		6	

