



120/240VAC
SOURCE

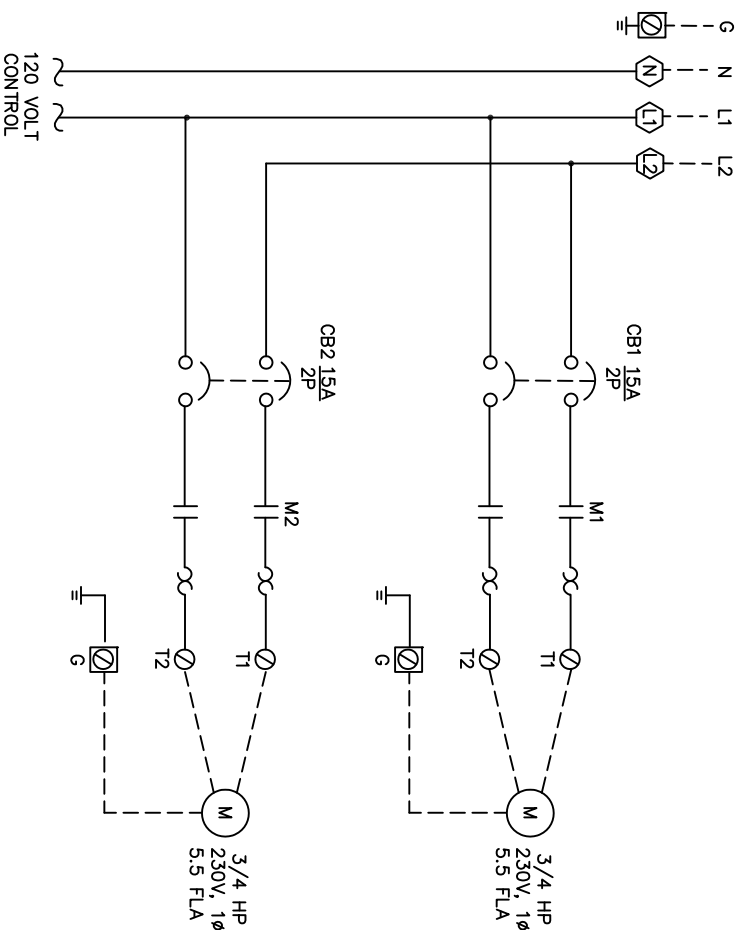

CLOCK 1 - PINS OUT= TIME THAT COMPRESSORS WILL BE ON
PINS IN= TIME THAT COMPRESSORS WILL BE OFF
CLOCK 2 - MOVE ONE PIN OUT AT THE TIME THAT THE COMPRESSORS
ARE TO ALTERNATE
ON BOTH CLOCKS MAKE SURE THAT THE MANUAL-AUTO-OFF LEVER
IS IN THE CENTER POSITION (AUTO).

○ DENOTES PANEL TERMINAL
--- DENOTES FIELD WIRING

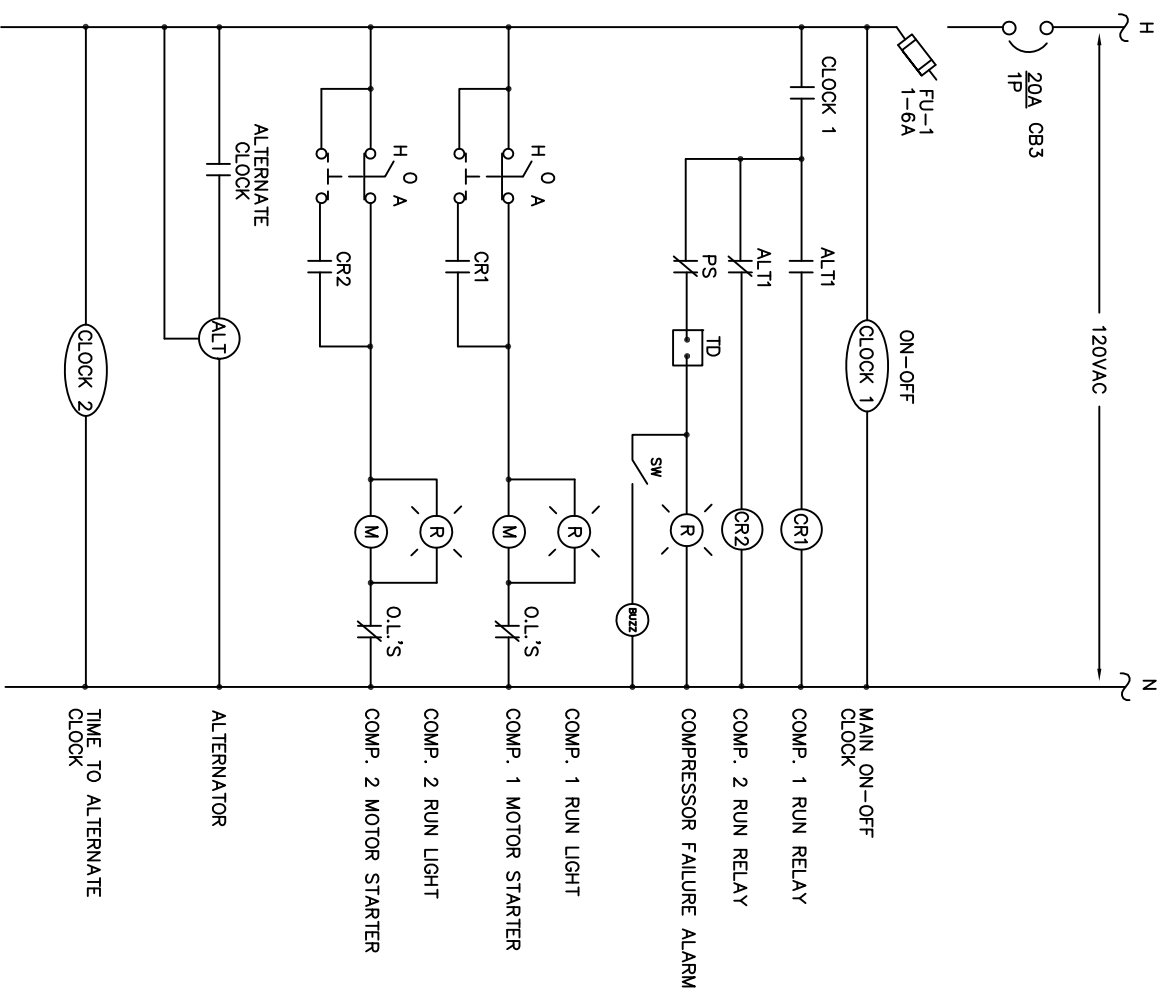

SCHEMATIC DIAGRAM

CP-1600