

PROGRAM: DRCTV1.0






NOTE

- INTERNAL PUMP THERMAL OVERLOAD IS RECOMMENDED.
- REMOVE JUMPERS IF REMOTE LOCK-OUT CONTACTS ARE USED

LEGEND

| | |
|-----|--------------------|
| — | WIRING BY VENDOR |
| --- | WIRING BY CUSTOMER |

| | | | | | | |
|------------------|---------------|---|------------------------|------------------------------|--------------|---------------------------|
| Drawing Title | POWER DIAGRAM | | | | | |
| DATE 11/05/04 | Project Title | CP1000 RCT W/DUPLEX COMPRESSORS | | | | PURCHASE ORDER NUMBER |
| | | COX Research and Technology, Inc. | | | | DRAWING NUMBER CP-1949 |
| | | P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030 | | | | SHEET NUMBER 1 |
| | | REFERENCE DRAWING | NO. | REVISION-LOCATION | ECN | DATE |
| | | S/N | Sales Engineer C.C. | Application Engineer R.C. | BY C. RACHAL | APPROVED |
| | | | | | BY | DATE |

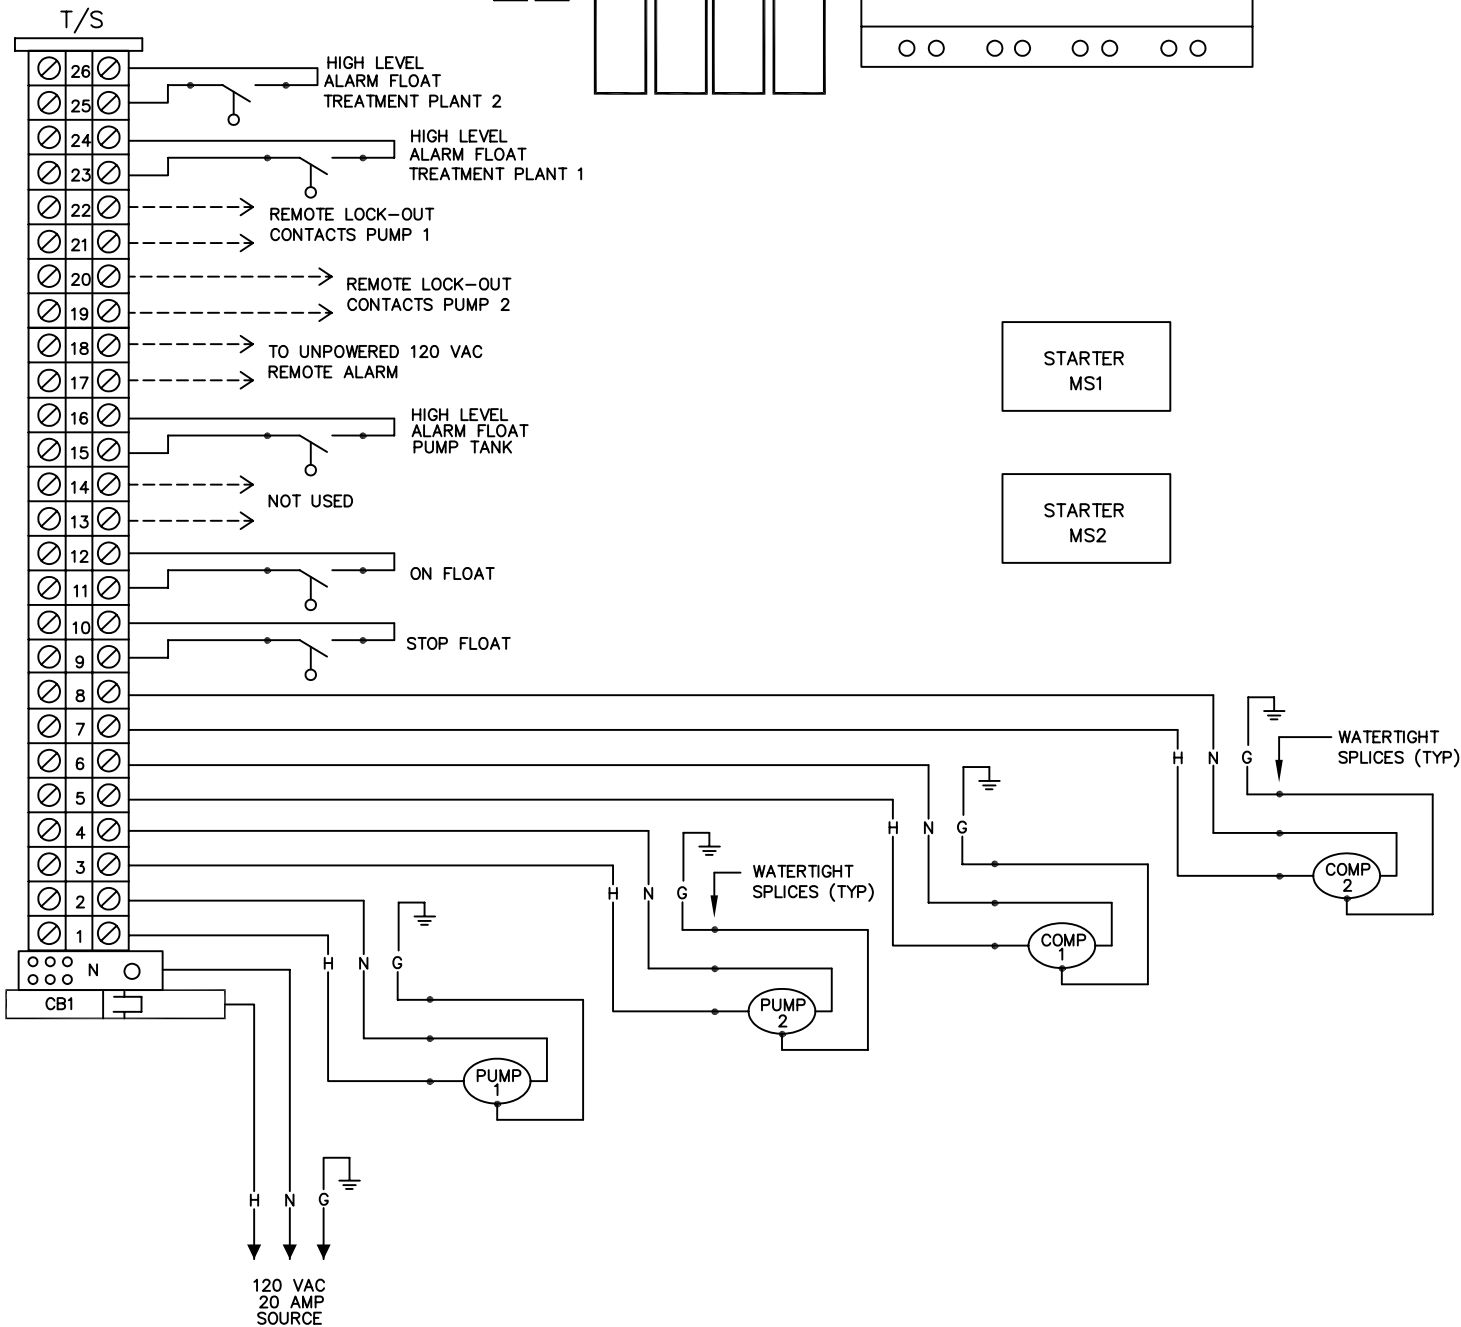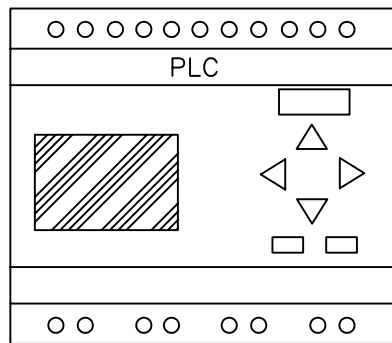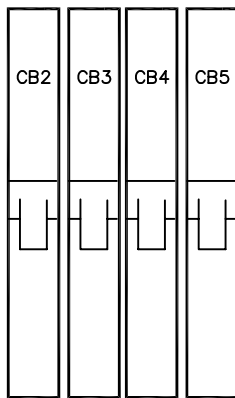

| | | | | | | | |
|------------------------------------|-------------------|------------------------|------------------------------|-----------------------|--|---------------------------|------|
| Drawing Title | | | | | | | |
| EXTERNAL DIAGRAM | | | | | | | |
| DATE 11/05/04 | REFERENCE DRAWING | | NO. | REVISION-LOCATION | | ECN | DATE |
| | S/N | Sales Engineer C.C. | Application Engineer R.C. | DRAWN BY C. RACHAL | | APPROVED BY | |
| Project Title | | | | | | PURCHASE ORDER NUMBER | |
| CP1000 RCT W/DUPLEX COMPRESSORS | | | | | | DRAWING NUMBER CP-1949 | |
| | | | | | | SHEET NUMBER | |
| | | | | | | 2 | |

COX

Research and Technology, Inc.

P.O. Box 77808
Baton Rouge, LA
70809

Ph. (225)756-3271
Fax (225)755-1030