
COX

Research and Technology, Inc.

DUPLEX PUMP
CONTROL PANEL
ST. JUDE CATHOLIC CHURCH

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-2315

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	1/60	
NO. MOTORS	2	
HP	2	
FLA	15	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	BARNES	
CATALOG NUMBER	SGVF2022L-MS	
CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	YES	(Yes, No)
CAPACITOR WIRING FIGURE	N/A	
THERM. & SEAL FAIL WIRING FIGURE		

OPTIONS:


SEAL FAIL LIGHTS	X	(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN		(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER	X	
ELAPSED TIME METER	X	
PHASE MONITOR		
NEMA RATED STARTERS		
GROUND FAULT RECPT.	X	
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		

SOLD TO: Delta Process - Bossier City, LA


TAG : St. Jude Catholic Church

SHIP TO: Delta Process - Ruston, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 2/17/06		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-2315
							SHEET NUMBER 1

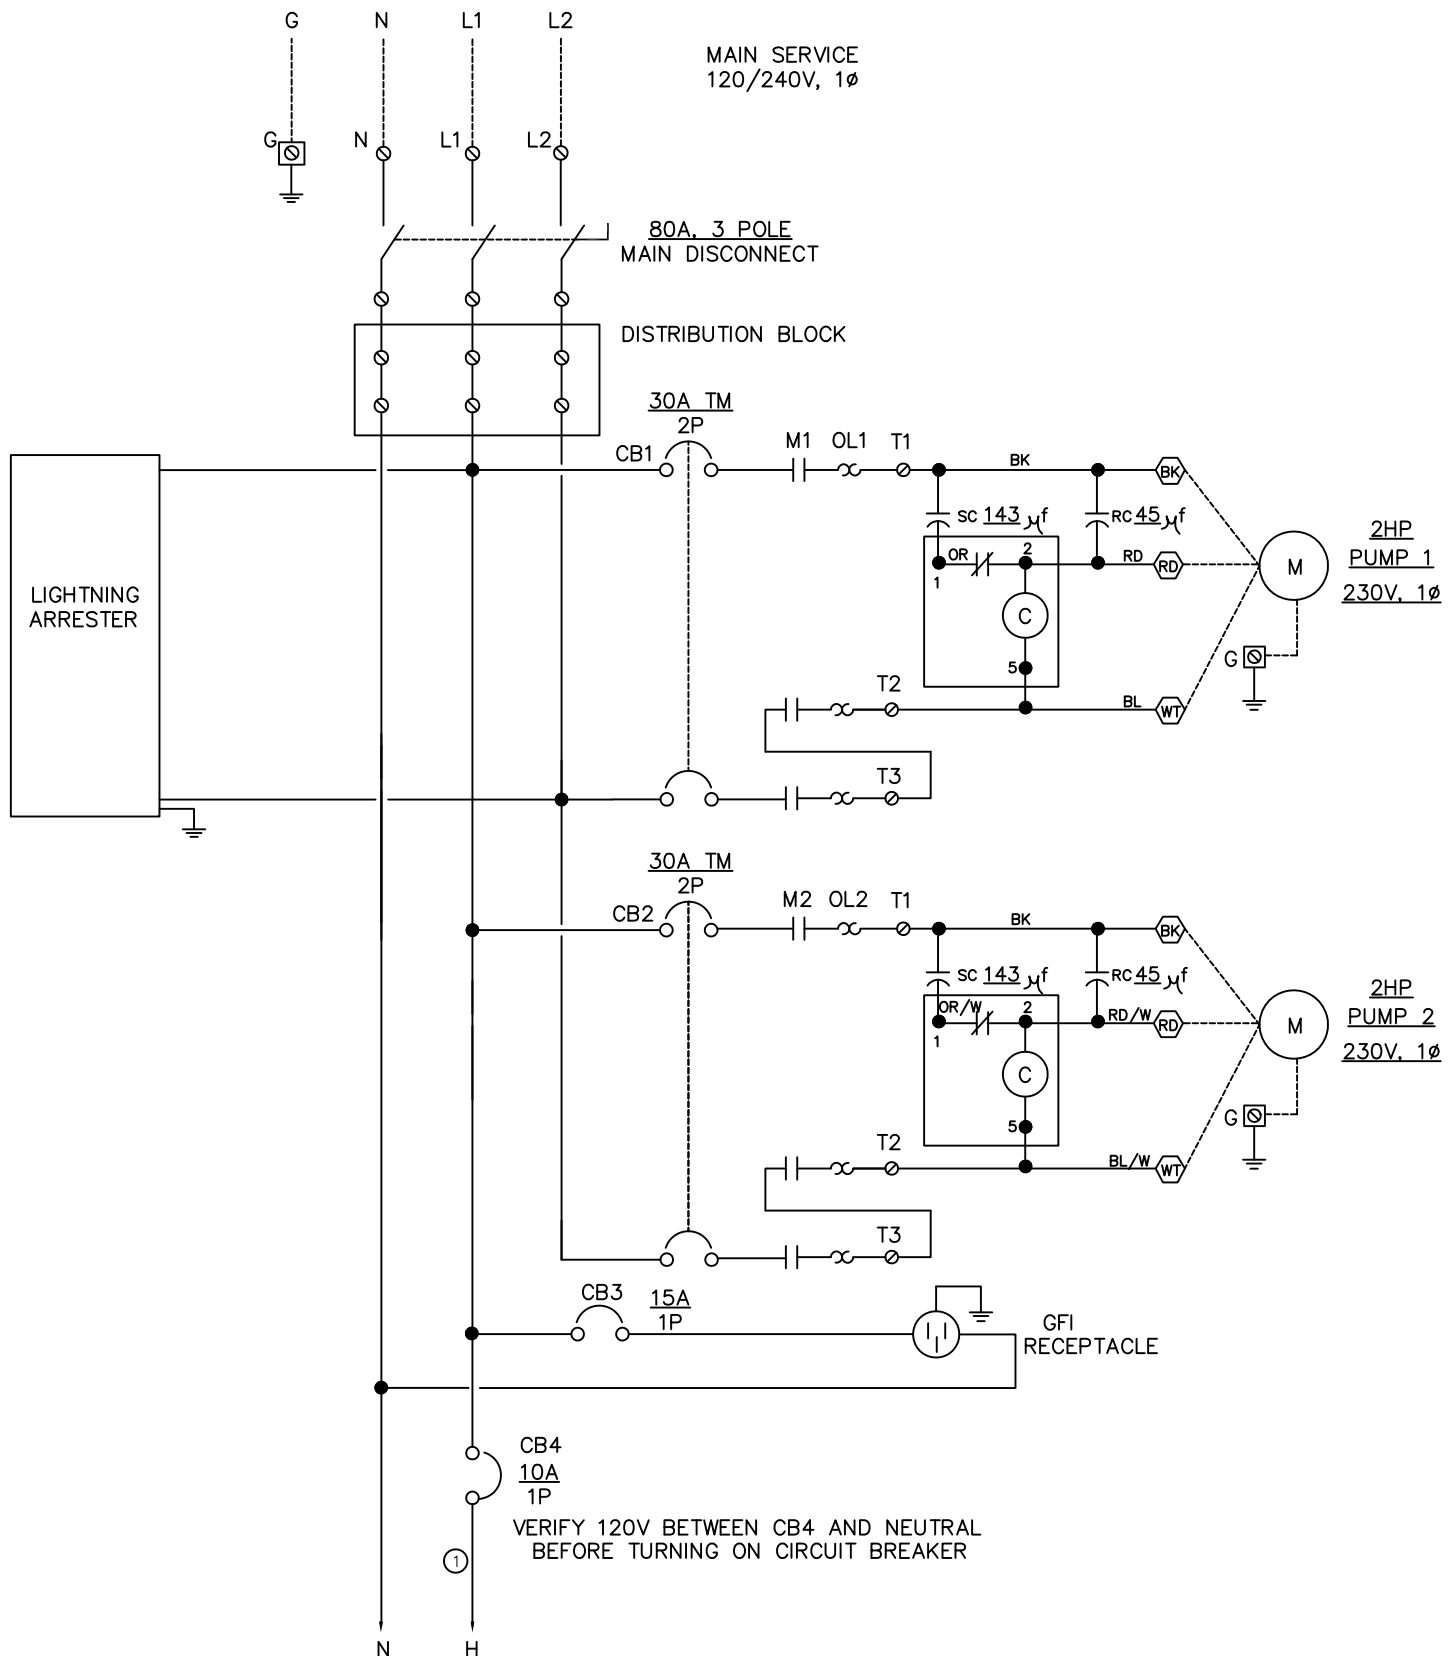

Drawing Title	POWER DIAGRAM					
DATE 2/17/06	REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN BY C. RACHAL	DATE BY	DATE BY
Project Title	COX Research and Technology, Inc.			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030	PURCHASE ORDER NUMBER	
DUPLEX PUMP CONTROL PANEL					DRAWING NUMBER CP-2315	
					SHEET NUMBER 2	

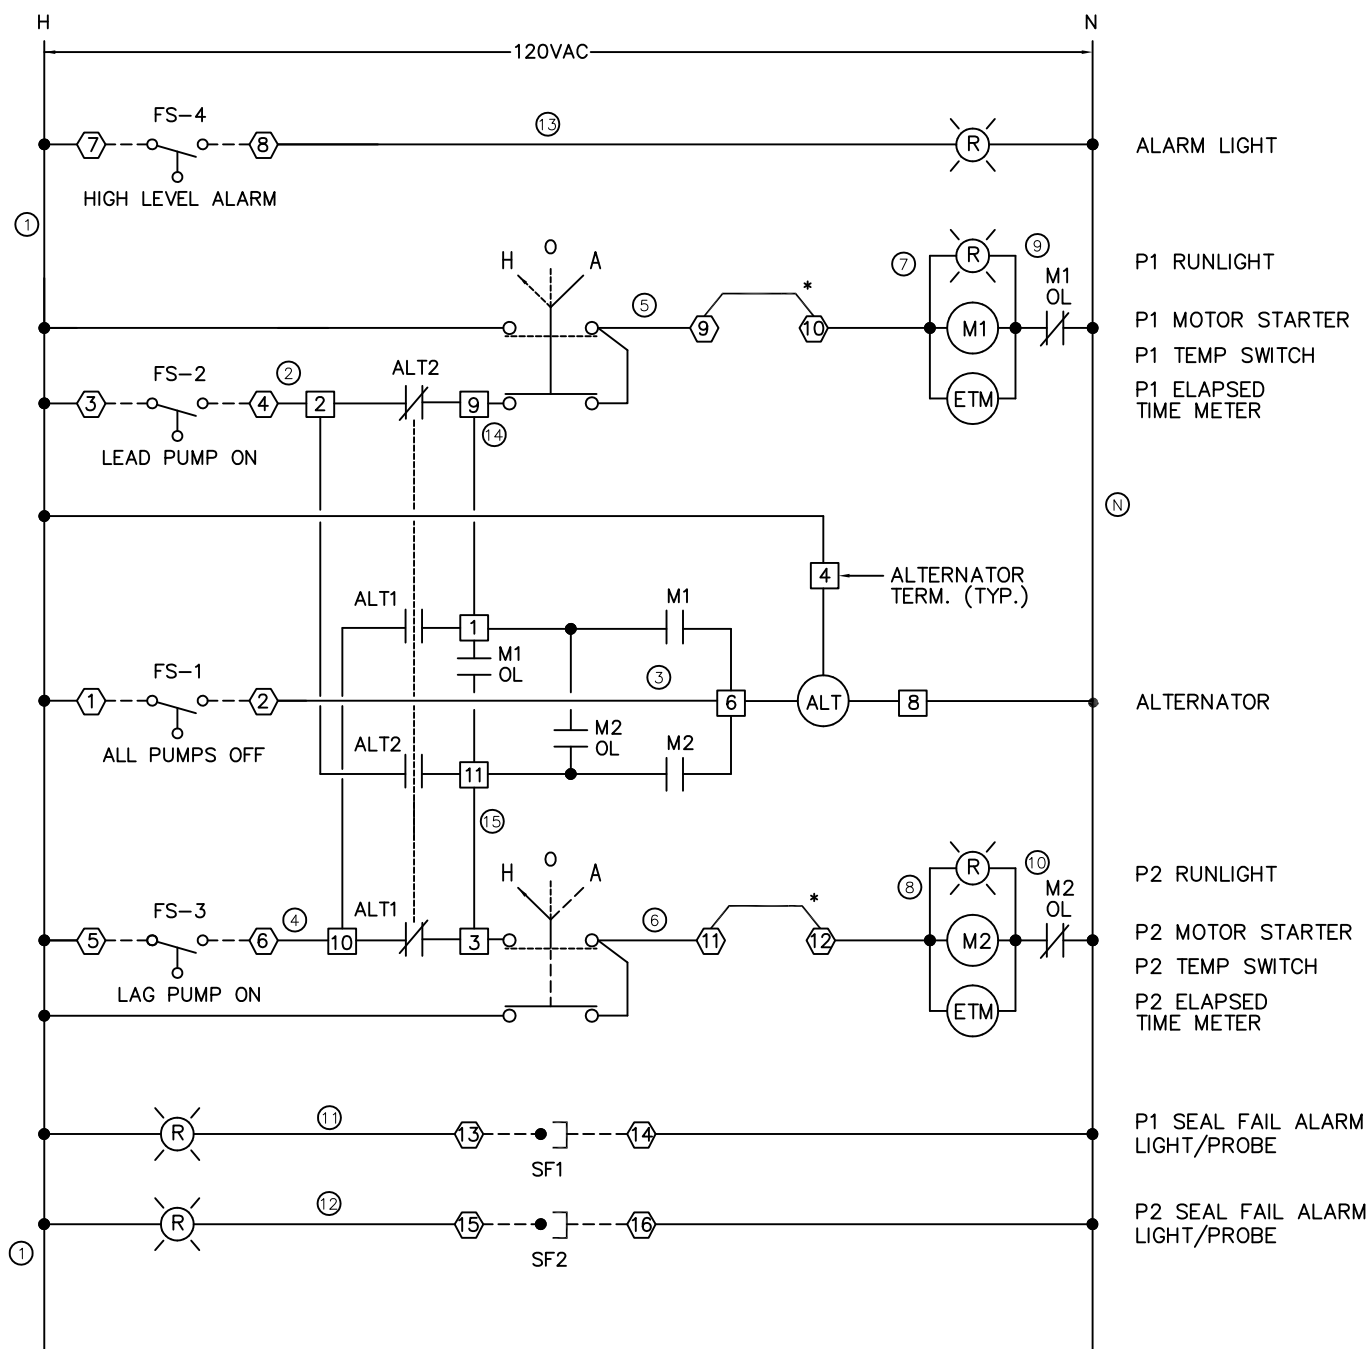

* REMOVE JUMPERS AND INSTALL LOCKOUT DEVICES IF REQUIRED.


	Drawing Title								
	CONTROL DIAGRAM								
DATE 2/17/06		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY	APPROVED
	Project Title								PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL								DRAWING NUMBER CP-2315
									SHEET NUMBER 3

COX

Research and Technology, Inc.

P.O. Box 77808
Baton Rouge, LA
70809

Ph. (225)756-3271
Fax (225)755-1030

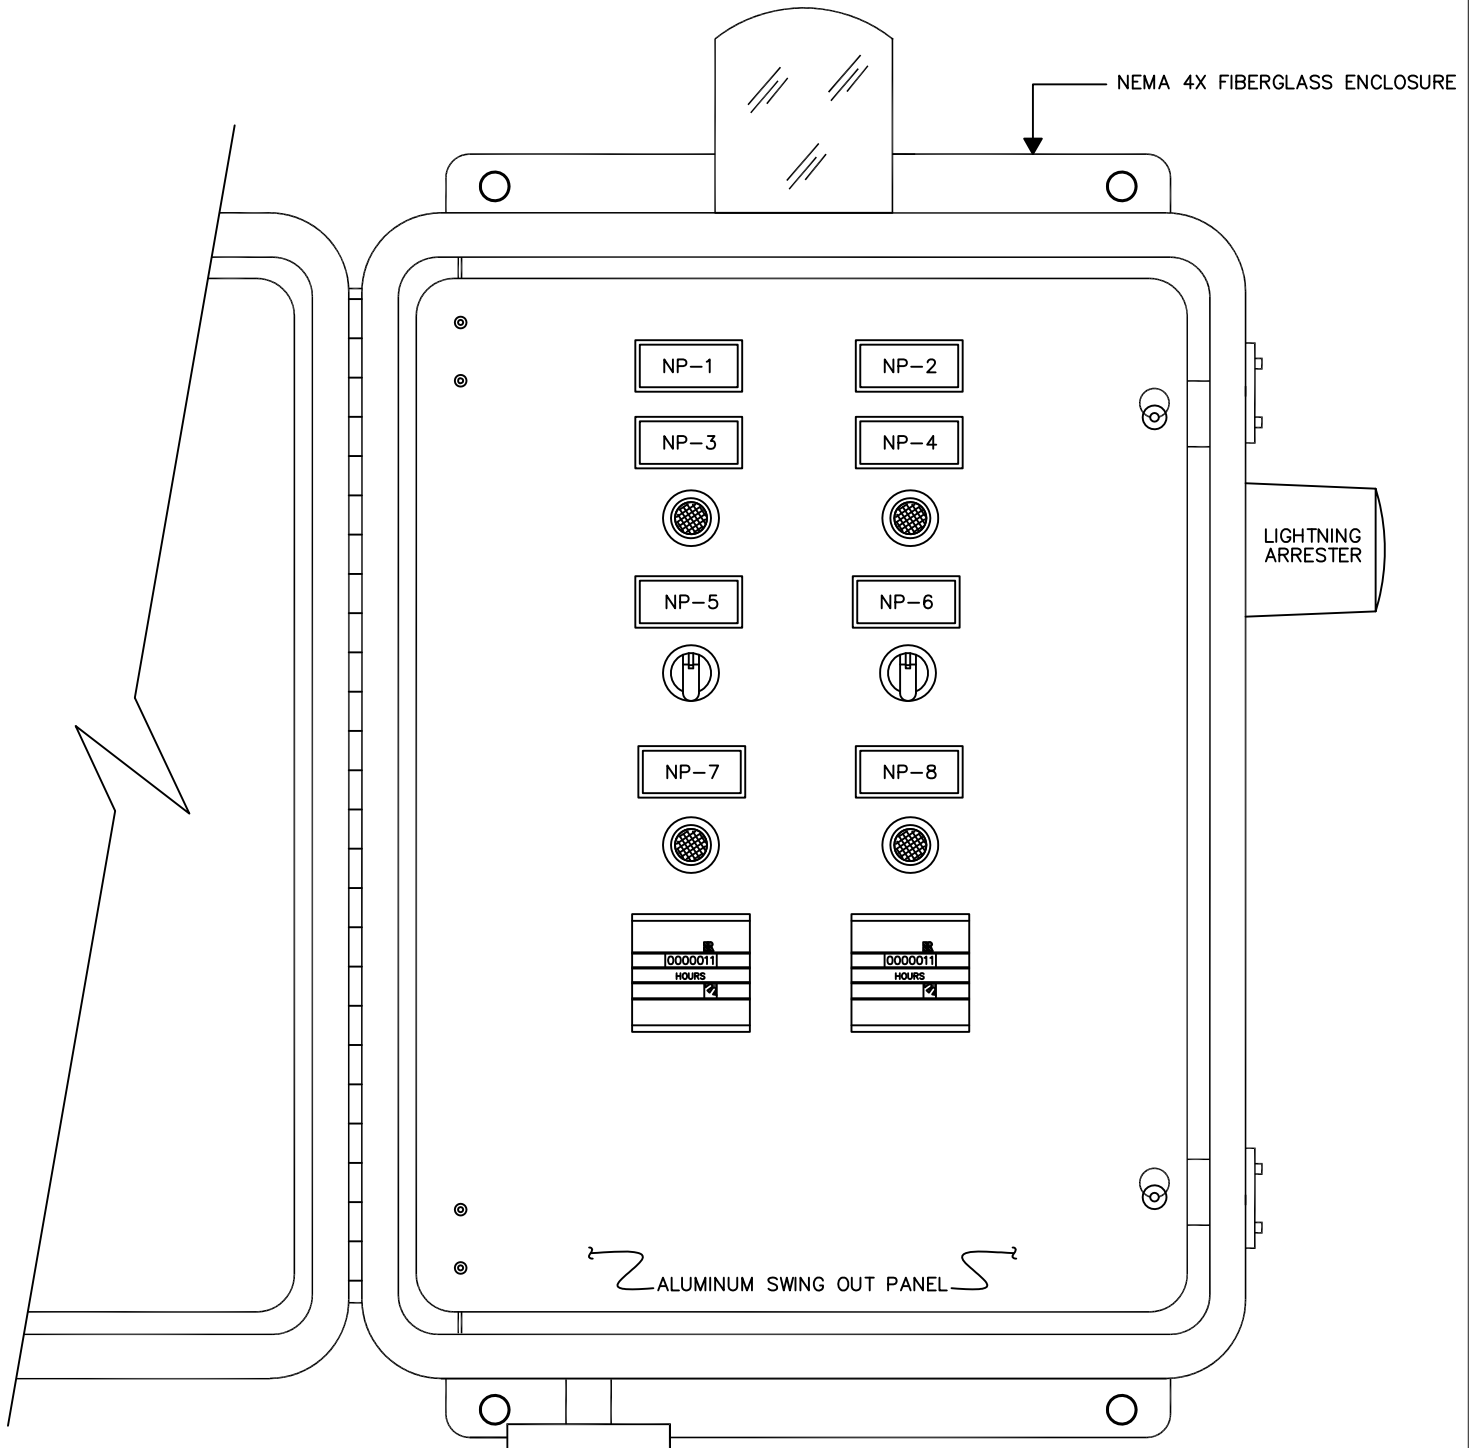

NOTE:
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL

DATE 2/17/06	Drawing Title								
	ENCLOSURE								
		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY		
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	APPROVED			
	Project Title				P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER			
	DUPLEX PUMP CONTROL PANEL	<div> <div>COX</div> <div>Research and Technology, Inc.</div> </div>			Ph. (225)756-3271 Fax (225)755-1030	DRAWING NUMBER CP-2315			
						SHEET NUMBER 4			

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	1	ABB	OT63E3	MAIN DISC. SWITCH
3	2	ABB	A16-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU19	O.L. (13-19A)
5	2	SQUARE D	QOU230	CB1, CB2
6	1	SQUARE D	QOU115	CB3
7	1	TIMEMARK	261DT120	ALTERNATING RELAY
8	4	ACI	JR22FR	RED PILOT LIGHT
9	2	ACI	JR22P3M20B	HOA SWITCH
10	1	AC/DC	BL5-R-120	ALARM LIGHT
11	1	MARATHON	1323580	DISTRIBUTION BLOCK
12	2	REDINGTON	711-0190	ELAPSED TIME METER
13	1	SQUARE D	QOU110	CB4
14	1	DELTA	LA302	LIGHTNING ARRESTER
15	1	STOCK		GFI
16	2	MALLORY	4CU54	143 μ f CAPACITOR
17	2	GE	5X434	45 μ f CAPACITOR
18	2	GE	6X559	START RELAY
19				
20				
21				
22				
23				
24				
25				

	Drawing Title						
	BILL OF MATERIALS						
DATE 2/17/06		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 150px;"> COX <small>Research and Technology, Inc.</small> </div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030		PURCHASE ORDER NUMBER DRAWING NUMBER CP-2315 SHEET NUMBER 5
	DUPLEX PUMP CONTROL PANEL						