

---

---

# COX

Research and Technology, Inc.

---

---

## DUPLEX BLOWER CONTROL PANEL

Cox Research and Technology, Inc.  
14697 S. Harrells Ferry Road  
Baton Rouge, LA. 70816  
(225) 756-3271 Fax (225) 755-1030

CP-1960

VOLTAGE	<u>120/208V</u>	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	<u>1/60</u>	
NO. MOTORS	<u>2</u>	
HP	<u>2</u>	
FLA	<u>13</u>	
TYPE OF PUMP	<u>Blower</u>	(Self-Priming, Submersible)
MANUFACTURER	<u></u>	
CATALOG NUMBER	<u></u>	
CONTROL VOLTAGE	<u>120V</u>	(120V, Other)
ENCLOSURE	<u>NEMA 4X</u>	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	<u>Fiberglass</u>	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	<u></u>	(Floats, Bubbler, Other)
CAPACITORS	<u></u>	(Yes, No)
CAPACITOR WIRING FIGURE	<u></u>	
THERM. & SEAL FAIL WIRING FIGURE	<u></u>	


OPTIONS:


SEAL FAIL LIGHTS	<u></u>	(Submersible Only)
SEAL FAIL RELAYS	<u></u>	(Submersible Only)
SEAL FAIL PUMP SHUTDOWN	<u></u>	(Submersible Only)
HT PUMP SHUTDOWN	<u></u>	(Self-Primer, Submersible)
ALARM HORN	<u></u>	
ALARM LIGHT	<u></u>	
LIGHT PANEL MTD	<u></u>	
LIGHT REMOTE MTD	<u></u>	
LIGHT FLASHER	<u></u>	
LIGHTNING ARRESTER	<u></u>	
ELAPSED TIME METER	<u></u>	
PHASE MONITOR	<u></u>	
NEMA RATED STARTERS	<u></u>	
GROUND FAULT RECPT.	<u></u>	
GREEN RUN LIGHTS VS. RED	<u></u>	
POLE, BOX, SEAL	<u></u>	
INTRINSICALLY SAFE RELAYS	<u></u>	
HIGH TEMP. LOCKOUT, MANUAL RESET	<u></u>	
ECONOMY VERSION	<u></u>	

SOLD TO: Delta Process Equipment, Inc.


TAG :

SHIP TO: Delta Process Equipment, Inc. - Denham Springs, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 1/25/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div style="text-align: center;">   <b>COX</b>  Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX BLOWER CONTROL PANEL				Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-1960
							SHEET NUMBER 1

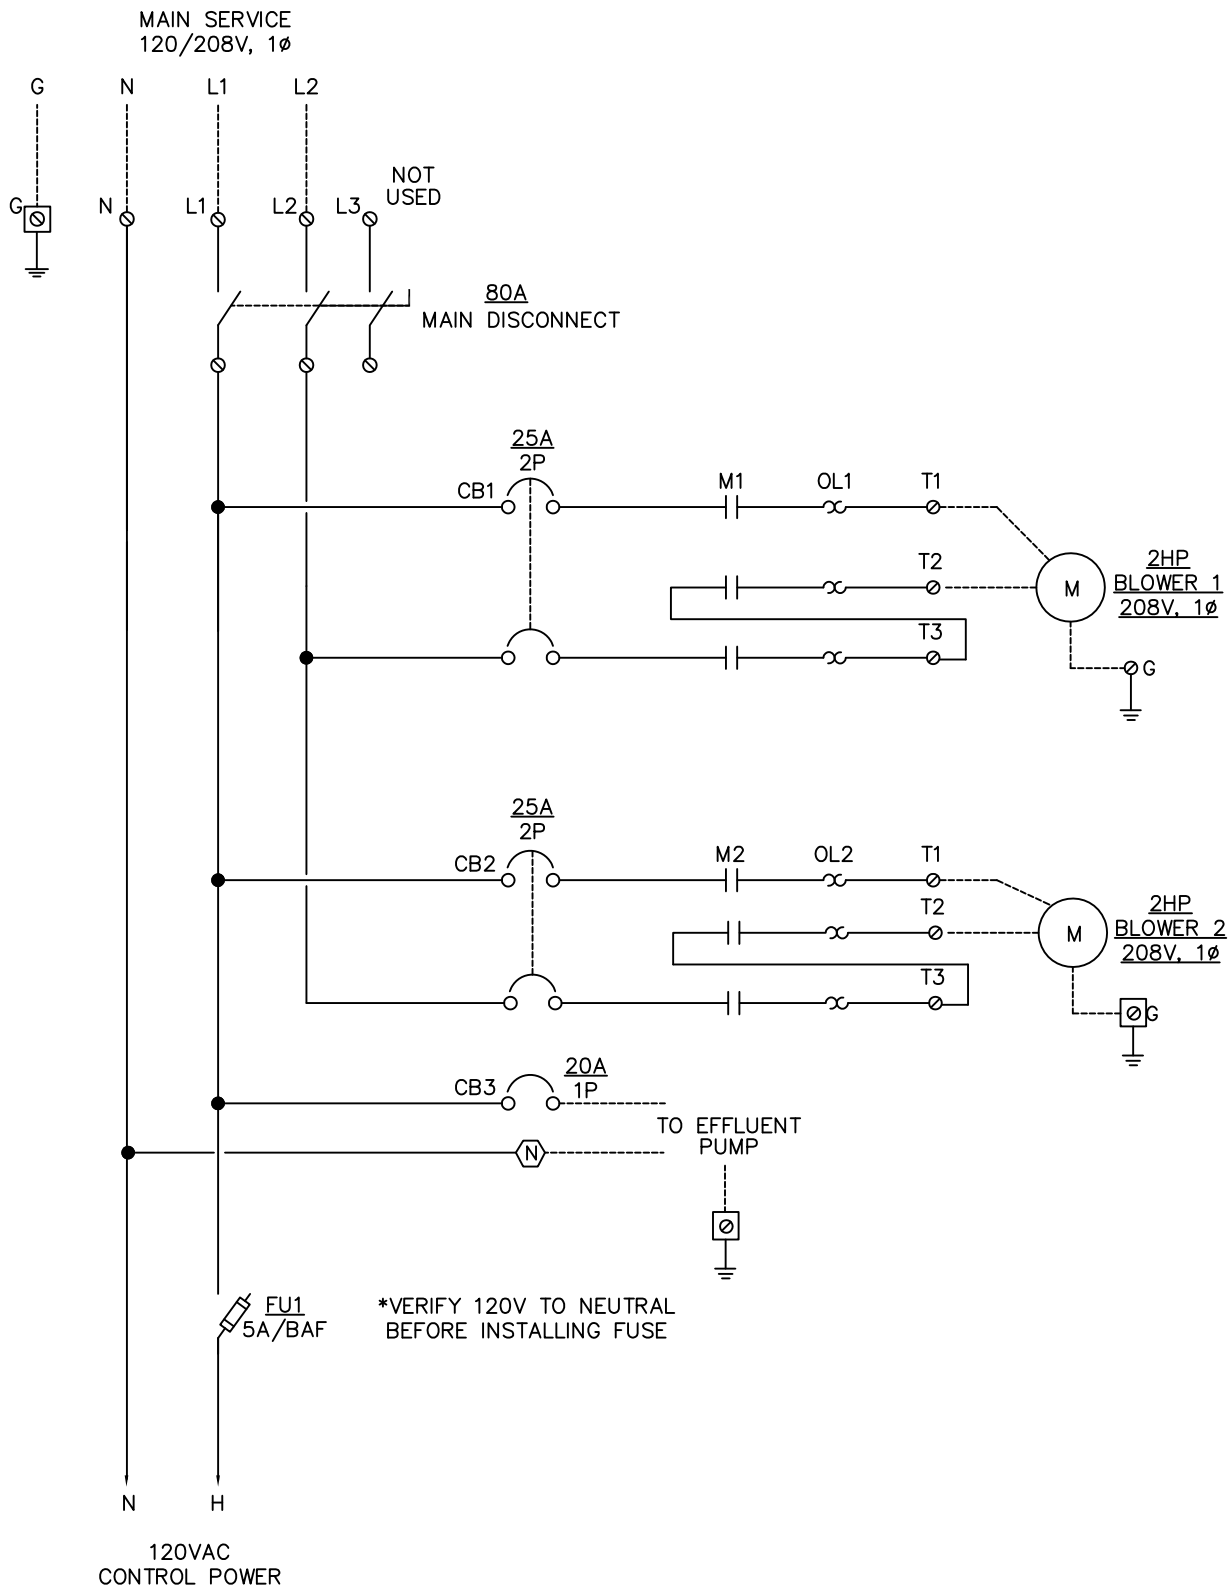

	Drawing Title								
	POWER DIAGRAM								
DATE	1/25/05	REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	APPROVED	
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	BY	DATE		
	Project Title	PURCHASE ORDER NUMBER							
	DUPLEX BLOWER CONTROL PANEL	DRAWING NUMBER CP-1960							
		SHEET NUMBER			2				


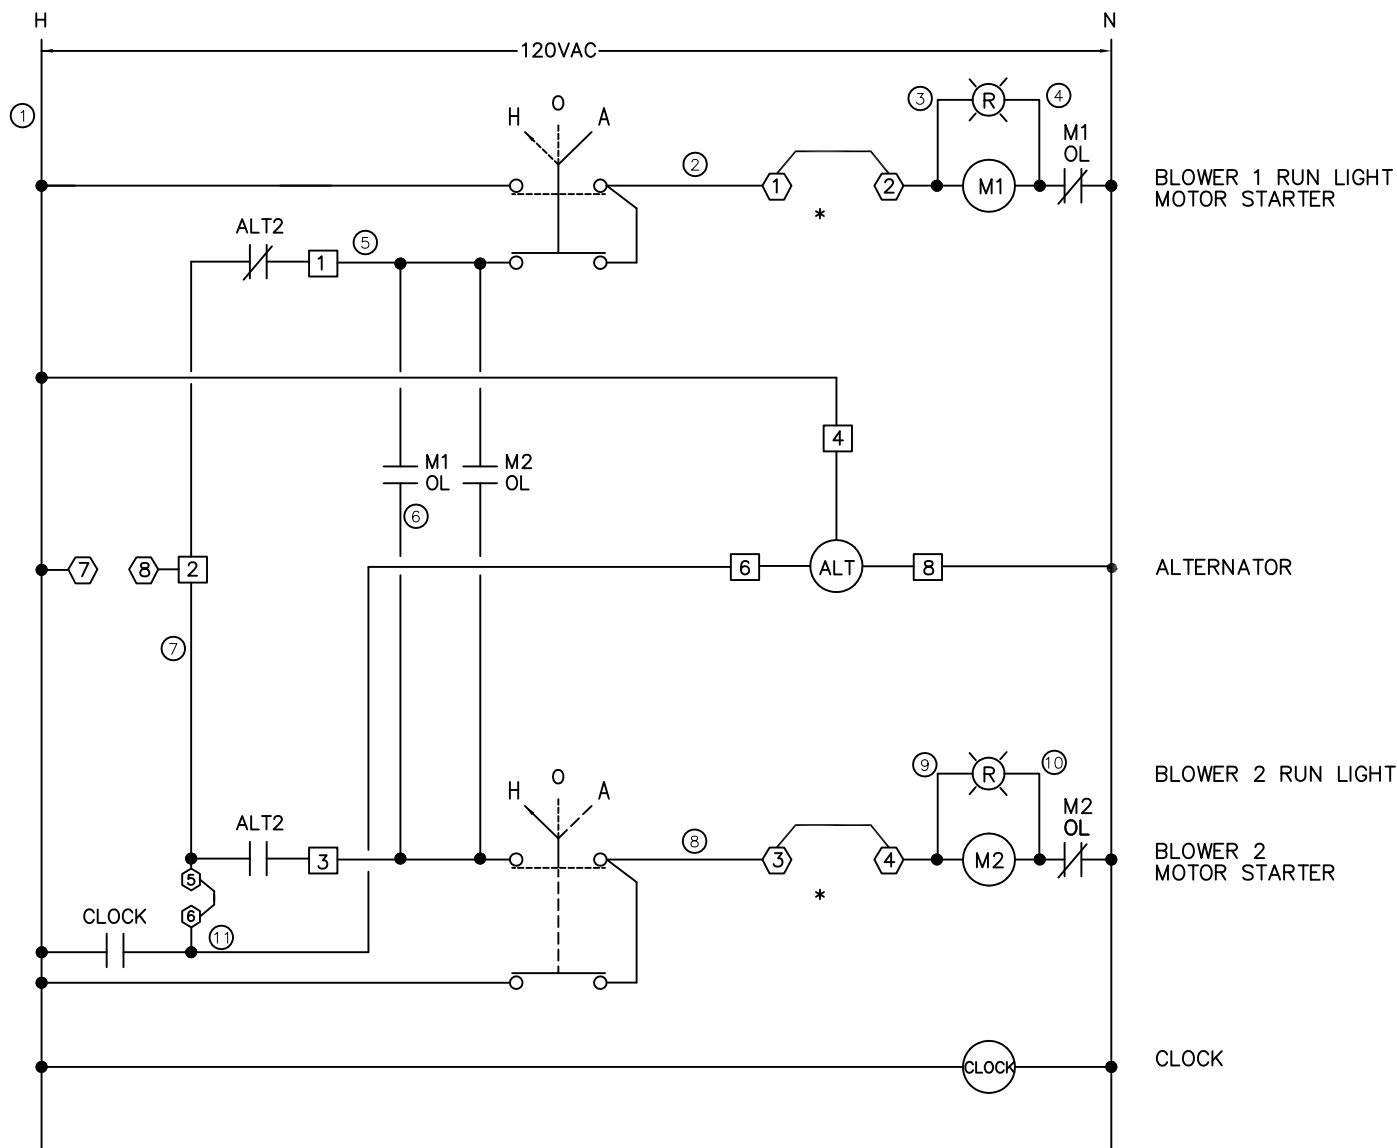


PANEL IS DESIGNED TO RUN AERATORS WITH A MINIMUM OF 15 MINUTES OF OFF TIME BETWEEN ALTERNATION. PINS PUSHED OUT ON CLOCK INDICATE RUN TIME. PINS PUSHED IN INDICATE OFF TIME. EACH PIN IS EQUAL TO 15 MINUTES.

IF NO OFF TIME IS REQUIRED BETWEEN ALTERNATION, REMOVE JUMPER FROM TERMINALS ⑤ AND ⑥ PLACE JUMPER ACROSS TERMINALS ⑦ AND ⑧ NOW AERATORS WILL RUN CONTINUOUSLY. SET 1 PIN IN AT THE TIME YOU WISH THE AERATORS TO ALTERNATE. ALL REMAINING PINS SHOULD BE PUSHED OUT.

\* REMOVE JUMPERS AND INSTALL LOCKOUT DEVICES IF REQUIRED


	Drawing Title								
	CONTROL DIAGRAM								
DATE	1/25/05	REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	APPROVED	
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	BY	DATE		
	Project Title	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER		
	DUPLEX BLOWER CONTROL PANEL				Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-1960		
							SHEET NUMBER 3		

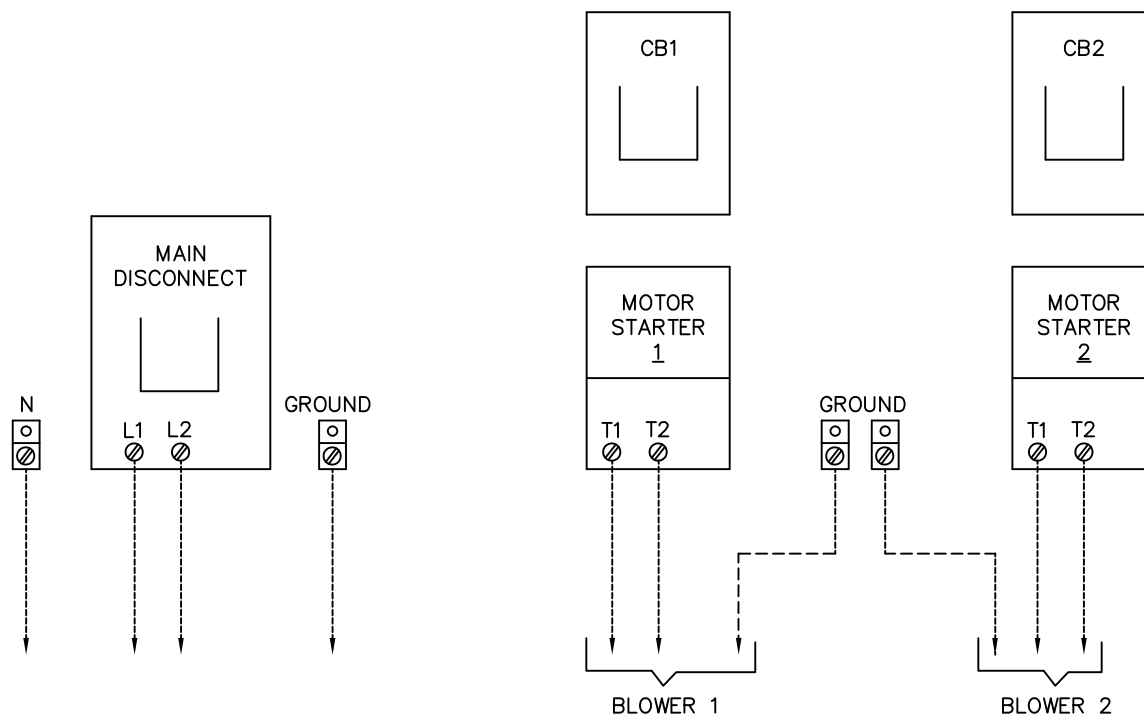

REMOVE JUMPERS & INSTALL  
LOCKOUT DEVICES IF REQUIRED

IF NO OFF TIME IS REQUIRED BETWEEN  
ALTERNATION, REMOVE JUMPER FROM  
TERMINALS ⑤ AND ⑥. PLACE JUMPER ACROSS  
TERMINALS ⑦ AND ⑧. NOW AERATORS WILL RUN  
CONTINUOUSLY. SET 1 PIN IN AT THE TIME YOU  
WISH THE AERATORS TO ALTERNATE.  
ALL REMAINING PINS SHOULD BE PUSHED OUT.

	Drawing Title							
	EXTERNAL CONNECTIONS							
DATE 1/25/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN	DATE	BY	
	Project Title	DRAWN BY C. RACHAL			APPROVED BY		DATE	
	DUPLEX BLOWER CONTROL PANEL	PURCHASE ORDER NUMBER			DRAWING NUMBER CP-1960		SHEET NUMBER	4
		<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809  Ph. (225)756-3271 Fax (225)755-1030			

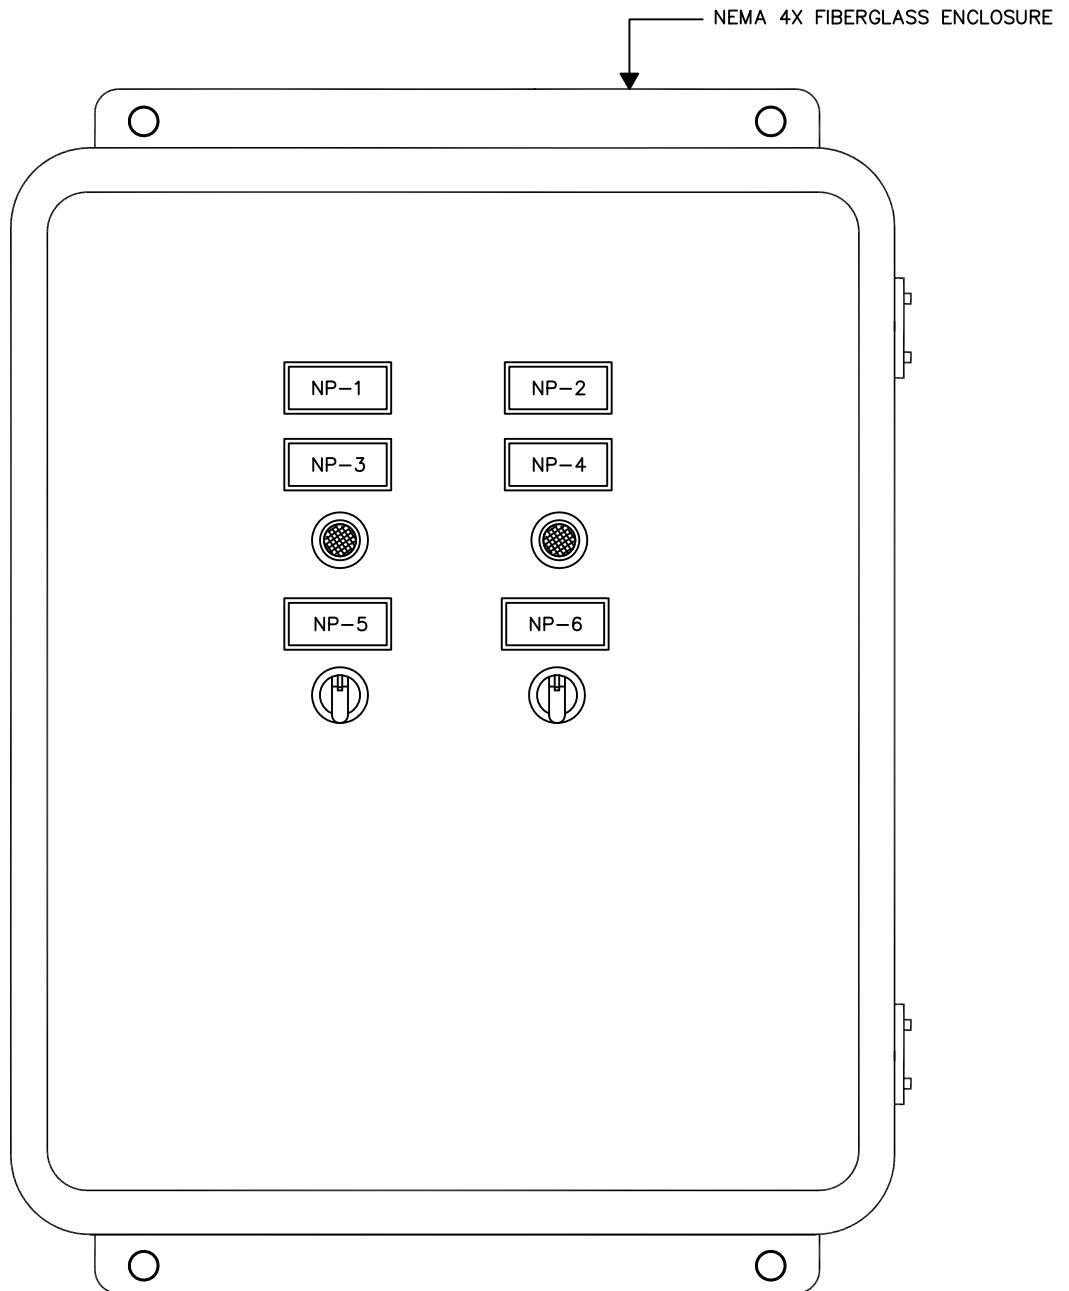

VIEW OF FRONT OF ENCLOSURE

NAMEPLATE SCHEDULE

NP-1	BLOWER 1
NP-2	BLOWER 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA

NOTE:

SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.  
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE  
PANEL TO PREVENT ENTRY OF GASSES.

DATE 1/25/05	Drawing Title							
	ENCLOSURE							
		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	
	Project Title	S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL	APPROVED BY	DATE	PURCHASE ORDER NUMBER
	DUPLEX BLOWER CONTROL PANEL	<div style="text-align: center;"> <b>COX</b>            Research and Technology, Inc.         </div>			P.O. Box 77808 Baton Rouge, LA 70809	DRAWING NUMBER CP-1960		
					Ph. (225)756-3271 Fax (225)755-1030	SHEET NUMBER 5		

## BILL OF MATERIAL

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	VYNCKIER	VJ1816HWPL	ENCLOSURE
2	1	VYNCKIER	MP1816A	BACKPLATE
3	2	ABB	A16-30-10-84	STARTER
4	2	ABB	TA25DU14	O.L. (10-14A)
5	2	SQUARE D	QOU225	CIRCUIT BREAKER 1,2
6	1	ABB	OT63E3	DISC. SWITCH
7	2	ACI	JR22P3M20B	H.O.A. SWITCH
8	2	ACI	JR22FR	RED PILOT LIGHTS
9	1	TIMEMARK	261DT120	ALTERNATING RELAY
10	1	SQUARE D	QOU120	CB3
11	1	GRASSLIN	FM/1 STUZH-L	TIMER
12				

	Drawing Title								
	BILL OF MATERIALS								
DATE 1/25/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN	DATE	BY		
	Project Title					PURCHASE ORDER NUMBER			
	DUPLEX BLOWER CONTROL PANEL	<div style="text-align: center;">COX  Research and Technology, Inc.</div>				P.O. Box 77808 Baton Rouge, LA 70809	DRAWING NUMBER CP-1960		
						Ph. (225)756-3271 Fax (225)755-1030	SHEET NUMBER 6		