
COX

Research and Technology, Inc.

DUPLEX PUMP CONTROL PANEL

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	1/60	
NO. MOTORS	2	
HP	10	
FLA	50	
TYPE OF PUMP	Self-Priming	(Self-Priming, Submersible)
MANUFACTURER		
CATALOG NUMBER		
CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	No	(Yes, No)
CAPACITOR WIRING FIGURE		
THERM. & SEAL FAIL WIRING FIGURE		


OPTIONS:

SEAL FAIL LIGHTS		(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN		(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER		
ELAPSED TIME METER		
PHASE MONITOR		
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION	X	


SOLD TO: Delta Process - Ruston, LA
TAG :

SHIP TO: Delta Process - Ruston, LA


Drawing Title	PANEL DESCRIPTION		REFERENCE DRAWING S/N	NO. C.C.	REVISION-LOCATION DRAWN BY CTR	ECN	DATE BY	APPROVED BY DATE
	Project Title	DUPLEX PUMP CONTROL PANEL			P.O. Box 77808 Baton Rouge, LA 70809			PURCHASE ORDER NUMBER
					Ph. (225)756-3271 Fax (225)756-1030			DRAWING NUMBER CP-1463
								SHEET NUMBER 1

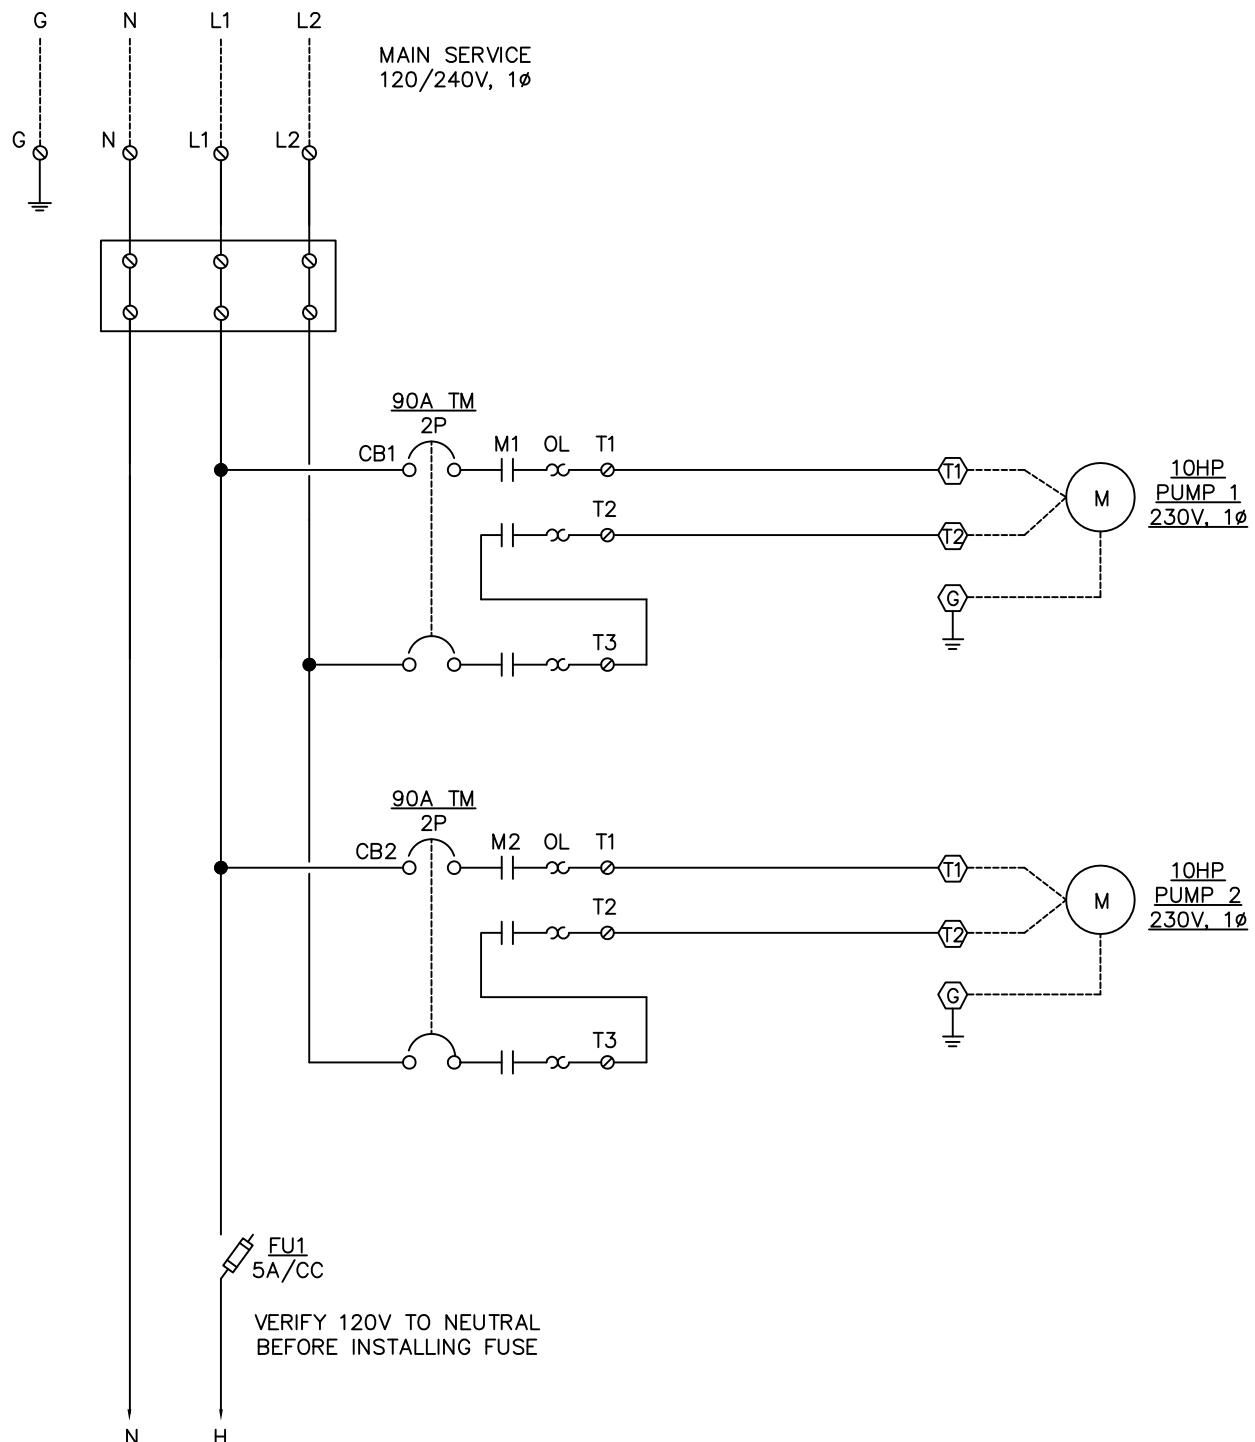

	Drawing Title POWER DIAGRAM						
ATE 8/20/02		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION DRAWN BY CTR	ECN	DATE	BY
	Project Title DUPLEX PUMP CONTROL PANEL		COX Research and Technology, Inc.	P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030	PURCHASE ORDER NUMBER DRAWING NUMBER CP-1463 SHEET NUMBER 2		

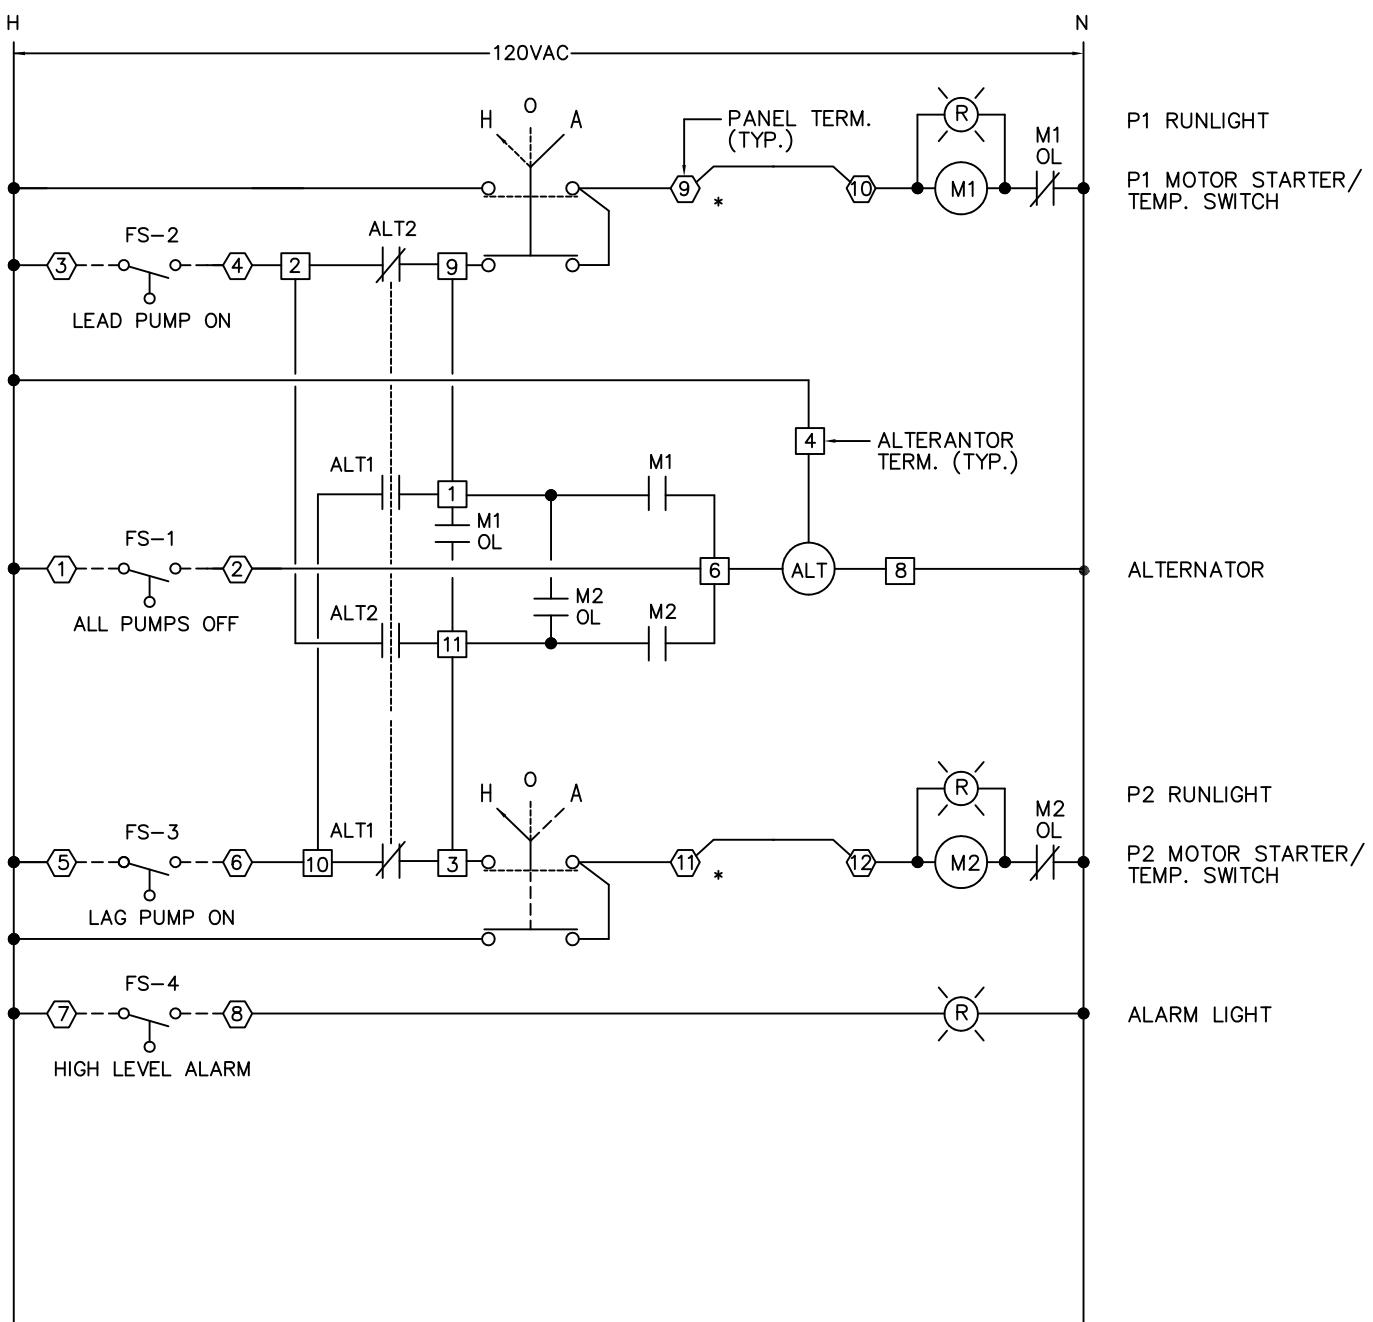

	Drawing Title CONTROL DIAGRAM				
		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION DRAWN BY CTR	ECN APPROVED BY DATE
DATE 8/20/02		Application Engineer R.C.			
	Project Title DUPLEX PUMP CONTROL PANEL		COX Research and Technology, Inc.	P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030	PURCHASE ORDER NUMBER DRAWING NUMBER CP-1463 SHEET NUMBER 3

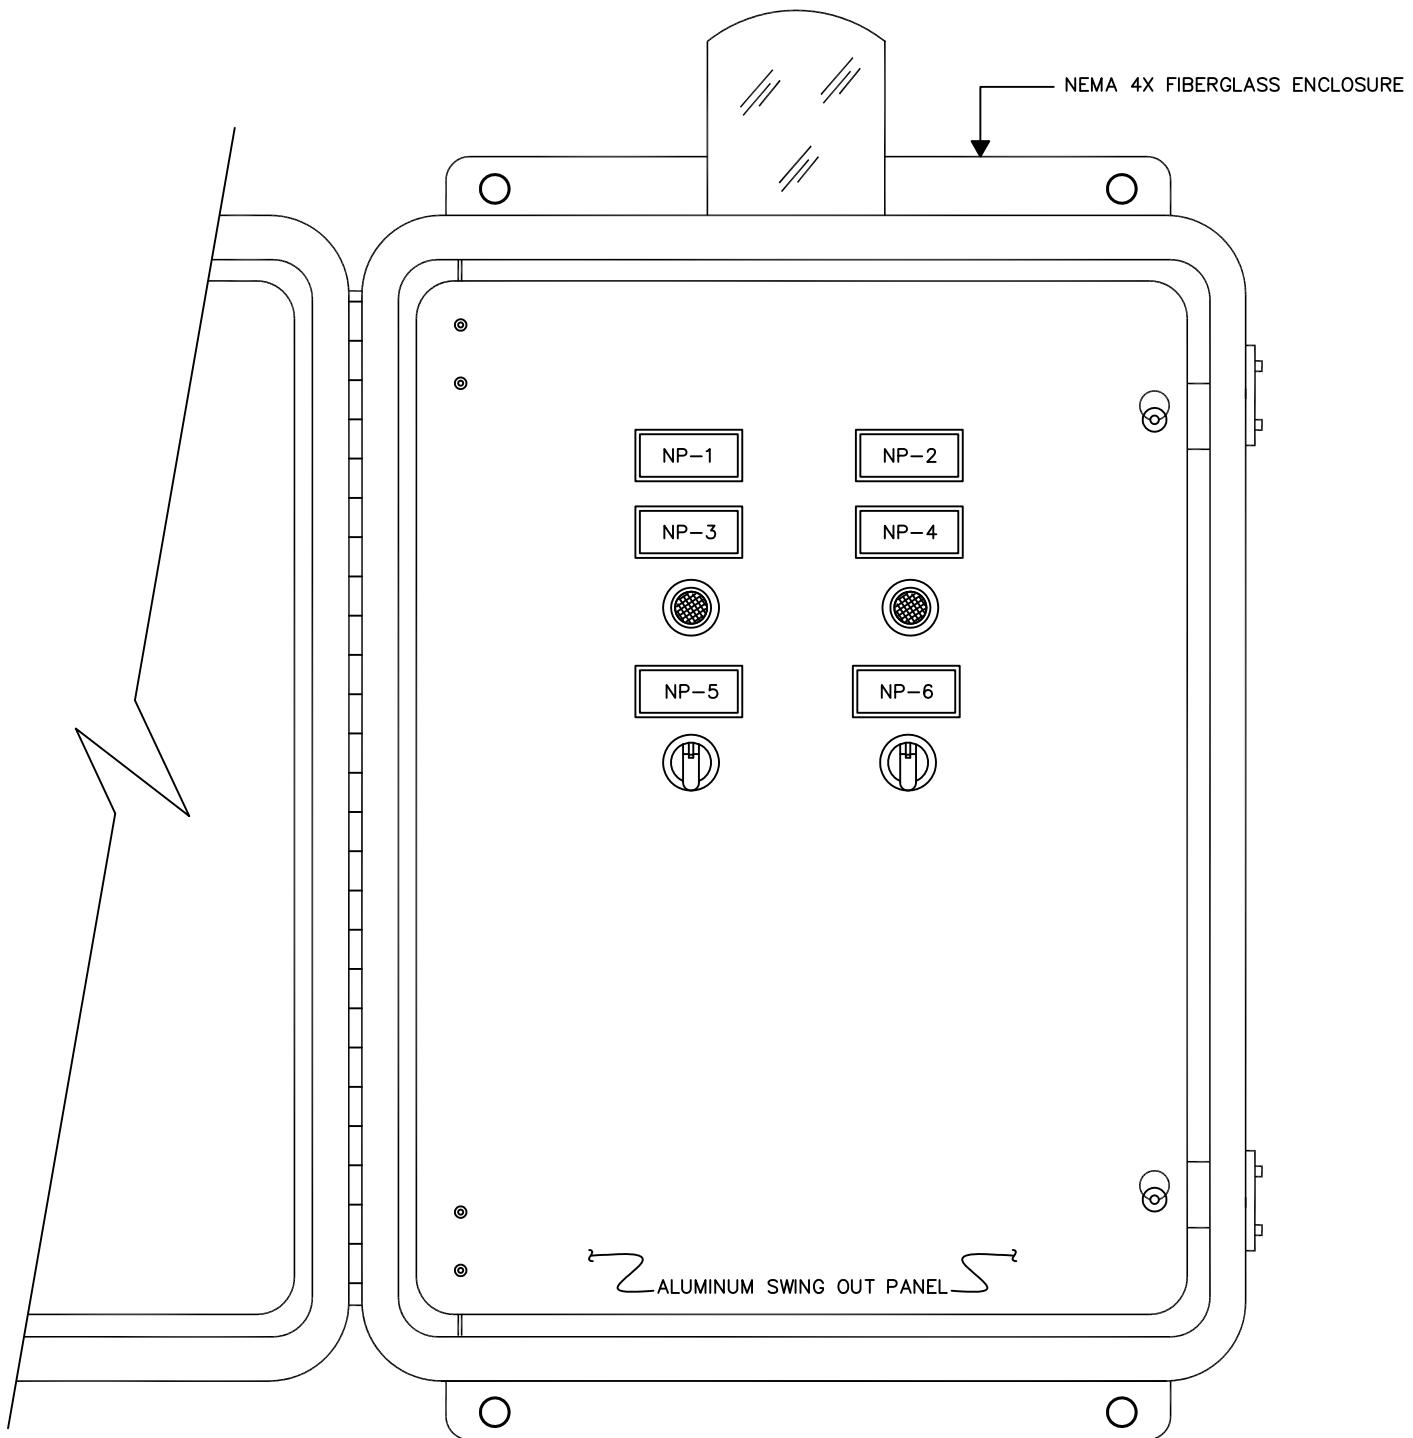

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA

NOTE:

SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

	Drawing Title					
	ENCLOSURE					
	REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
DATE 8/20/02	S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY CTR	APPROVED BY DATE	
	Project Title					
	DUPLEX PUMP CONTROL PANEL	<u>COX</u> Research and Technology, Inc.	P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER	
			Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1463	
					SHEET NUMBER	4

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	2	ABB	A63-30-11-84	MOTOR STARTER
3	2	ABB	TA75DU63	O.L. RELAY (45-63A)
4	2	SQUARE D	QOU290	CB1, CB2
5	1	TIMEMARK	261DT120	ALTERNATING RELAY
6	2	ACI	JR22FR	RED PILOT LIGHT
7	2	ACI	JR22P3M20B	HOA SWITCH
8	1	AC/DC	BL5-R-120	ALARM LIGHT
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title						
	BILL OF MATERIALS						
DATE 8/20/02	REFERENCE DRAWING		NO.	REVISION-LOCATION		ECN	DATE BY
	S/N	Sales Engineer	Application Engineer	DRAWN		APPROVED	
			C.C.	R.C.	BY CTR	BY DATE	
	Project Title		COX		P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER	
	DUPLEX PUMP CONTROL PANEL		Research and Technology, Inc.		Ph. (225)756-3271 Fax (225)756-1030	DRAWING NUMBER CP-1463	
						SHEET NUMBER 5	