

---

---

# COX

Research and Technology, Inc.

---

---

## PALMETTO PARK DUPLEX PUMP CONTROL PANEL

Cox Research and Technology, Inc.  
14697 S. Harrells Ferry Road  
Baton Rouge, LA. 70816  
(225) 756-3271 Fax (225) 755-1030

CP-1952

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	3/60	
NO. MOTORS	2	
HP	5	
FLA	19	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	BARNES	
CATALOG NUMBER	4SE 5094L	

CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	N/A	(Yes, No)
CAPACITOR WIRING FIGURE	N/A	
THERM. & SEAL FAIL WIRING FIGURE		


OPTIONS:


SEAL FAIL LIGHTS	X	(Submersible Only)
SEAL FAIL RELAYS	X	(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN		(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER	X	
ELAPSED TIME METER	X	
PHASE MONITOR	X	
NEMA RATED STARTERS		
GROUND FAULT RECPT.	X	
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		

SOLD TO: Delta Process - Bossier City, LA  
TAG : Palmetto Park

SHIP TO: Delta Process - Ruston, LA


	Drawing Title						
	PANEL DESCRIPTION						
DATE 11/11/04		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809  Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER  DRAWING NUMBER CP-1952 SHEET NUMBER 1
	DUPLEX PUMP CONTROL PANEL						

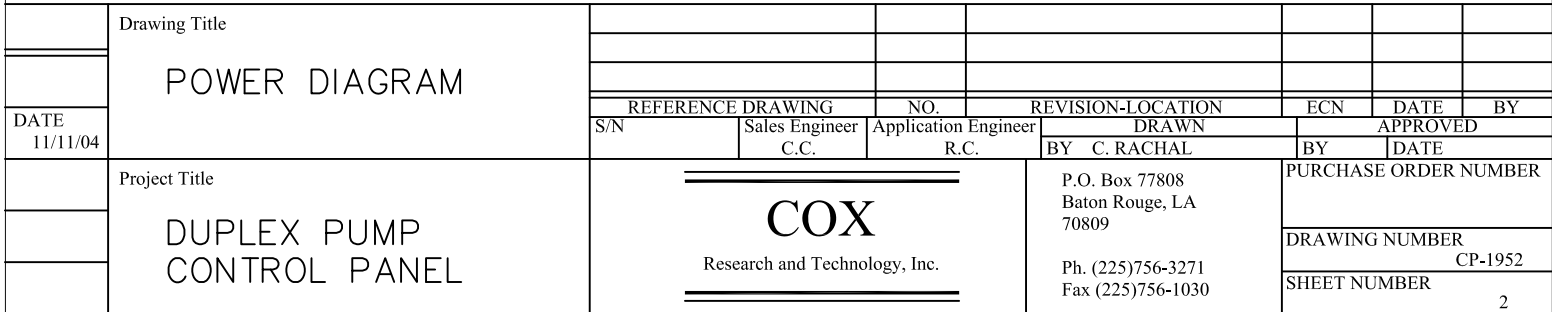

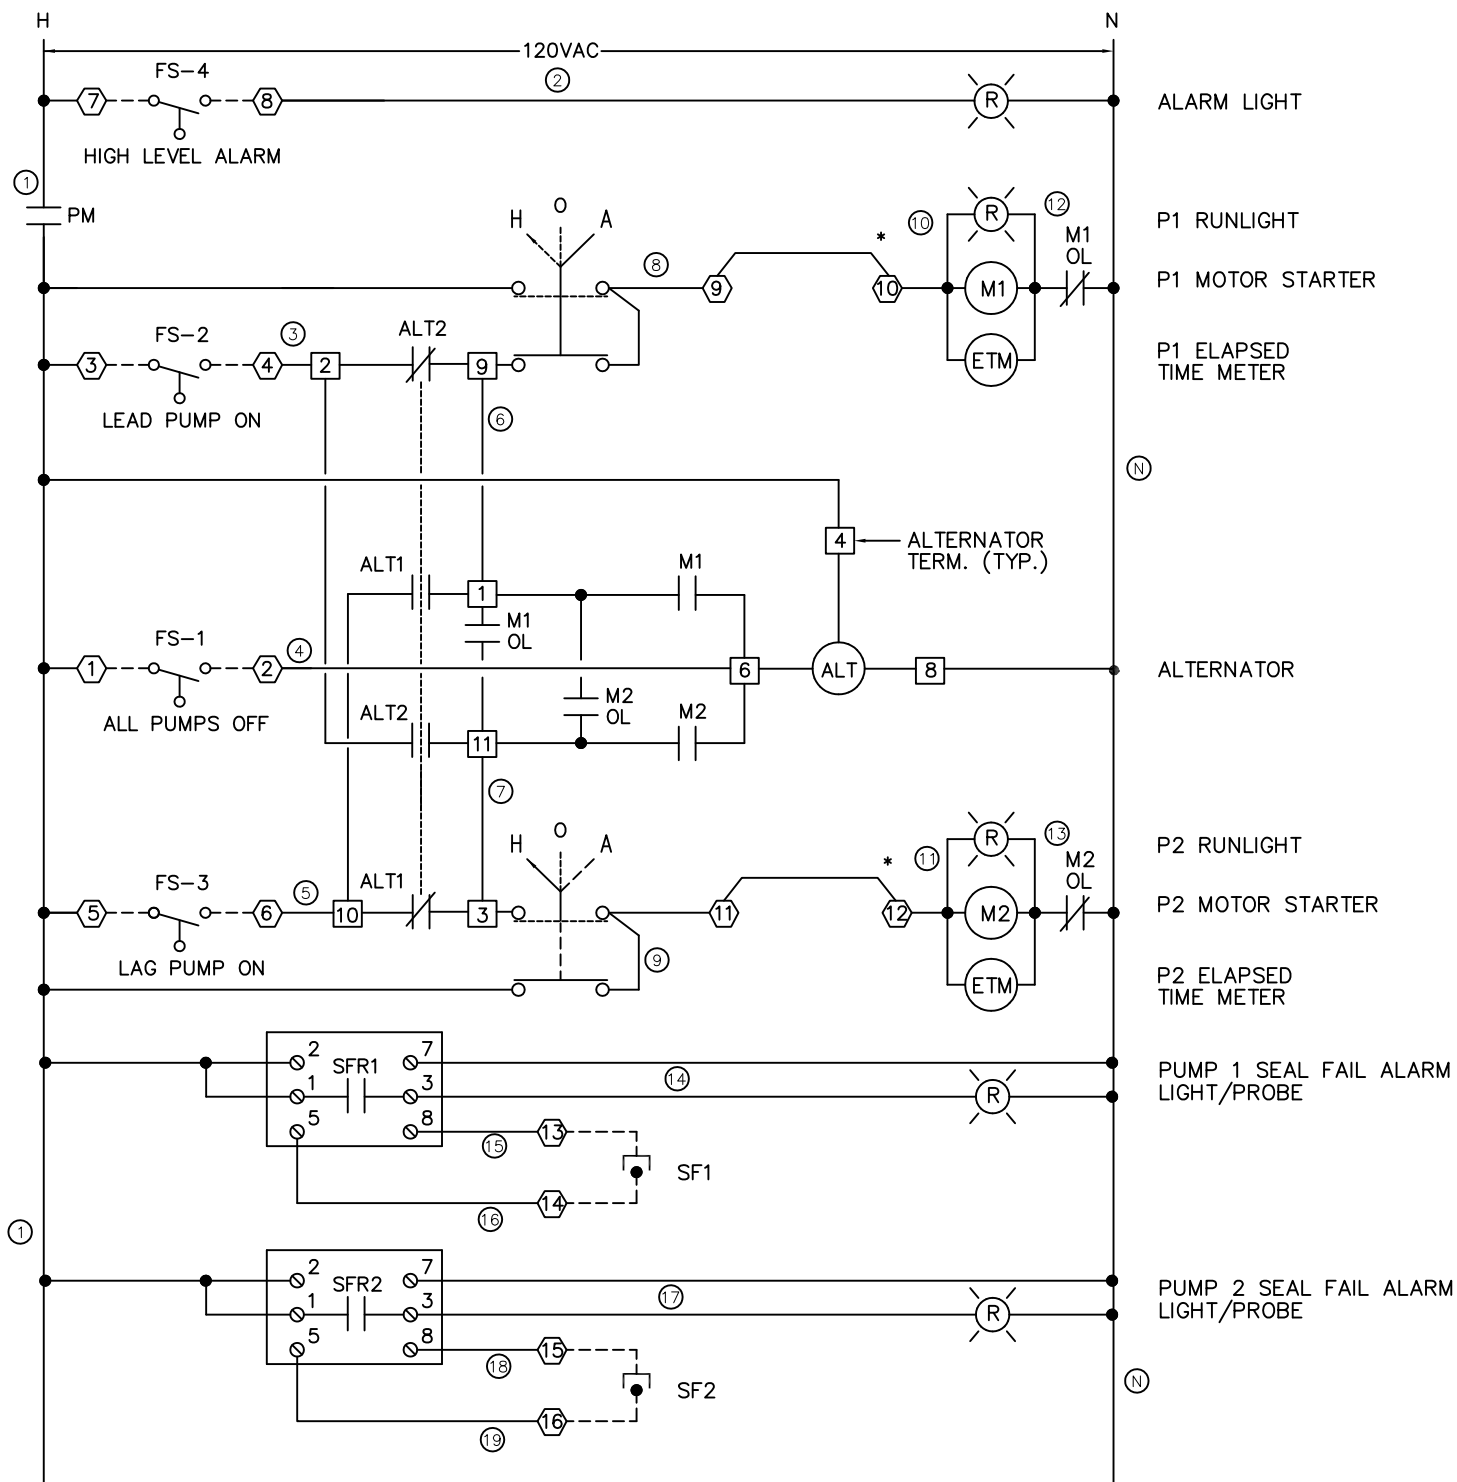

\* REMOVE JUMPERS AND INSTALL LOCKOUT DEVICES IF REQUIRED

	Drawing Title    CONTROL DIAGRAM							
DATE 11/11/04			REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN BY	DATE DATE
	Project Title   DUPLEX PUMP CONTROL PANEL		<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809  Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER
DRAWING NUMBER CP-1952								
SHEET NUMBER 3								

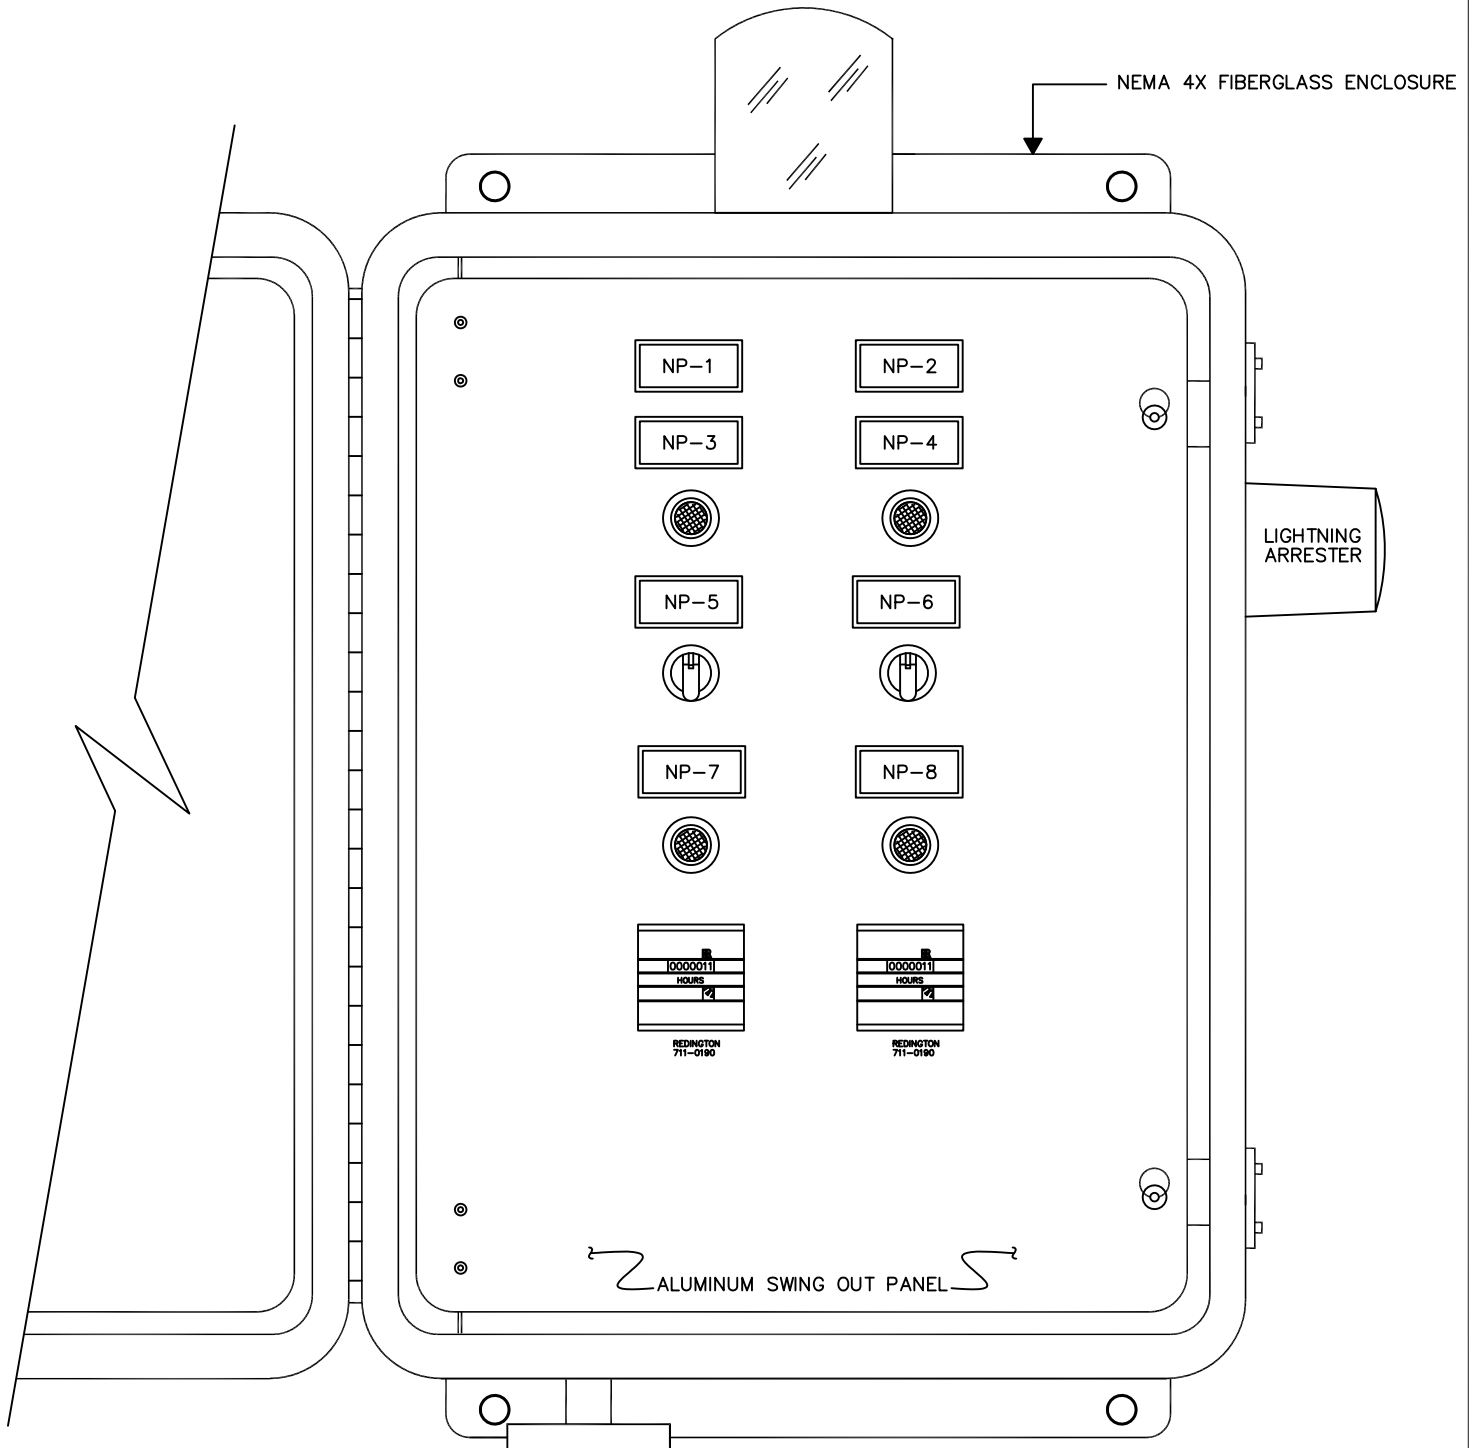

**NOTE:**  
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.  
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE  
PANEL TO PREVENT ENTRY OF GASSES.

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL

DATE 11/11/04	Drawing Title								
	ENCLOSURE								
	Project Title								
	DUPLEX PUMP CONTROL PANEL								
		REFERENCE DRAWING	NO.	REVISION-LOCATION		ECN	DATE	BY	
		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL		APPROVED BY		DATE
						PURCHASE ORDER NUMBER			
						DRAWING NUMBER CP-1952			
						SHEET NUMBER			

**COX**

Research and Technology, Inc.

P.O. Box 77808  
Baton Rouge, LA  
70809

Ph. (225)756-3271  
Fax (225)756-1030

# BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	1	ABB	OT63E3	MAIN DISC. SWITCH
3	2	ABB	A26-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU25	O.L. (18-25A)
5	2	SQUARE D	QOU340	CB1, CB2
6	1	SQUARE D	QOU115	CB3
7	1	TIMEMARK	261DT120	ALTERNATING RELAY
8	4	ACI	JR22FR	RED PILOT LIGHT
9	2	ACI	JR22P3M20B	HOA SWITCH
10	1	AC/DC	BL5-R-120	ALARM LIGHT
11	1	MARATHON	1323580	DISTRIBUTION BLOCK
12	2	REDINGTON	711-0190	ELAPSED TIME METER
13	2	SSAC	LLC54AA	SEAL FAIL RELAY
14	1	DELTA	LA603	LIGHTNING ARRESTER
15	1	STOCK		GFI
16	1	SSAC	PLMU-11	PHASE MONITOR
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title							
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>							
DATE 11/11/04		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
		<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 100px;"> <h3 style="margin: 0;">COX</h3> <p style="margin: 0; font-size: small;">Research and Technology, Inc.</p> </div>		<p style="margin: 0; font-size: small;">P.O. Box 77808 Baton Rouge, LA 70809</p> <p style="margin: 0; font-size: small;">Ph. (225)756-3271 Fax (225)756-1030</p>		<p style="margin: 0; font-size: small;">PURCHASE ORDER NUMBER</p> <hr/> <p style="margin: 0; font-size: small;">DRAWING NUMBER CP-1952</p> <hr/> <p style="margin: 0; font-size: small;">SHEET NUMBER</p>		
	Project Title	<h2 style="margin: 0;">DUPLEX PUMP CONTROL PANEL</h2>						
					5			