

COX

Research and Technology, Inc.


CONTROL PANEL

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-1512FR
(FIELD REVISION)

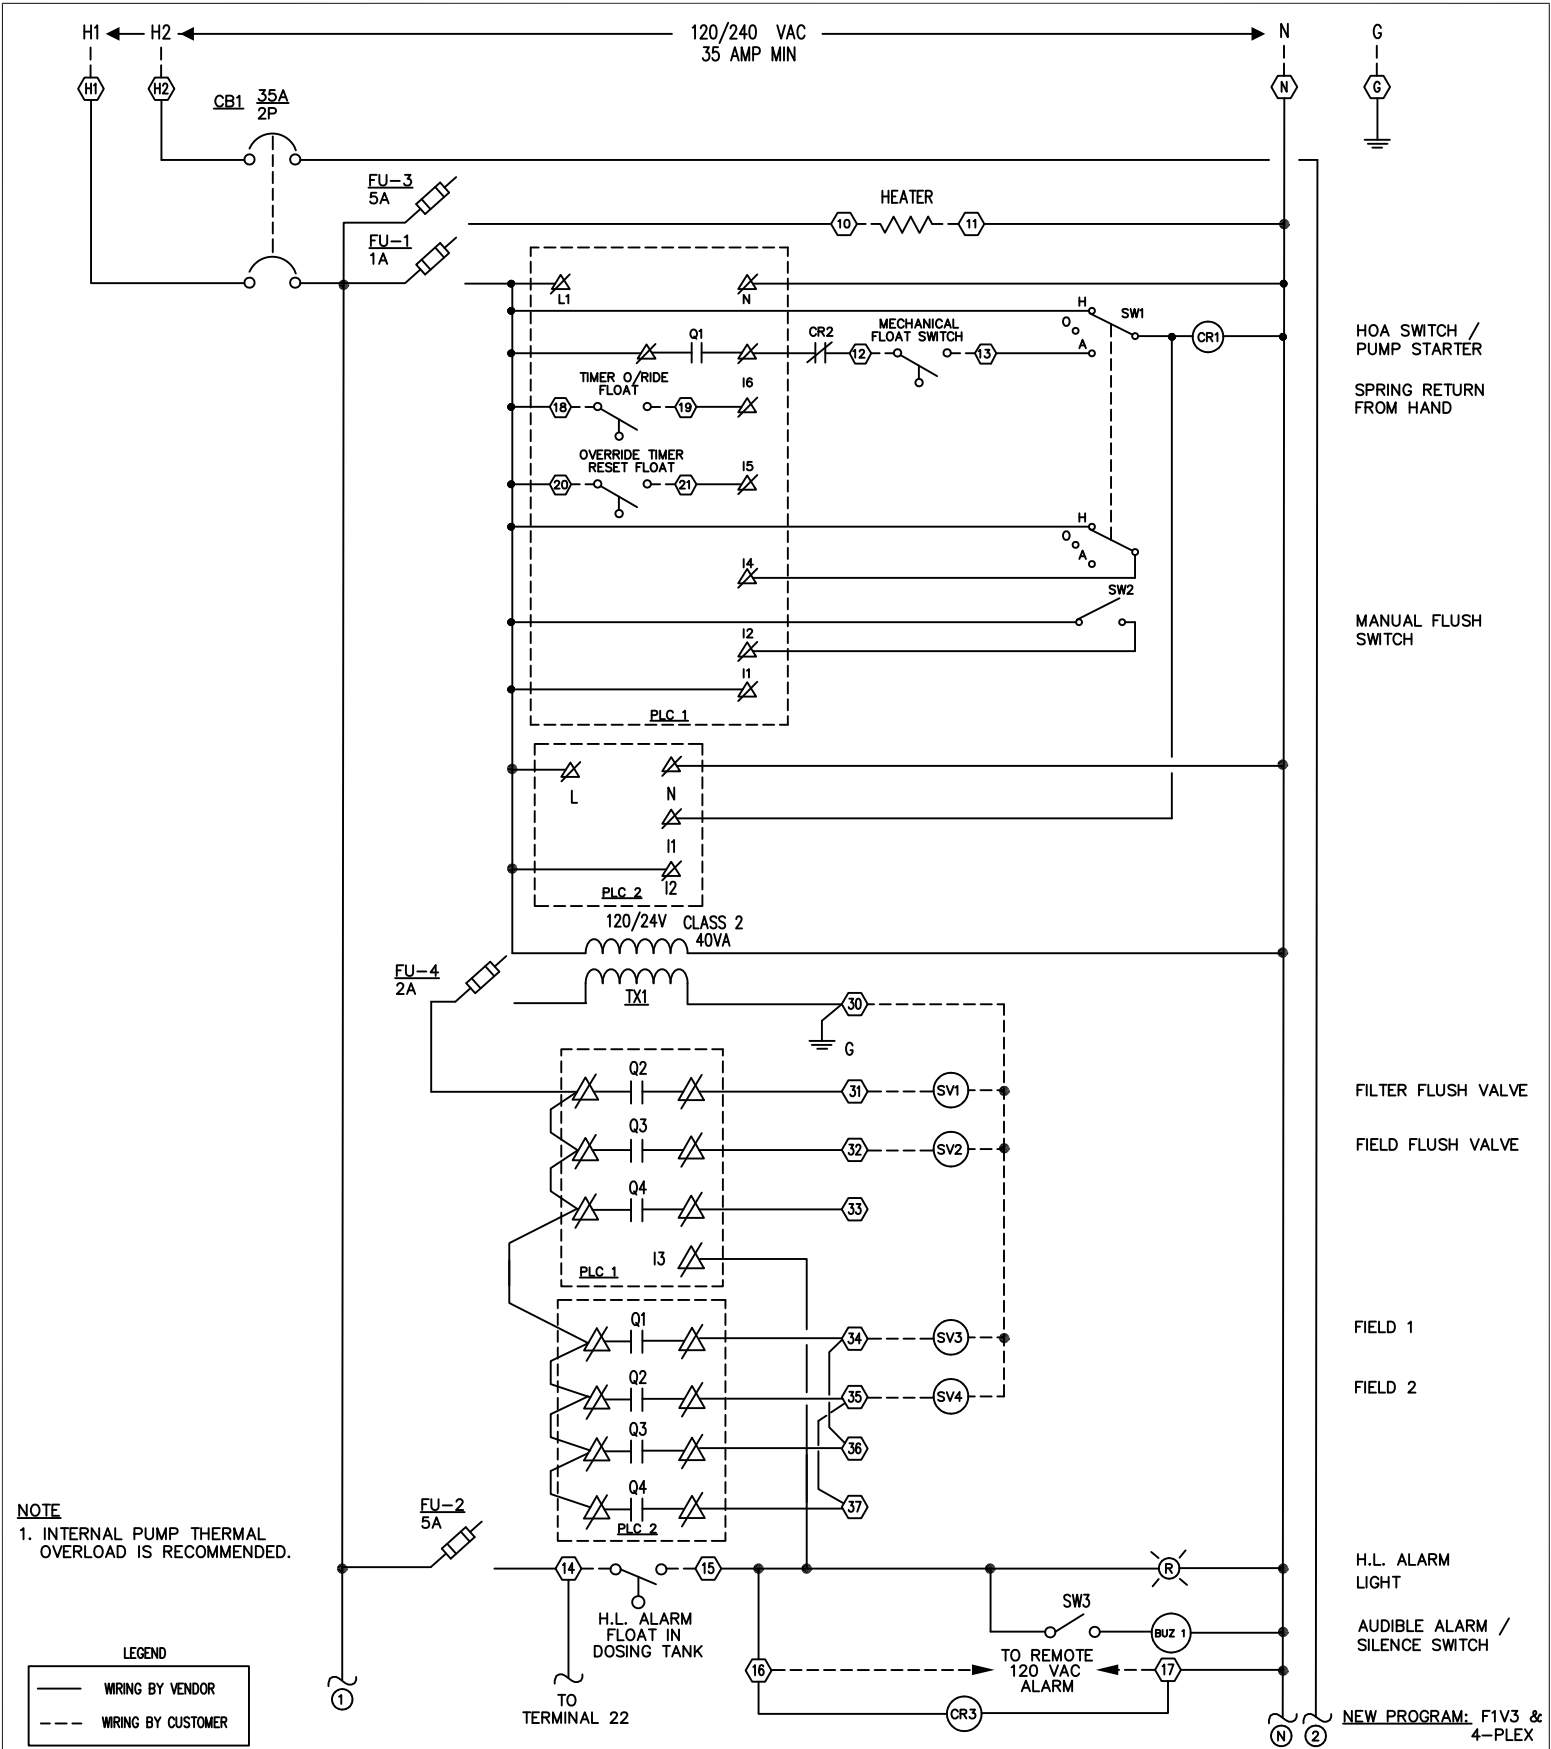


Drawing Title		NO. 1		REVISION-LOCATION		ECN	DATE	BY
DATE 4/10/03		Sales Engineer C.C.		Application Engineer R.C.		DRAWN BY C. RACHAL		APPROVED
Project Title		PURCHASE ORDER NUMBER		DRAWING NUMBER		CP-1512R		SHEET NUMBER
CONTROL PANEL		COX Research and Technology, Inc.		P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030		1		

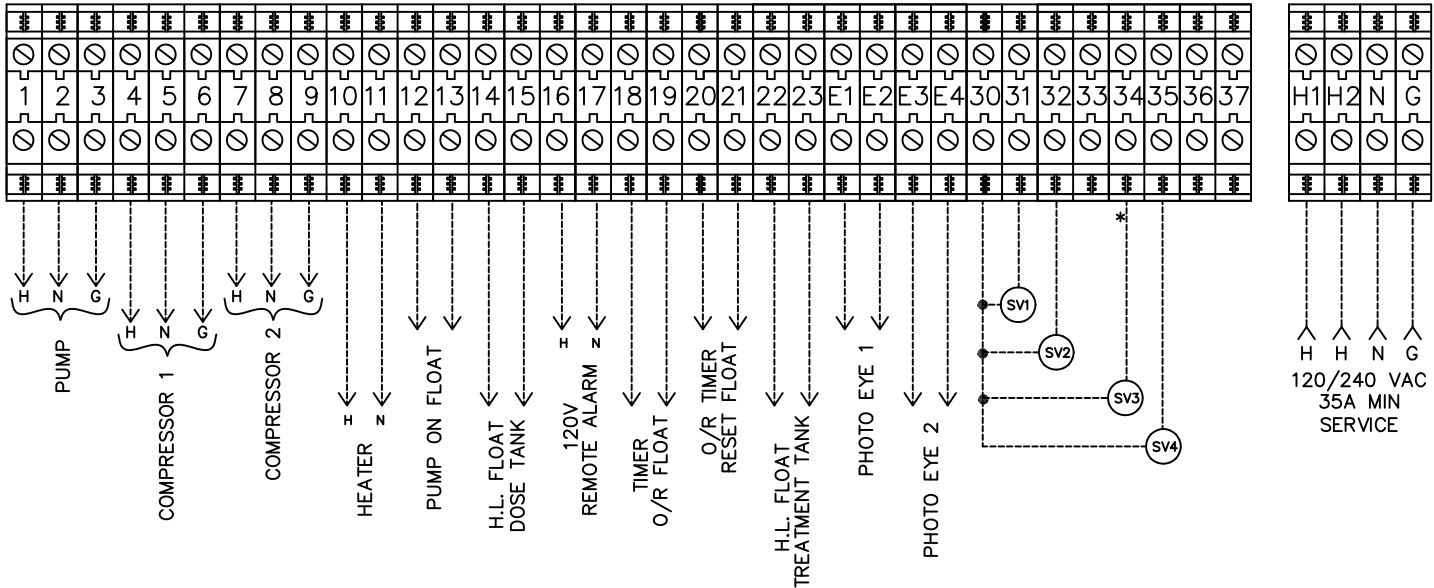



*** TO REMOVE A FIELD VALVE FROM SERVICE:**

- 1) If SV3 needs to be taken out service, disconnect SV3 wire from terminal 34.
- 2) Place jumper wire between terminals 34 and 35.
- 3) Make sure that the SV4 wire in terminal 35 remains along with the jumper wire.

FACTORY WIRING

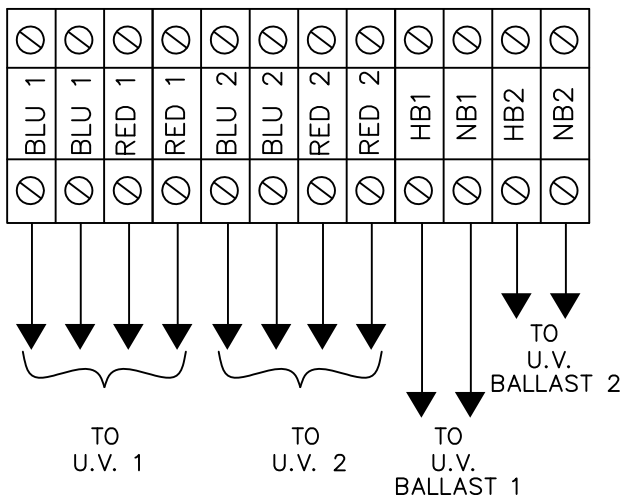

Drawing Title									
DATE 4/10/03		Project Title CONTROL PANEL		<div style="text-align: center;"> COX Research and Technology, Inc. </div>		P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER DRAWING NUMBER CP-1512R SHEET NUMBER 3	
				1		4/10/03		CTR	
REFERENCE DRAWING		NO.		REVISION-LOCATION		ECN		DATE	
S/N		Sales Engineer C.C.		Application Engineer R.C.		BY C. RACHAL		APPROVED	
						BY		DATE	

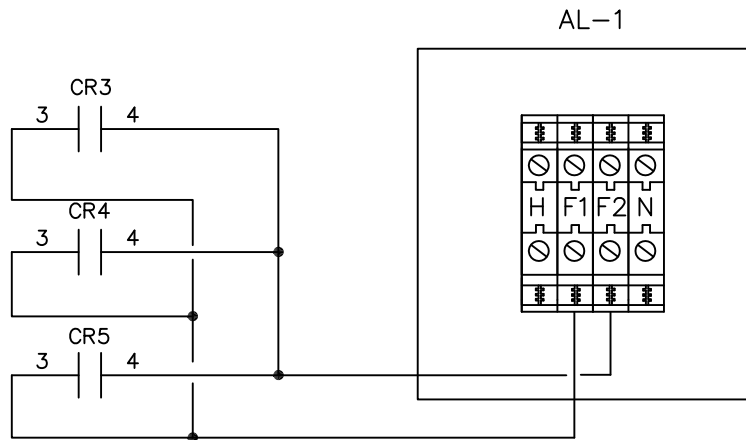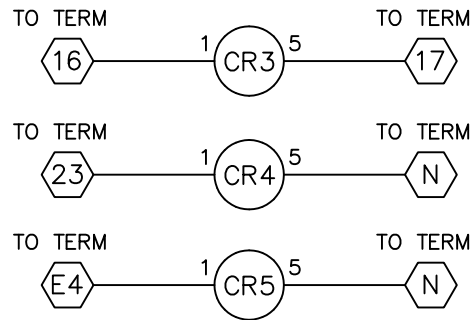

	Drawing Title							
			1				4/10/03	CTR
		REFERENCE DRAWING		NO.	REVISION-LOCATION		ECN	DATE
DATE 4/10/03		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL		APPROVED BY DATE	
	Project Title	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER	
							DRAWING NUMBER CP-1512R	
							SHEET NUMBER	
							4	
	CONTROL PANEL							