

LEGEND

— WIRING BY VENDOR
- - - - - WIRING BY CUSTOMER

NOTE

1. INTERNAL PUMP THERMAL OVERLOAD IS RECOMMENDED.
2. PLC WILL INDICATE NUMBER OF HIGH LEVEL ALARMS AND NUMBER OF TIMES A PUMP IS TURNED TO HAND POSITION.

PROGRAM
PULSE 6 FIELDS W/O
BACKWASH VALVE r1



Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

Schematic Diagram Filter System


DWN BY:
C.RACHAL


DATE:
1/04/06

SCALE:
N.T.S.

DWG. NO.:
1 OF 6

JOB NO.:
CP-2257

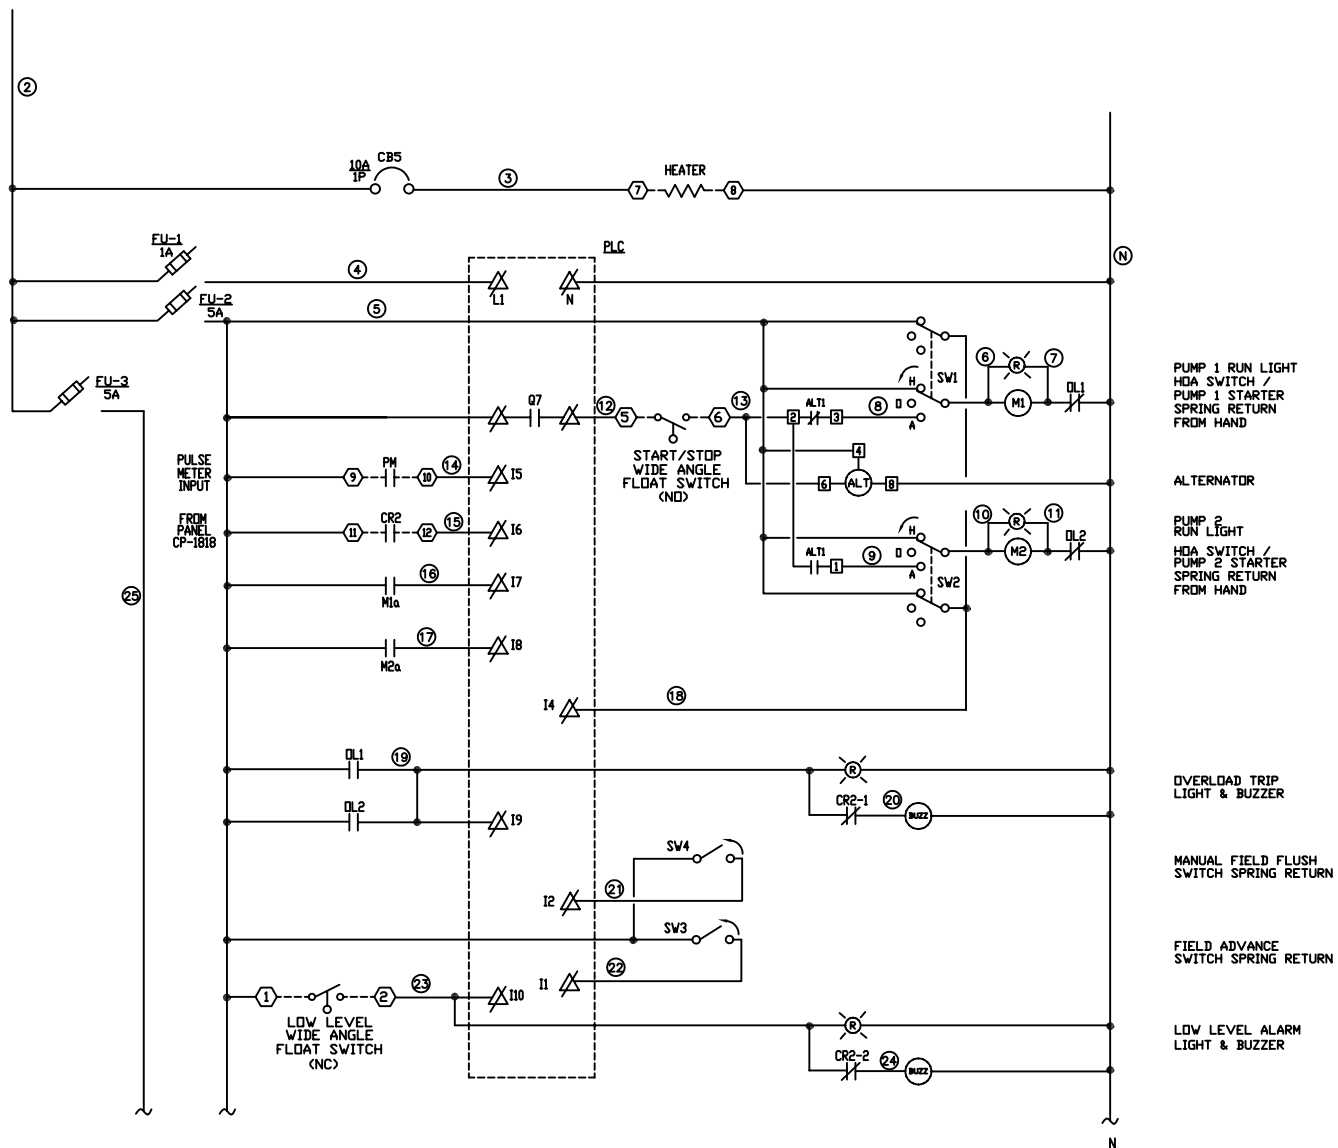

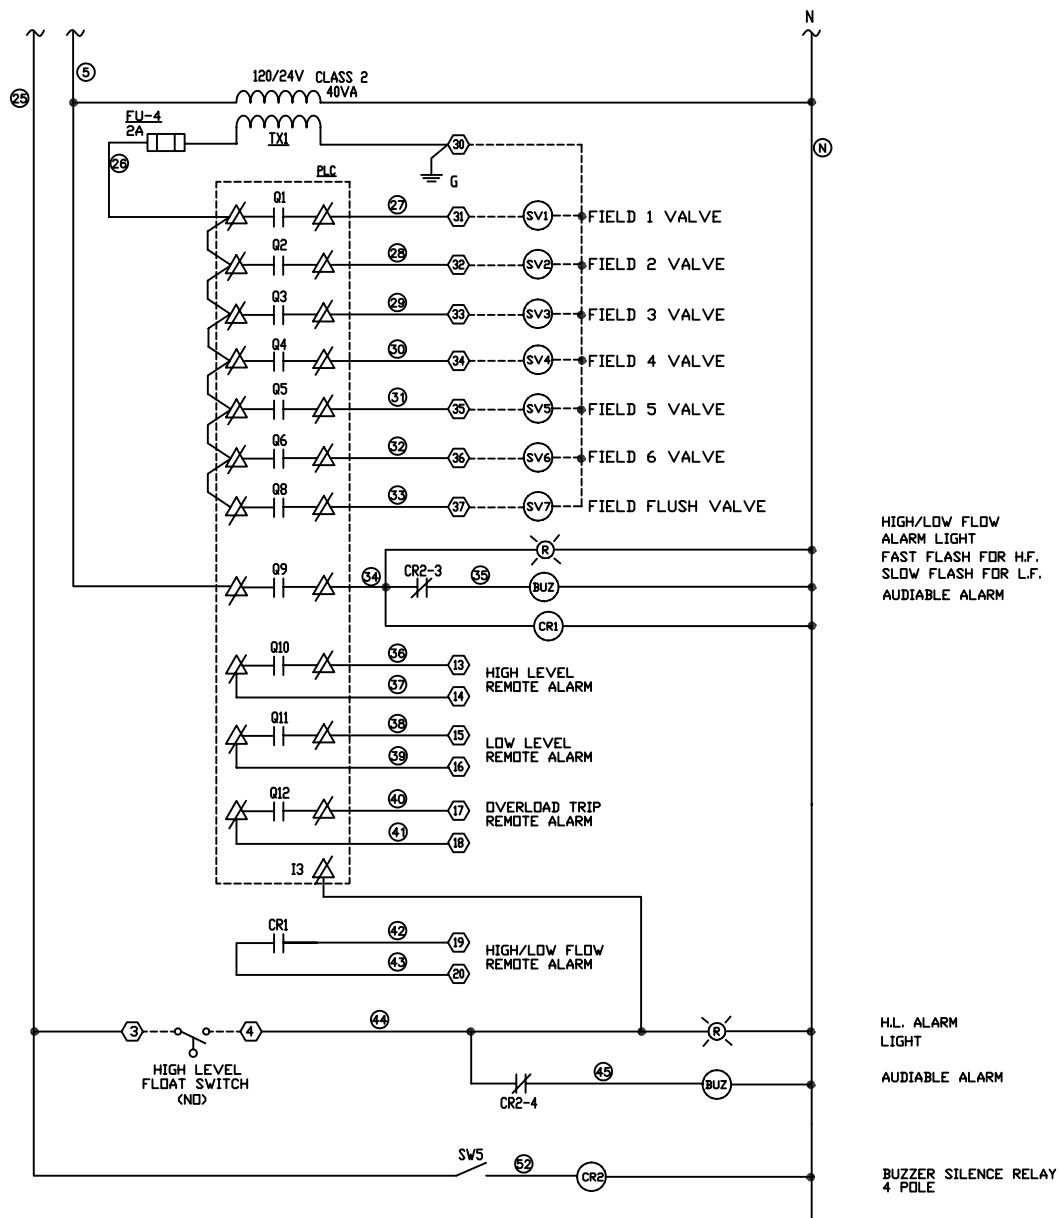

LEGEND

— WIRING BY VENDOR
 ---- WIRING BY CUSTOMER

NOTE

1. INTERNAL PUMP THERMAL OVERLOAD IS RECOMMENDED.
2. PLC WILL INDICATE NUMBER OF HIGH LEVEL ALARMS AND NUMBER OF TIMES A PUMP IS TURNED TO HAND POSITION.

PROGRAM
 PULSE 6 FIELDS W/O
 BACKWASH VALVE r1



Delta Environmental Products, Inc.
 P.O. Box 969 Denham Springs, LA 70727

Schematic Diagram Filter System

DWN BY:
 C.RACHAL

DATE:
 1/04/06

SCALE:
 N.T.S.

DWG. NO.:
 3 OF 6

JOB NO.:
 CP-2257