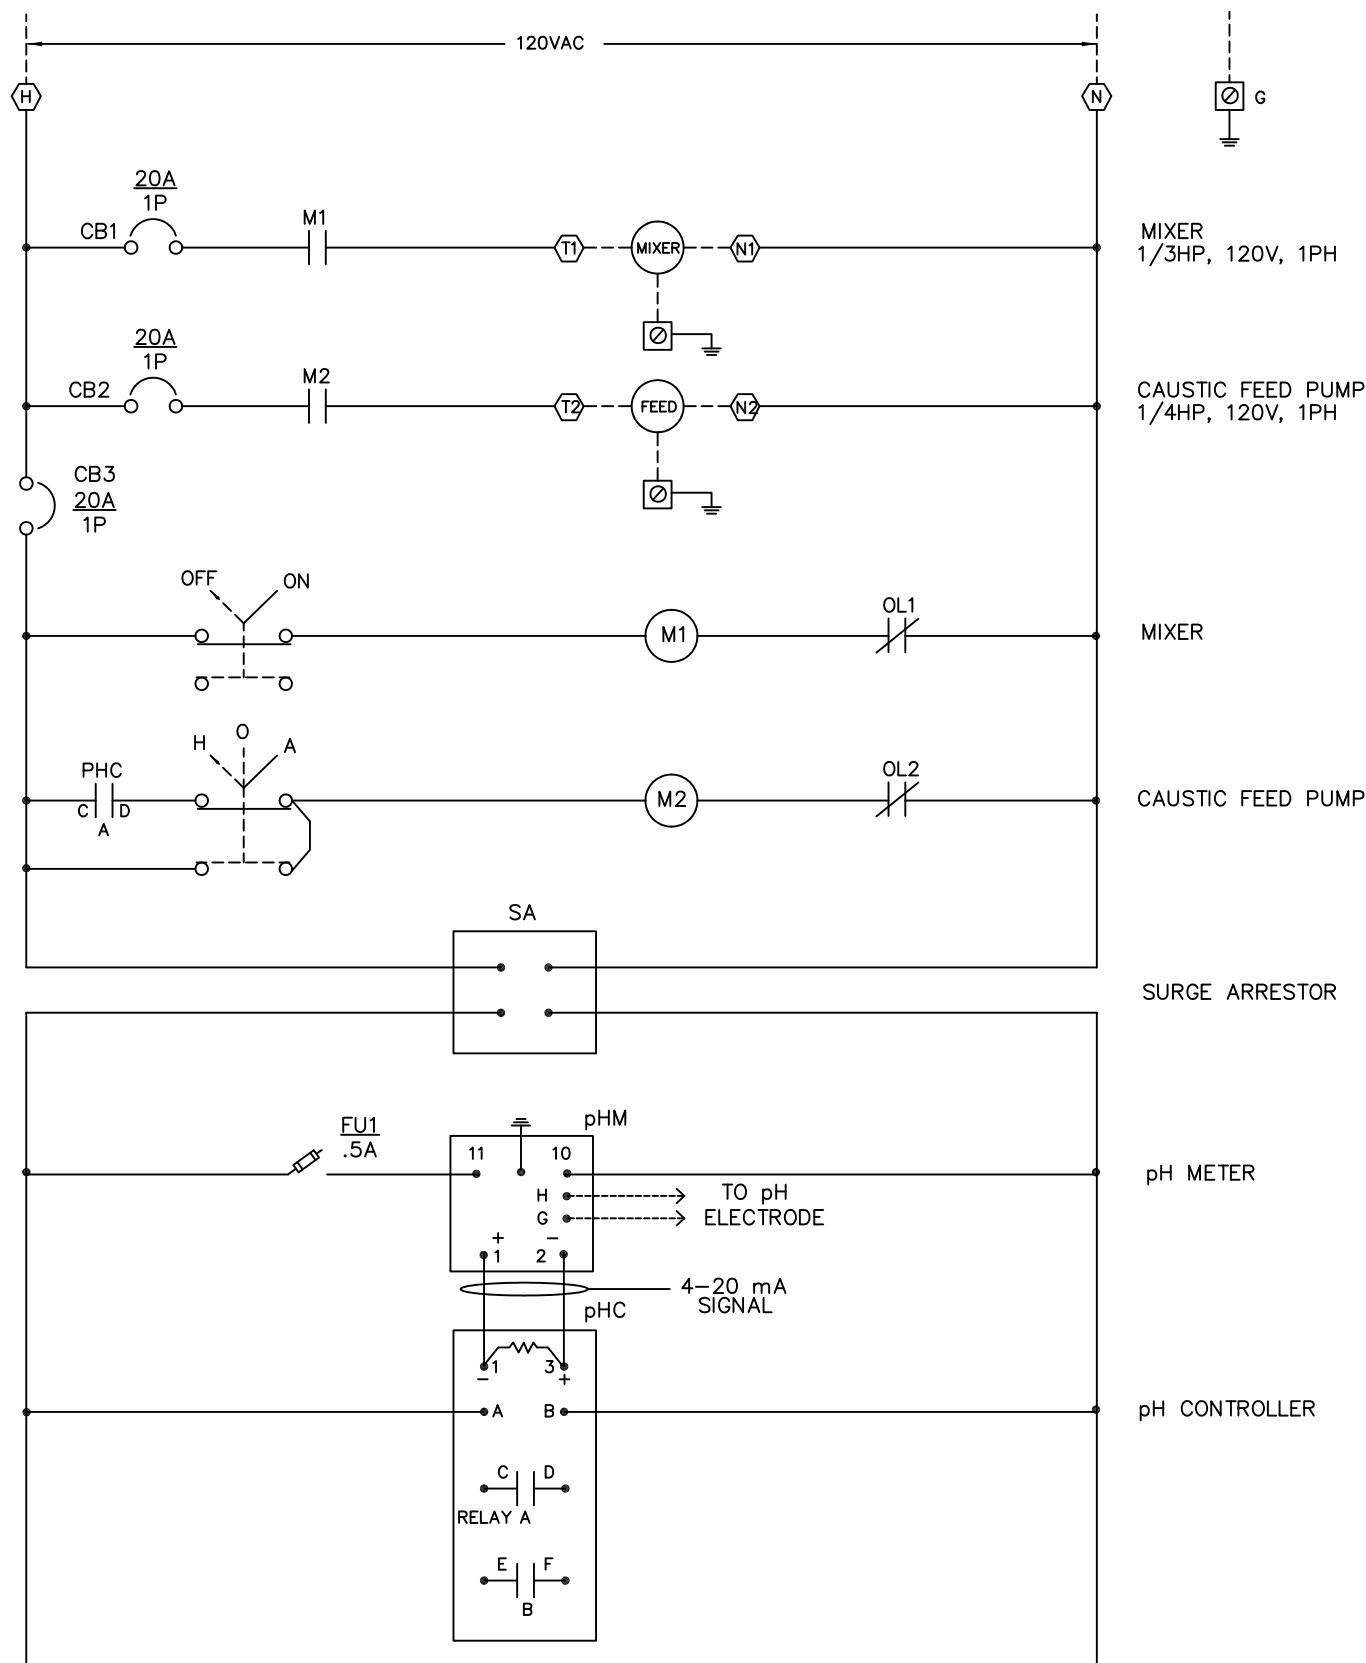

COX

Research and Technology, Inc.

pH CONTROL PANEL

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP1487



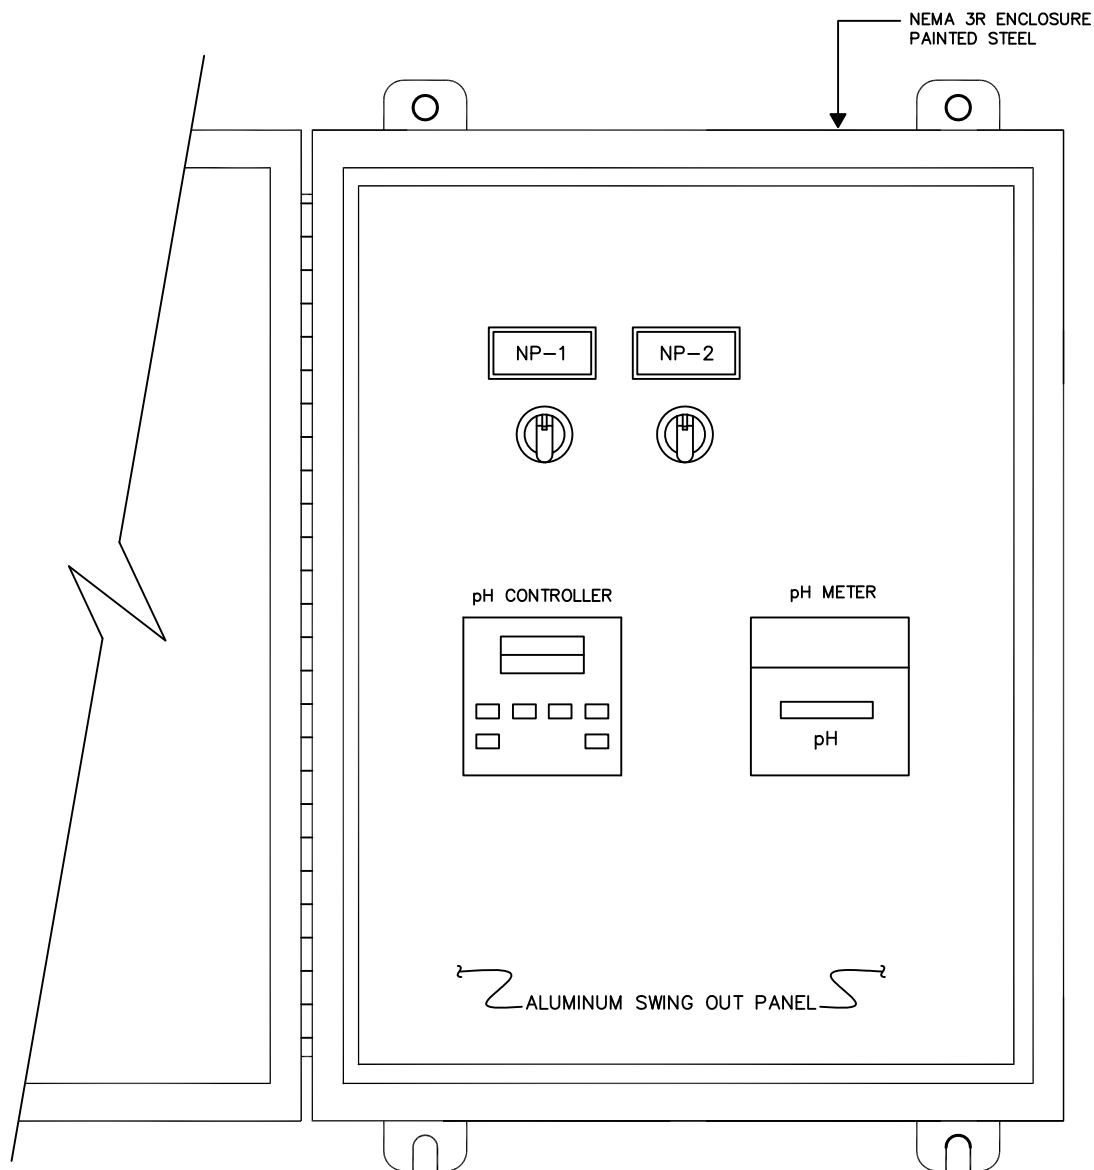
	Drawing Title							
	CONTROL DIAGRAM							
DATE	11/07/02	REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY	CTR	APPROVED	
	Project Title							PURCHASE ORDER NUMBER
	pH CONTROL PANEL							DRAWING NUMBER CP-1487
								SHEET NUMBER 1

COX

Research and Technology, Inc.

P.O. Box 77808
Baton Rouge, LA
70809

Ph. (225)756-3271
Fax (225)756-1030



VIEW OF SWING OUT PANEL

NOTE:
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

NAMEPLATE SCHEDULE

NP-1 MIXER/OFF ON
NP-2 CAUSTIC FEED/M-O-A

DATE 11/07/02	Drawing Title							
	ENCLOSURE							
		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	
	Project Title	S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY CTR	APPROVED BY	DATE	PURCHASE ORDER NUMBER
	pH CONTROL PANEL	<div> <div>COX</div> <div>Research and Technology, Inc.</div> </div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030	DRAWING NUMBER CP-1487 SHEET NUMBER 2		

BILL OF MATERIAL

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	EBE	242012REPL	ENCLOSURE
2	1	EBE	A2420P	BACKPLATE
3	1	EBE	A2420SP	DEAD FRONT
4	3	SQUARE D	QOU120	CB1,2,3
5	2	ABB	A16-30-10-84	MS1,2
6	1	ABB	TA25DU8.5	O.L.1 (6.0-8.5A)
7	1	ABB	TA25DU6.5	O.L.2 (4.5-6.5A)
8	1	ACI	JR22PSM11B	MIXER SWITCH
9	1	ACI	JR22PSM20B	CAUSTIC HOA
10	1	AMBER IND	AI-102	SURGE ARRESTOR

	Drawing Title							
	BILL OF MATERIALS							
DATE 11/07/02		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN	DATE	BY	
	Project Title	<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 150px;"> COX Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER DRAWING NUMBER CP-1487 SHEET NUMBER 3	
	pH CONTROL PANEL							