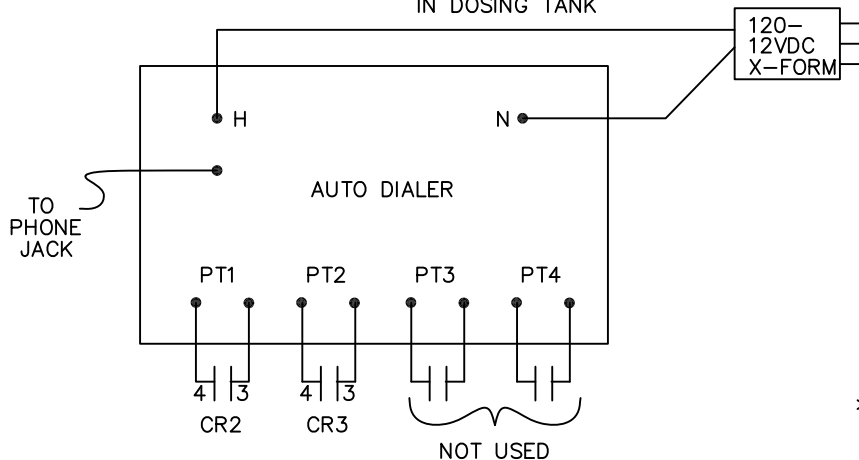
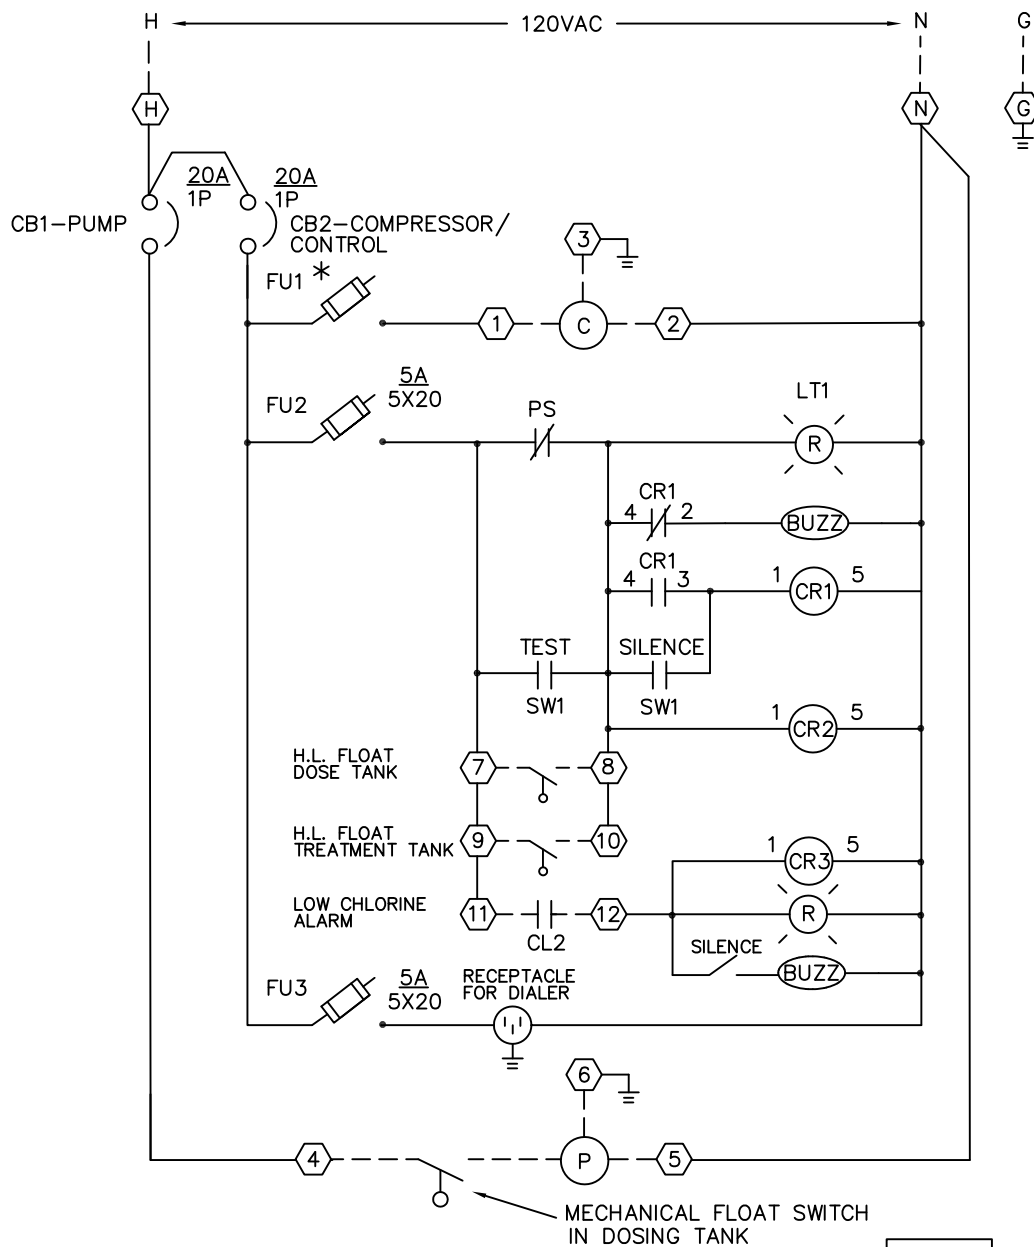

COX

Research and Technology, Inc.

COMBINATION PUMP/COMPRESSOR W/CL2 ALARM & AUTO DIALER

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

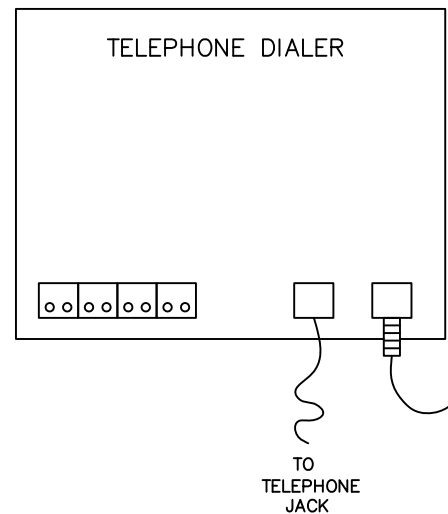
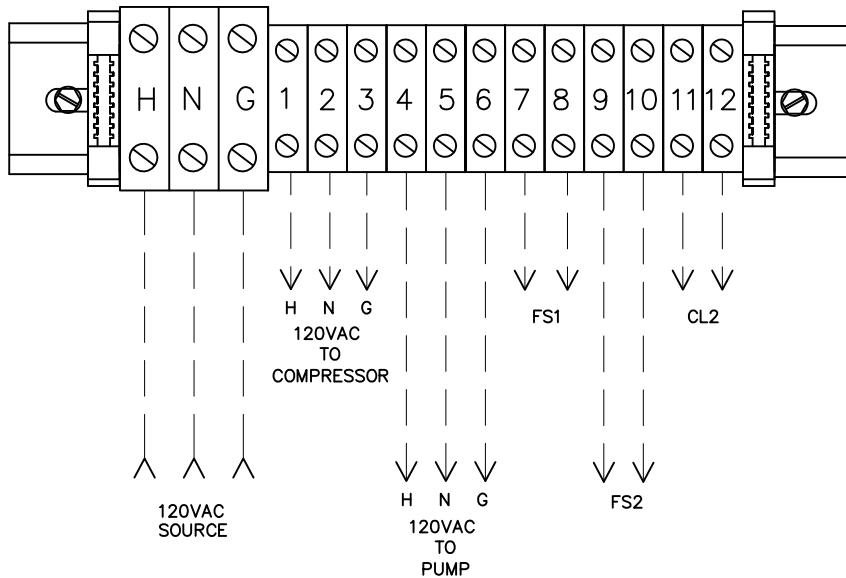

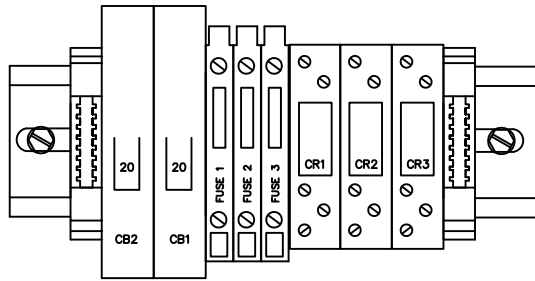
CP-1537



PUMP INTERNAL THERMAL OVERLOAD IS REQ'D

* SIZE VARIES WITH COMPRESSOR SIZE PER NATIONAL ELECTRICAL CODE

	Drawing Title								
	POWER DIAGRAM								
DATE	3/27/03	REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	APPROVED	
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	BY	DATE		
	Project Title	COX			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER		
	COMBINATION PUMP/COMPRESSOR W/CL2 ALARM & AUTO DIALER	Research and Technology, Inc.			Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1537		
							SHEET NUMBER 1		



FS-1 HIGH LEVEL FLOAT DOSE TANK
 FS-2 HIGH LEVEL FLOAT TREATMENT TANK
 CL-2 LOW CHLORINE ALARM

	Drawing Title								
	POWER DIAGRAM								
DATE	3/27/03	REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	APPROVED	
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	BY	DATE		
	Project Title	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER		
	COMBINATION PUMP/COMPRESSOR W/CL2 ALARM & AUTO DIALER				Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1537		
							SHEET NUMBER 2		