
COX

Research and Technology, Inc.

DUPLEX PUMP
CONTROL PANEL
WILLOW PLAZA

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-1702

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	3/60	
NO. MOTORS	2	
HP	2	
FLA	9.5	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	Barnes	
CATALOG NUMBER		
CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	No	(Yes, No)
CAPACITOR WIRING FIGURE	N/A	
THERM. & SEAL FAIL WIRING FIGURE		


OPTIONS:


SEAL FAIL LIGHTS	X	(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN		(Self-Primer, Submersible)
ALARM HORN	X (INGRAM)	
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER	X	
ELAPSED TIME METER	X	
PHASE MONITOR	X	
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		

SOLD TO: Delta Process - Bossier City, LA

TAG : WILLOW PLAZA

SHIP TO: Delta Process - Shreveport, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 12/03/03		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div style="text-align: center;">  COX Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1702
							SHEET NUMBER 1

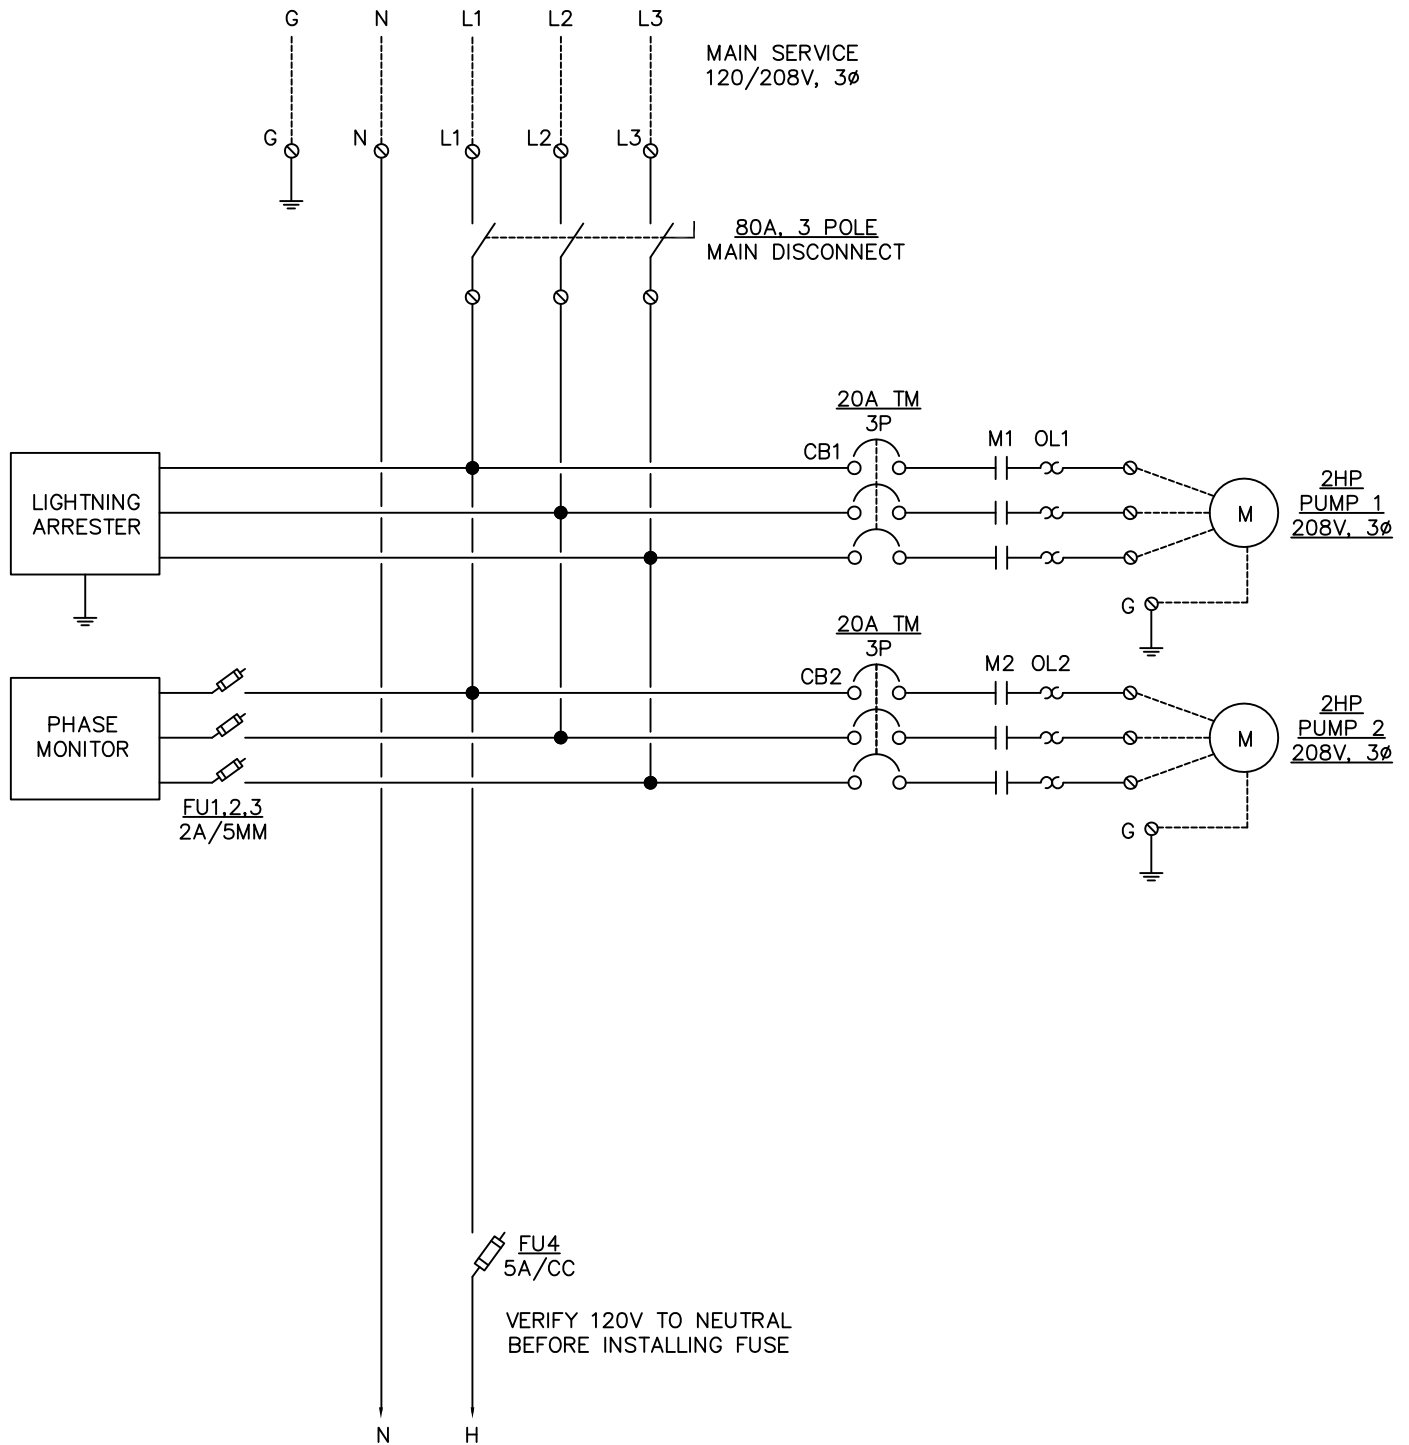

	Drawing Title 	
--	---	--


COX

Research and Technology, Inc.

P.O. Box 77808
Baton Rouge, LA
70809

Ph. (225)756-3271
Fax (225)756-1030

3

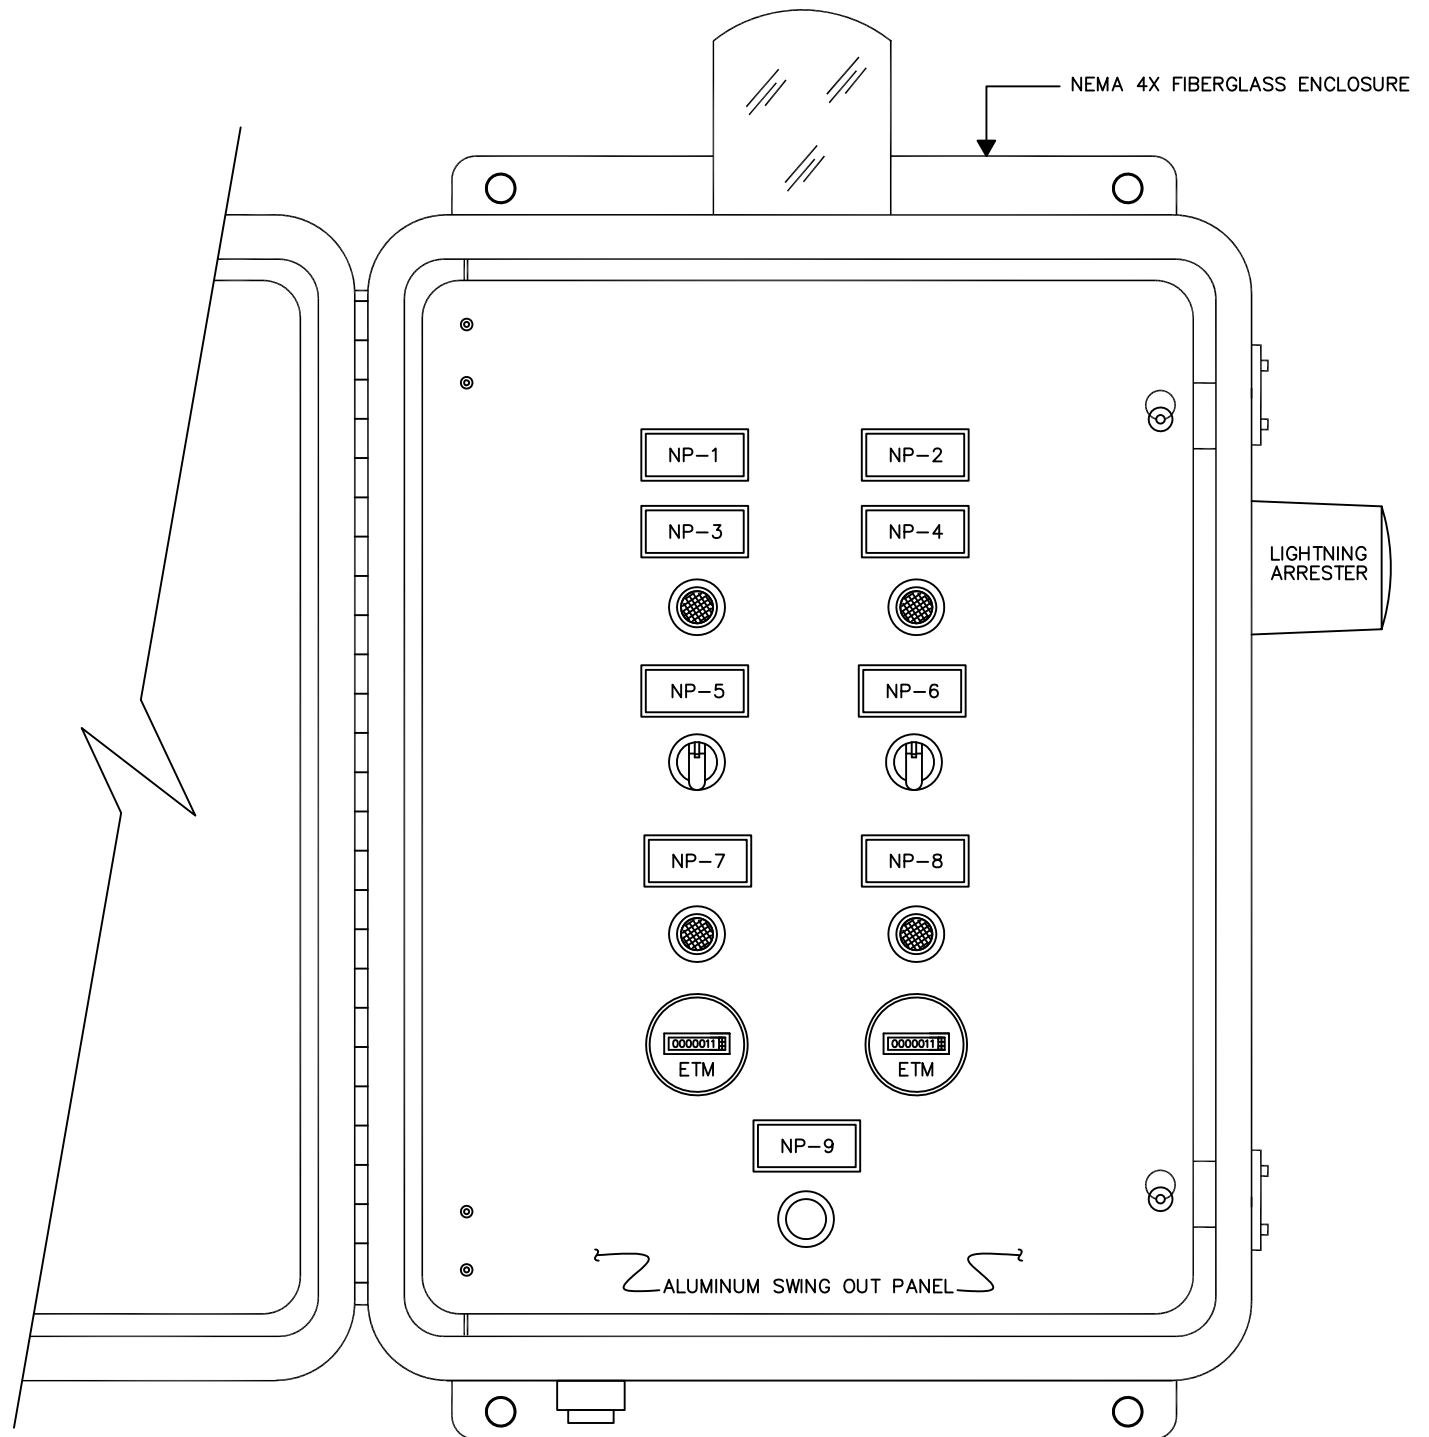

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NOTE:
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL
NP-9	ALARM SILENCE

DATE 12/03/03	Drawing Title ENCLOSURE		REFERENCE DRAWING		NO.		REVISION-LOCATION		ECN	DATE	BY
			S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL		APPROVED BY		DATE	
Project Title DUPLEX PUMP CONTROL PANEL		<div>COX</div> <div>Research and Technology, Inc.</div>				P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER			
								DRAWING NUMBER CP-1702		SHEET NUMBER 4	

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	VYNCKIER	VJ1816HPLDF	ENCLOSURE
1a	1	VYNCKIER	MP1816AL	BACKPLATE
2	1	ABB	OT63E3	MAIN DISC. SWITCH
3	2	ABB	A16-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU11	O.L. RELAY (7.5-11A)
5	2	SQUARE D	QOU320	CB1, CB2
6	1	TIMEMARK	261DT120	ALTERNATING RELAY
7	4	ACI	JR22FR	RED PILOT LIGHT
8	2	ACI	JR22P3M20B	HOA SWITCH
9	1	AC/DC	BL5-R-120	ALARM LIGHT
10	1	C-H	CHSA03	LIGHTNING ARRESTER
11	1	SSAC	PLMU-11	PHASE MONITOR
12	2	GRASSLIN	UWZ52E	ELAPSED TIME METER
13	1	ACI	JR22AN11B	PUSH BUTTON
14	1	INGRAM	PW120A	BELL
15	1	OMRON	G2R2SAC120	CONTROL RELAY
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title						
	<h3 style="margin: 0;">BILL OF MATERIALS</h3>						
DATE 12/03/03		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL	APPROVED BY	DATE
	Project Title	<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 150px;"> <h2 style="margin: 0;">COX</h2> </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	<h3 style="margin: 0;">DUPLEX PUMP CONTROL PANEL</h3>	Research and Technology, Inc.			Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1702
							SHEET NUMBER
							5