

---

---

# COX

Research and Technology, Inc.

---

---

## DUPLEX BLOWER CONTROL PANEL

Cox Research and Technology, Inc.  
14697 S. Harrells Ferry Road  
Baton Rouge, LA. 70816  
(225) 756-3271 Fax (225) 755-1030

CP-1476

VOLTAGE	<u>240V</u>	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	<u>3/60</u>	
NO. MOTORS	<u>2</u>	
HP	<u>5</u>	
FLA	<u>15.2</u>	
TYPE OF PUMP	<u>Blower</u>	(Self-Priming, Submersible)
MANUFACTURER	<u></u>	
CATALOG NUMBER	<u></u>	
CONTROL VOLTAGE	<u>120V</u>	(120V, Other)
ENCLOSURE	<u>NEMA 4X</u>	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	<u>Fiberglass</u>	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	<u></u>	(Floats, Bubbler, Other)
CAPACITORS	<u></u>	(Yes, No)
CAPACITOR WIRING FIGURE	<u></u>	
THERM. & SEAL FAIL WIRING FIGURE	<u></u>	


OPTIONS:


SEAL FAIL LIGHTS	<u></u>	(Submersible Only)
SEAL FAIL RELAYS	<u></u>	(Submersible Only)
SEAL FAIL PUMP SHUTDOWN	<u></u>	(Submersible Only)
HT PUMP SHUTDOWN	<u></u>	(Self-Primer, Submersible)
ALARM HORN	<u></u>	
ALARM LIGHT	<u></u>	
LIGHT PANEL MTD	<u></u>	
LIGHT REMOTE MTD	<u></u>	
LIGHT FLASHER	<u></u>	
LIGHTNING ARRESTER	<u></u>	
ELAPSED TIME METER	<u></u>	
PHASE MONITOR	<u></u>	
NEMA RATED STARTERS	<u></u>	
GROUND FAULT RECPT.	<u></u>	
GREEN RUN LIGHTS VS. RED	<u></u>	
POLE, BOX, SEAL	<u></u>	
INTRINSICALLY SAFE RELAYS	<u></u>	
HIGH TEMP. LOCKOUT, MANUAL RESET	<u></u>	
ECONOMY VERSION	<u>X</u>	

SOLD TO: Delta Process

TAG : Blower Control Panel


SHIP TO: Delta Process - Denham Springs, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 10/11/02		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY CTR	ECN	DATE
	Project Title	<div style="text-align: center;">   <b>COX</b>  Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX BLOWER CONTROL PANEL				Ph. (225)756-3271 Fax (225)756-1030		DRAWING NUMBER CP-1476
							SHEET NUMBER 1

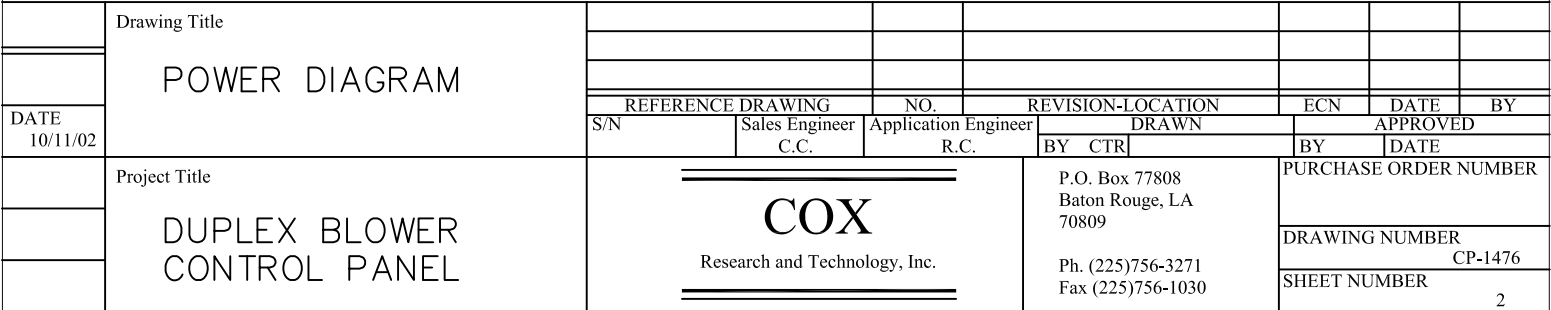

COX



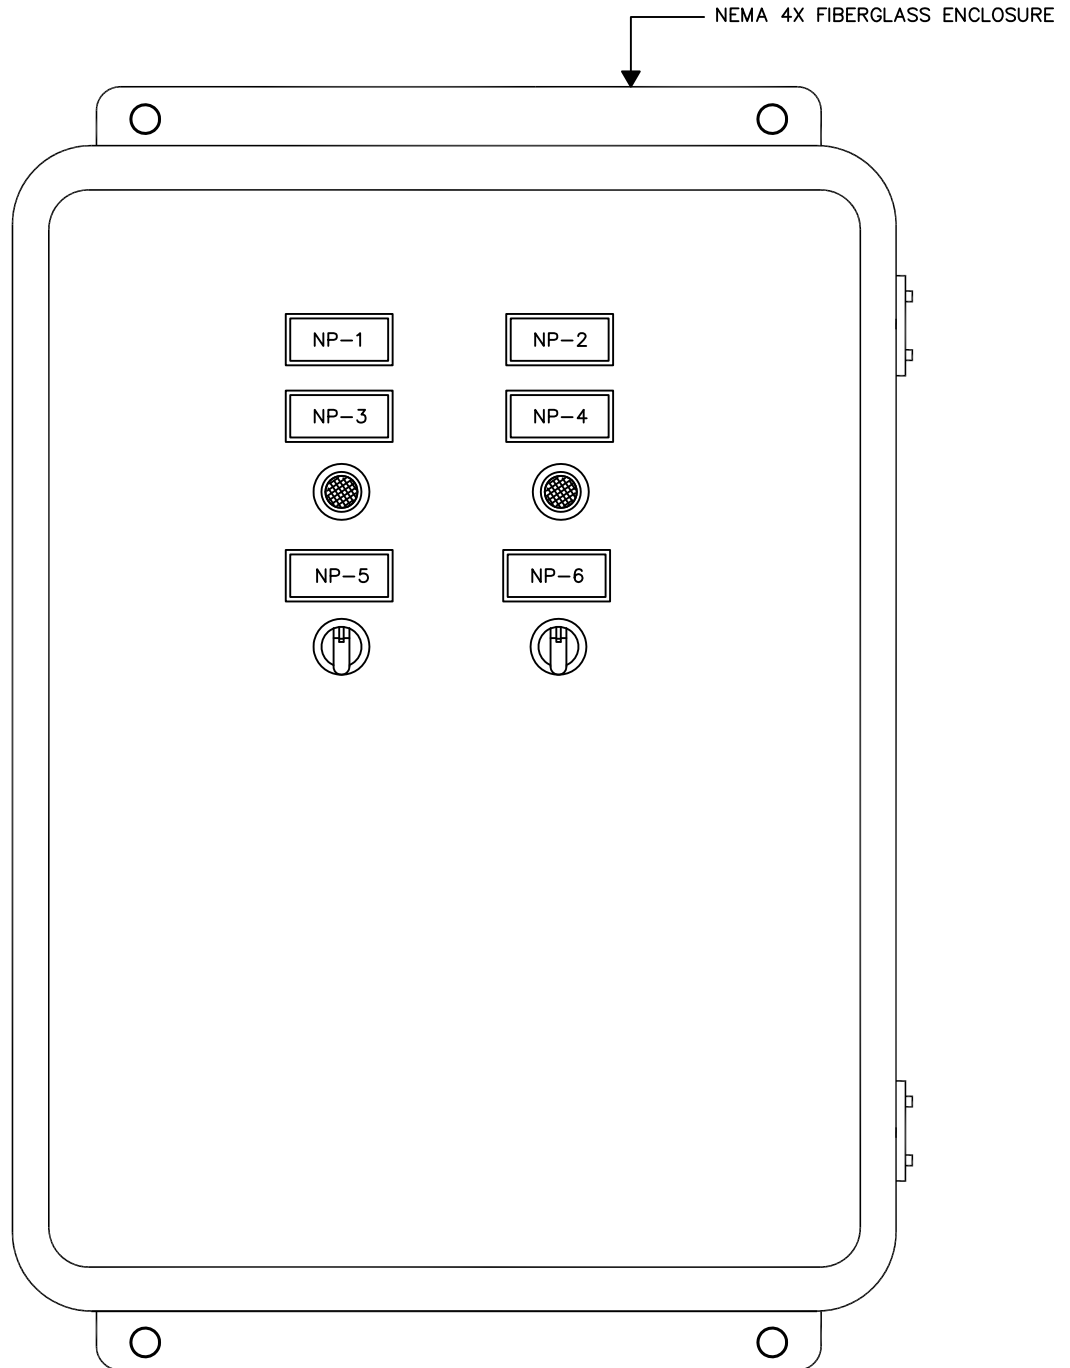

VIEW OF FRONT COVER

NAMEPLATE SCHEDULE

**NOTE:**  
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.  
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE  
PANEL TO PREVENT ENTRY OF GASSES.

NP-1	BLOWER 1
NP-2	BLOWER 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA

DATE 10/11/02	Drawing Title							
	ENCLOSURE							
		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	
	Project Title	S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY CTR	APPROVED BY	DATE	PURCHASE ORDER NUMBER
	DUPLEX BLOWER CONTROL PANEL	<div style="text-align: center;"> <b>COX</b>            Research and Technology, Inc.         </div>			P.O. Box 77808 Baton Rouge, LA 70809		DRAWING NUMBER CP-1476	
					Ph. (225)756-3271 Fax (225)756-1030		SHEET NUMBER 5	

# BILL OF MATERIAL

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPL	ENCLOSURE
2	1	STAHLIN	BP1816AL	BACKPLATE
3	2	ABB	A16-30-10-84	STARTER
4	2	ABB	TA25DU19	O.L. (13-19A)
5	2	SQUARE D	QOU335	CIRCUIT BREAKER 1,2
6	2	ACI	JR22P3M20B	H.O.A. SWITCH
7	1	TIMEMARK	261DT120	ALTERNATING RELAY
8	1	GRASSLIN	FM/1 STUZH-L	TIMER
9	2	ACI	JR22FR	RED PILOT LIGHT
10	1	SQUARE D	9070TF150D1	TRANSFORMER

	Drawing Title						
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>						
DATE 10/11/02		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY CTR	APPROVED BY	DATE
	Project Title	<div style="border-top: 3px double black; border-bottom: 3px double black; padding: 5px;"> <h1 style="margin: 0;">COX</h1> <p style="margin: 0;">Research and Technology, Inc.</p> </div>			P.O. Box 77808 Baton Rouge, LA 70809  Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER  DRAWING NUMBER <div style="text-align: right;">CP-1476</div> SHEET NUMBER <div style="text-align: right;">6</div>
	DUPLEX BLOWER CONTROL PANEL						