




CP2220/ECO/FG/UL/2
CONTROL PANEL

Delta Treatment Systems
9125 Comar Drive
Walker, LA 70785
(225) 665-6162 Fax (800) 219-9183


CP2220/ECO/FG/UL/2

EXTERNAL DISCONNECTS REQUIRED

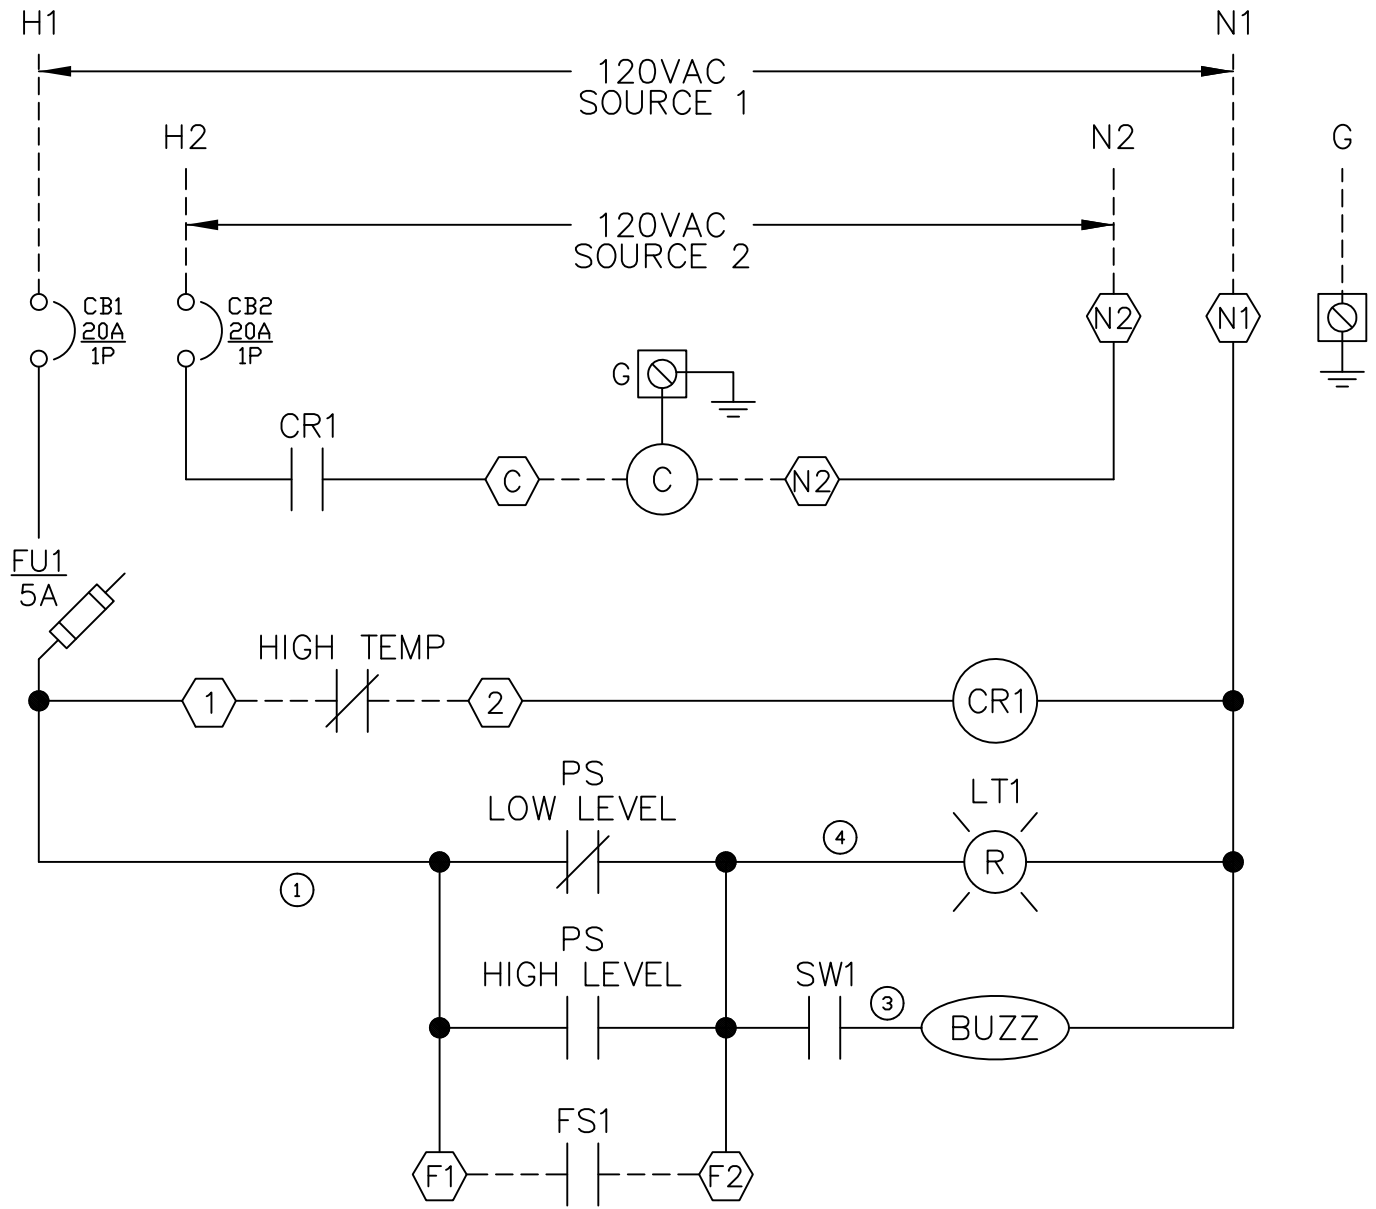


FS1 - (OPTIONAL) H.L. FLOAT SWITCH. IN TREATMENT PLANT

CP-2220/ECO/FG/UL CONTROL PANEL



					9125 Comar Drive Walker, LA 70785 Ph. (225) 665-6162 Fax (800)219-9183	SCHEMATIC DIAGRAM					
-	-	-	-								
-	-	-	-								
REV.	DATE	REVISION	DESCRIPTION								BY
COMPANY CONFIDENTIAL: INFORMATION CONTAINED HEREIN IS CONFIDENTIAL, IT IS THE PROPERTY OF PENTAIR PUMP GROUP, IT IS TO BE USED SOLELY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF PENTAIR PUMP GROUP.					PLOT SCALE	DRAWING NUMBER		DRAWN BY	DATE	SHEET OF	REV.
					NTS	CP2220/ECO/FG/UL/2		N. RILL	01/20/23	1 2	A

SETTING HIGH LEVEL PRESSURE SWITCH

BRING PLANT TO OPERATING WATER LEVEL WITH COMPRESSOR TURNED ON. USING PROPERLY SIZED SCREW DRIVER, TURN HIGH LEVEL ALARM ADJUSTMENT SCREW CLOCKWISE UNTIL ALARM OCCURS, THEN TURN THE SCREW COUNTER-CLOCKWISE UNTIL ALARM STOPS.

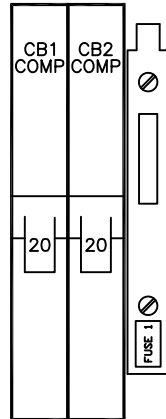


HIGH LEVEL ALARM
ADJUSTMENT SCREW

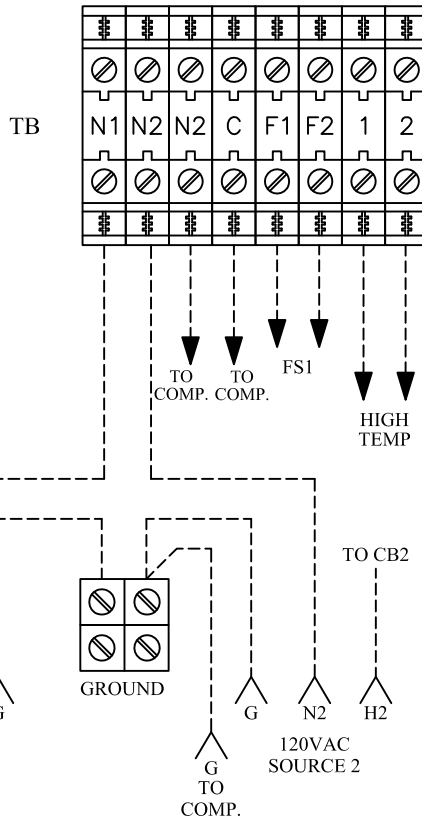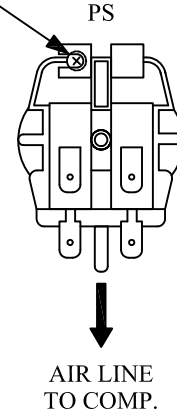

FS1 - (OPTIONAL) H.L. FLOAT SWITCH.
IN TREATMENT PLANT

CP-2220/ECO/FG/UL CONTROL PANEL

					9125 Comar Drive Walker, LA 70785 Ph. (225) 665-6162 Fax (800)219-9183	EXTERNAL CONNECTIONS					
-	-	-	-								
-	-	-	-								
REV.	DATE	REVISION	DESCRIPTION								BY
COMPANY CONFIDENTIAL: INFORMATION CONTAINED HEREIN IS CONFIDENTIAL. IT IS THE PROPERTY OF PENTAIR PUMP GROUP, IT IS TO BE USED SOLELY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF PENTAIR PUMP GROUP.					PLOT SCALE	DRAWING NUMBER		DRAWN BY	DATE	SHEET OF	REV.
					NTS	CP2220/ECO/FG/UL/2		N. RILL	01/20/23	2 2	A