

PROGRAM  
6 FIELD V/D  
FILTER B/W



Delta Environmental Products, Inc.  
P.O. Box 969 Denham Springs, LA 70727

## Schematic Diagram Filter System



DWN BY:  
CTR

DATE:  
6/17/02

SCALE:  
N.T.S.

DWG. NO.:

JOB NO.:  
CP-1417

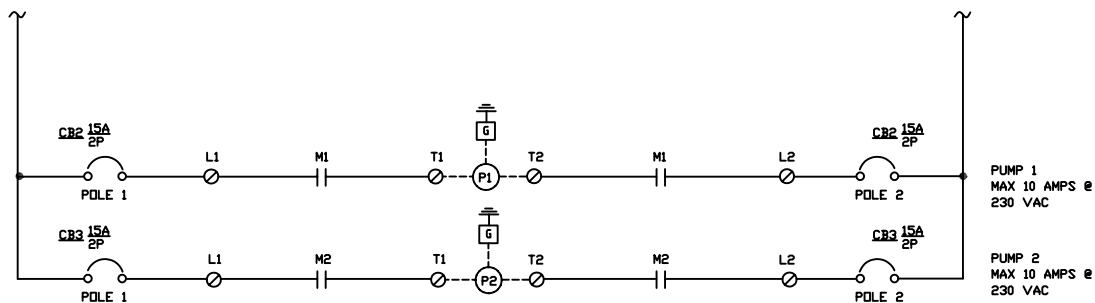

NOTE

1. INTERNAL PUMP THERMAL OVERLOAD IS RECOMMENDED.
2. PLC WILL INDICATE NUMBER OF HIGH LEVEL ALARMS AND NUMBER OF TIMES A PUMP IS TURNED TO HAND POSITION.



Delta Environmental Products, Inc.  
P.O. Box 969 Denham Springs, LA 70727

## Schematic Diagram Filter System



DWN BY:  
CTR

DATE:  
6/17/02

SCALE:  
N.T.S.

DWG. NO.:

JOB NO.:  
CP-1417

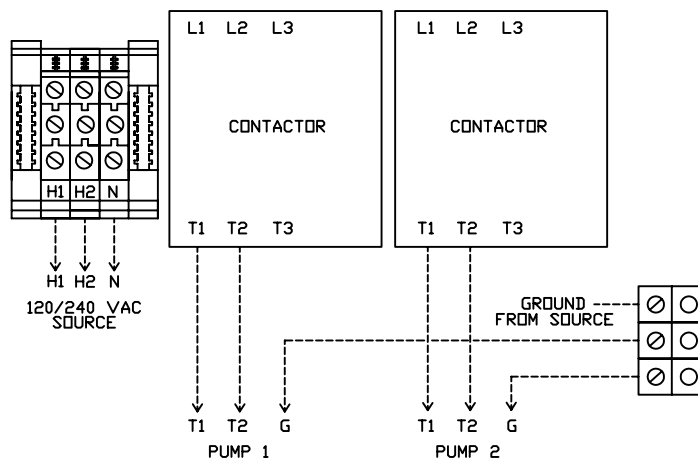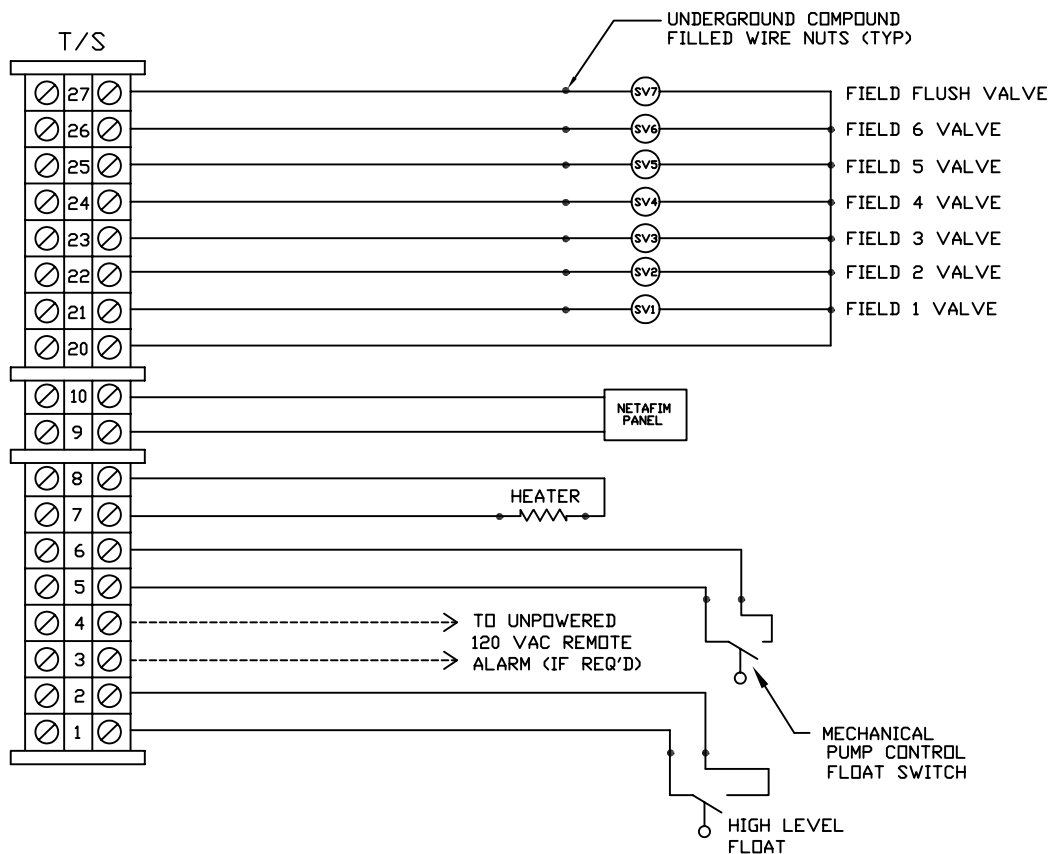

Delta Environmental Products, Inc.  
P.O. Box 969 Denham Springs, LA 70727

## Filter System External Connections

DWN BY:  
CTR

DATE:  
6/17/02

SCALE:  
N.T.S.

DWG. NO.:

JOB NO.:  
CP-1417