
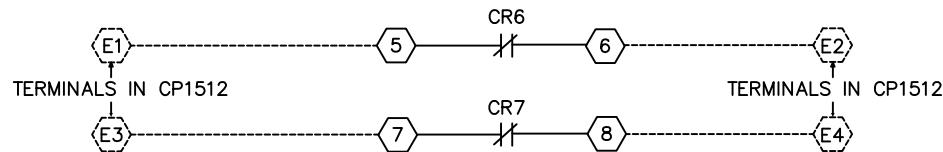
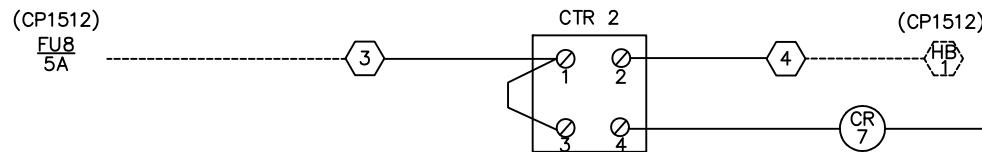


FROM CP1512
TO AUXILARY

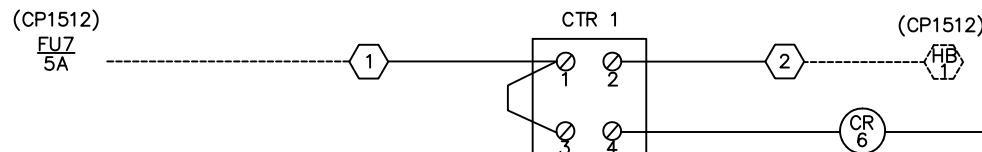

	Drawing Title					
		1			4/10/03	CTR
DATE 09/18/06	REFERENCE DRAWING S/N	NO. C.C.	REVISION-LOCATION DRAWN BY CJC	ECN	DATE APPROVED BY DATE	BY
	Project Title CONTROL PANEL	COX Research and Technology, Inc.	P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030	PURCHASE ORDER NUMBER DRAWING NUMBER CP-1512A SHEET NUMBER 1		


COX

Research and Technology, Inc.


CONTROL PANEL

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030


CP-1512R2
(FIELD REVISION)

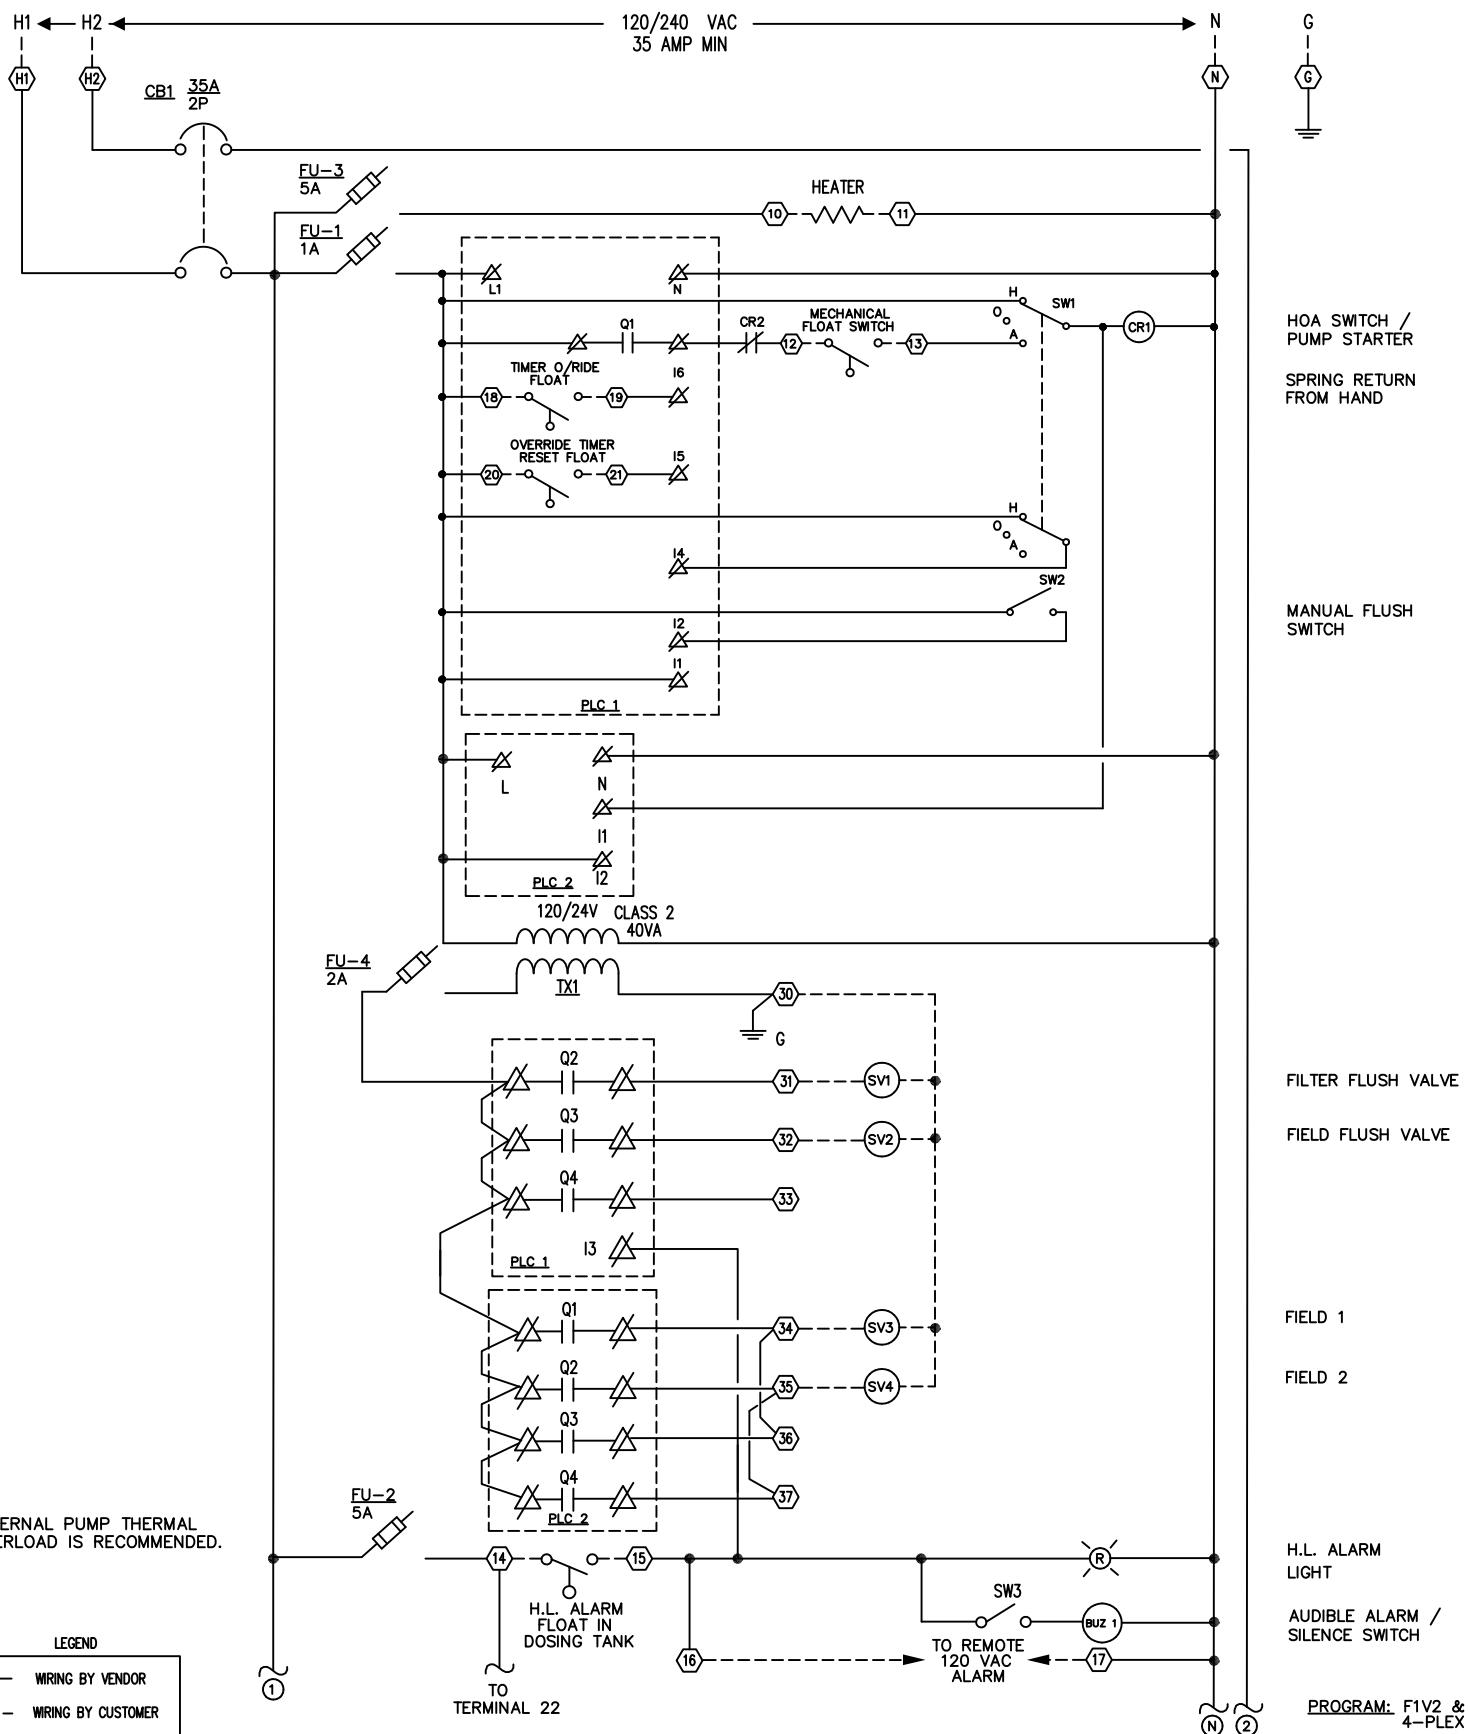

	Drawing Title					
DATE 12/12/06	Project Title CONTROL PANEL	REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	
		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY CTR	
COX Research and Technology, Inc.		P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER			
		Ph. (225)756-3271 Fax (225)756-1030	DRAWING NUMBER CP-1512R2			
			SHEET NUMBER 1			

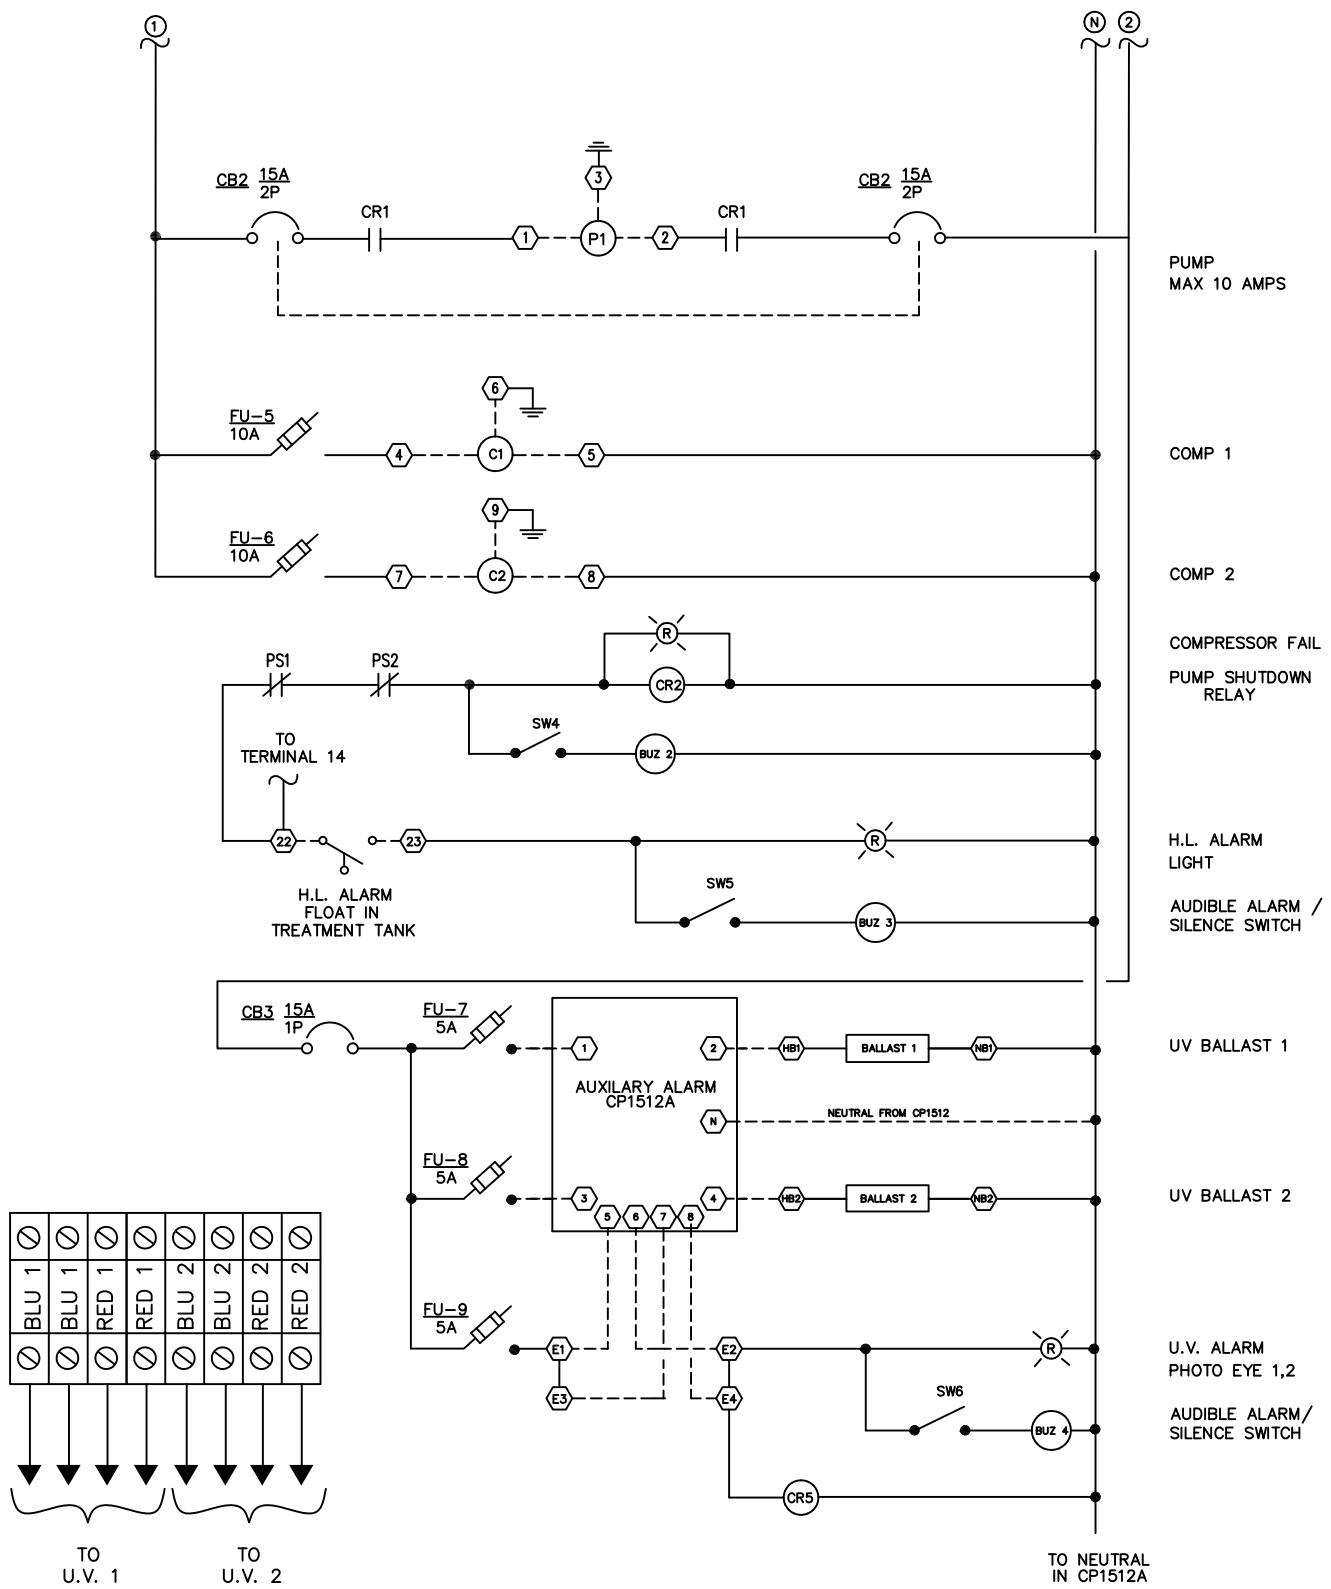


	Drawing Title							
			1				4/10/03	CTR
DATE 12/12/06		REFERENCE DRAWING		NO.	REVISION-LOCATION		ECN	DATE
	S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY CJC		APPROVED BY DATE		
	Project Title		<hr/> <hr/> COX <hr/> <hr/> Research and Technology, Inc.		P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER	
	CONTROL PANEL						DRAWING NUMBER CP-1512R2	
							SHEET NUMBER 2	

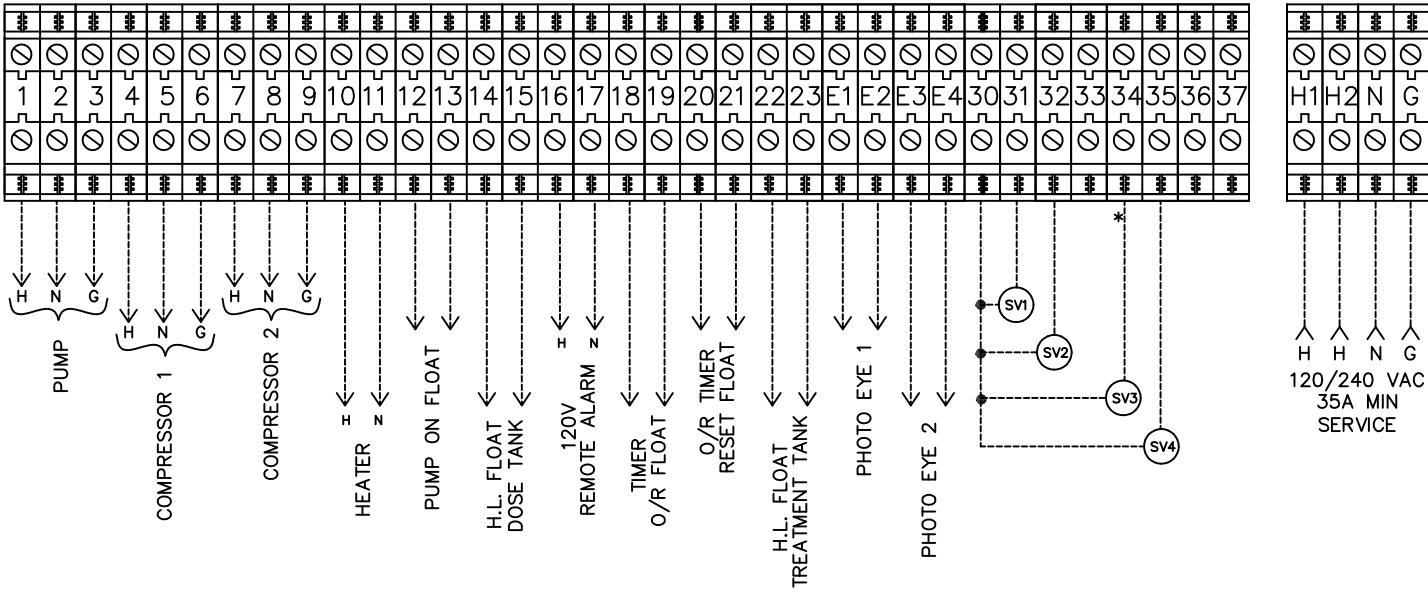

* TO REMOVE A FIELD VALVE FROM SERVICE:

- 1) If SV3 needs to be taken out of service, disconnect SV3 wire from terminal 34.
- 2) Place jumper wire between terminals 34 and 35.
- 3) Make sure that the SV4 wire in terminal 35 remains along with the jumper wire.

FACTORY WIRING

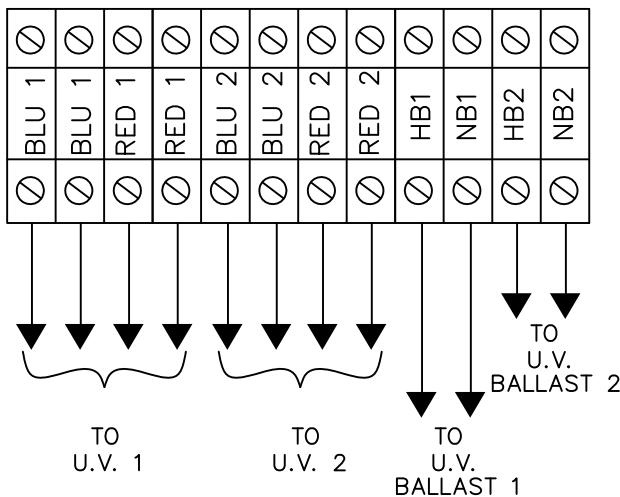

	Drawing Title	REFERENCE DRAWING		NO. DRAWN BY CTR	REVISION-LOCATION	ECN	DATE APPROVED
		S/N	Sales Engineer C.C.				
DATE 12/12/06							
	Project Title CONTROL PANEL	<hr/> <hr/> COX <hr/> <hr/> Research and Technology, Inc. <hr/> <hr/>		P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER		3
				Ph. (225)756-3271 Fax (225)756-1030	DRAWING NUMBER CP-1512R2		
					SHEET NUMBER		