

---

---

COX

Research and Technology, Inc.

---

---

TALL TIMBERS SUBDIVISION  
DUPLEX PUMP  
CONTROL PANEL

Cox Research and Technology, Inc.  
14697 S. Harrells Ferry Road  
Baton Rouge, LA. 70816  
(225) 756-3271 Fax (225) 755-1030

CP-1945

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	3/60	
NO. MOTORS	2	
HP	10	
FLA	26	
TYPE OF PUMP	Self-Priming	(Self-Priming, Submersible)
MANUFACTURER	GR	
CATALOG NUMBER		

CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	No	(Yes, No)
CAPACITOR WIRING FIGURE	N/A	
THERM. & SEAL FAIL WIRING FIGURE		


OPTIONS:

SEAL FAIL LIGHTS		(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN		(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD		
LIGHT REMOTE MTD	X (NOT SUPPLIED)	
LIGHT FLASHER		
LIGHTNING ARRESTER	X	
ELAPSED TIME METER	X	
PHASE MONITOR	X	
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		

SOLD TO: Delta Process - Bossier City, LA  
TAG : TALL TIMBERS SUBDIVISION

SHIP TO: Delta Process - Ruston, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 11/05/04		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	APPROVED BY	DATE
	Project Title	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809  Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER  DRAWING NUMBER CP-1945 SHEET NUMBER 1
	DUPLEX PUMP CONTROL PANEL						

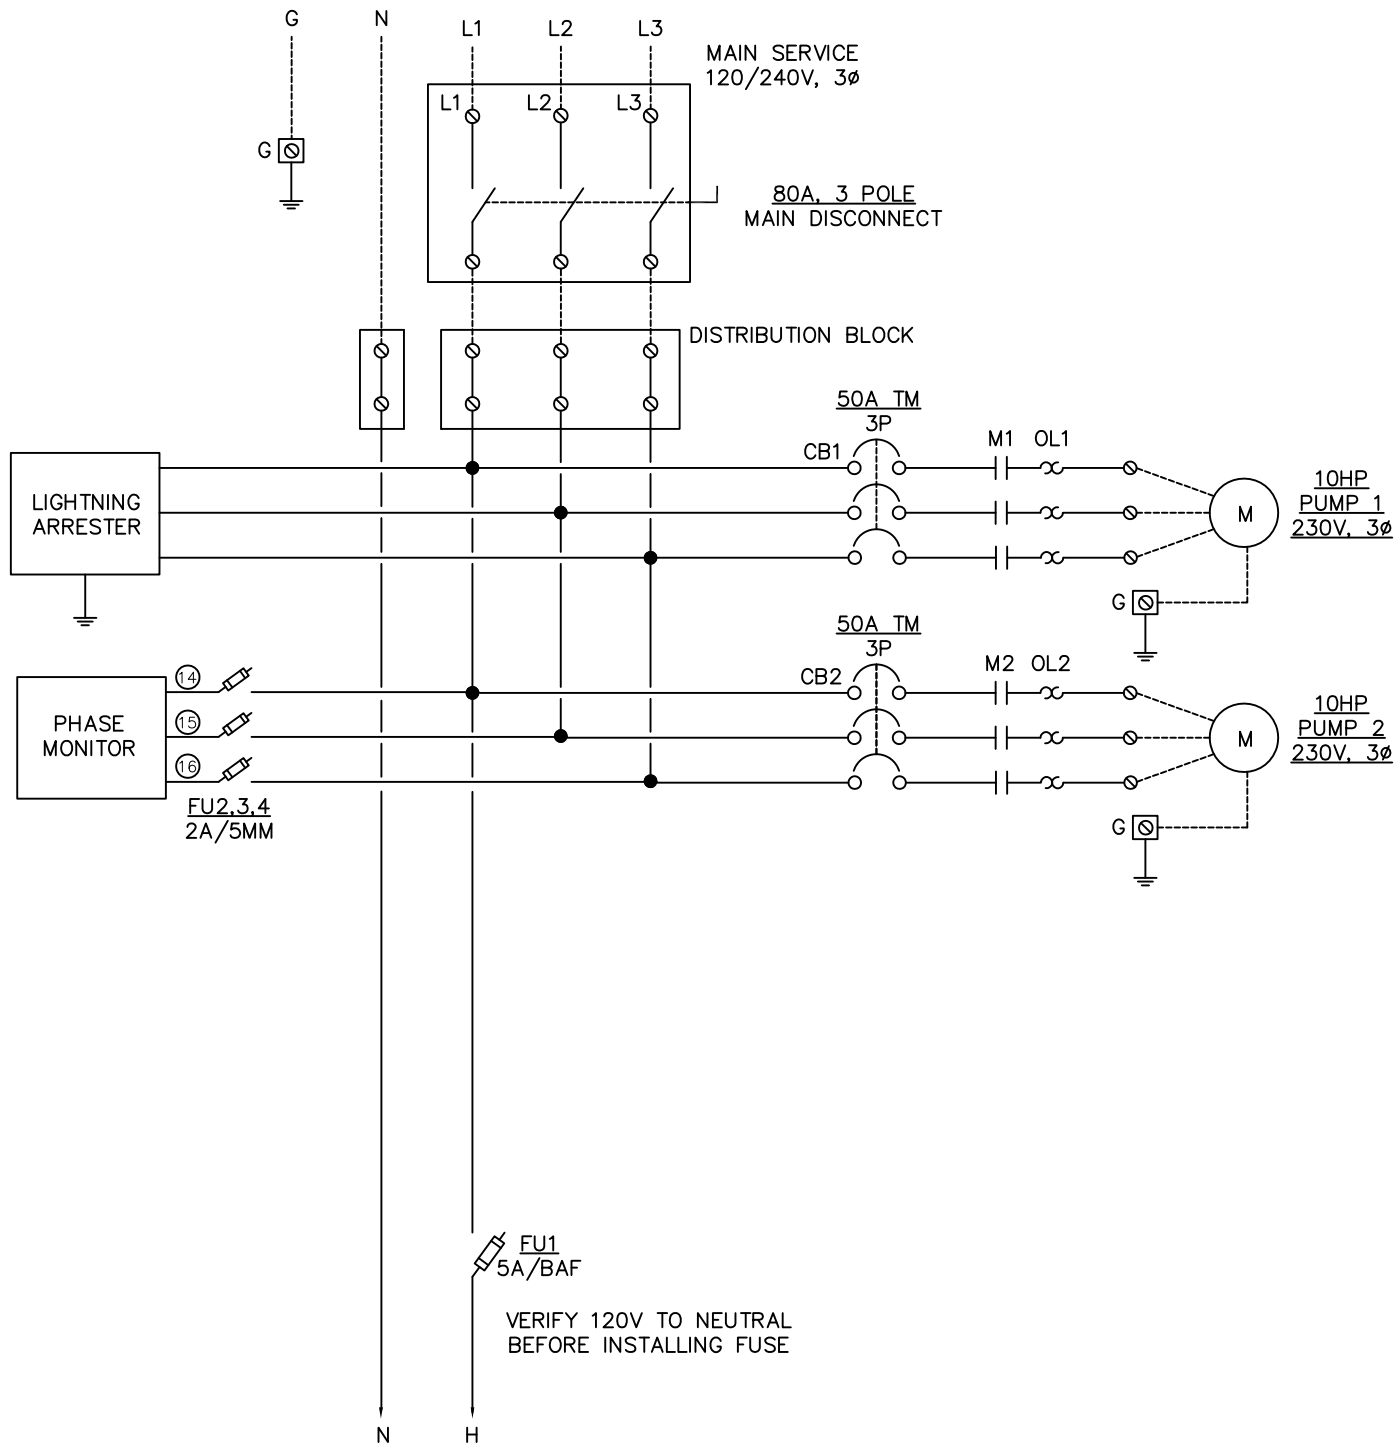

	Drawing Title							
	POWER DIAGRAM							
DATE 11/05/04		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
	Project Title	PURCHASE ORDER NUMBER			APPROVED			
	DUPLEX PUMP CONTROL PANEL	DRAWING NUMBER CP-1945			DATE			
		SHEET NUMBER			2			

COX

Research and Technology, Inc.


P.O. Box 77808  
Baton Rouge, LA  
70809

Ph. (225)756-3271  
Fax (225)756-1030

DATE	DATE
PURCHASE ORDER NUMBER	

DRAWING NUMBER	CP-1945
----------------	---------

SHEET NUMBER

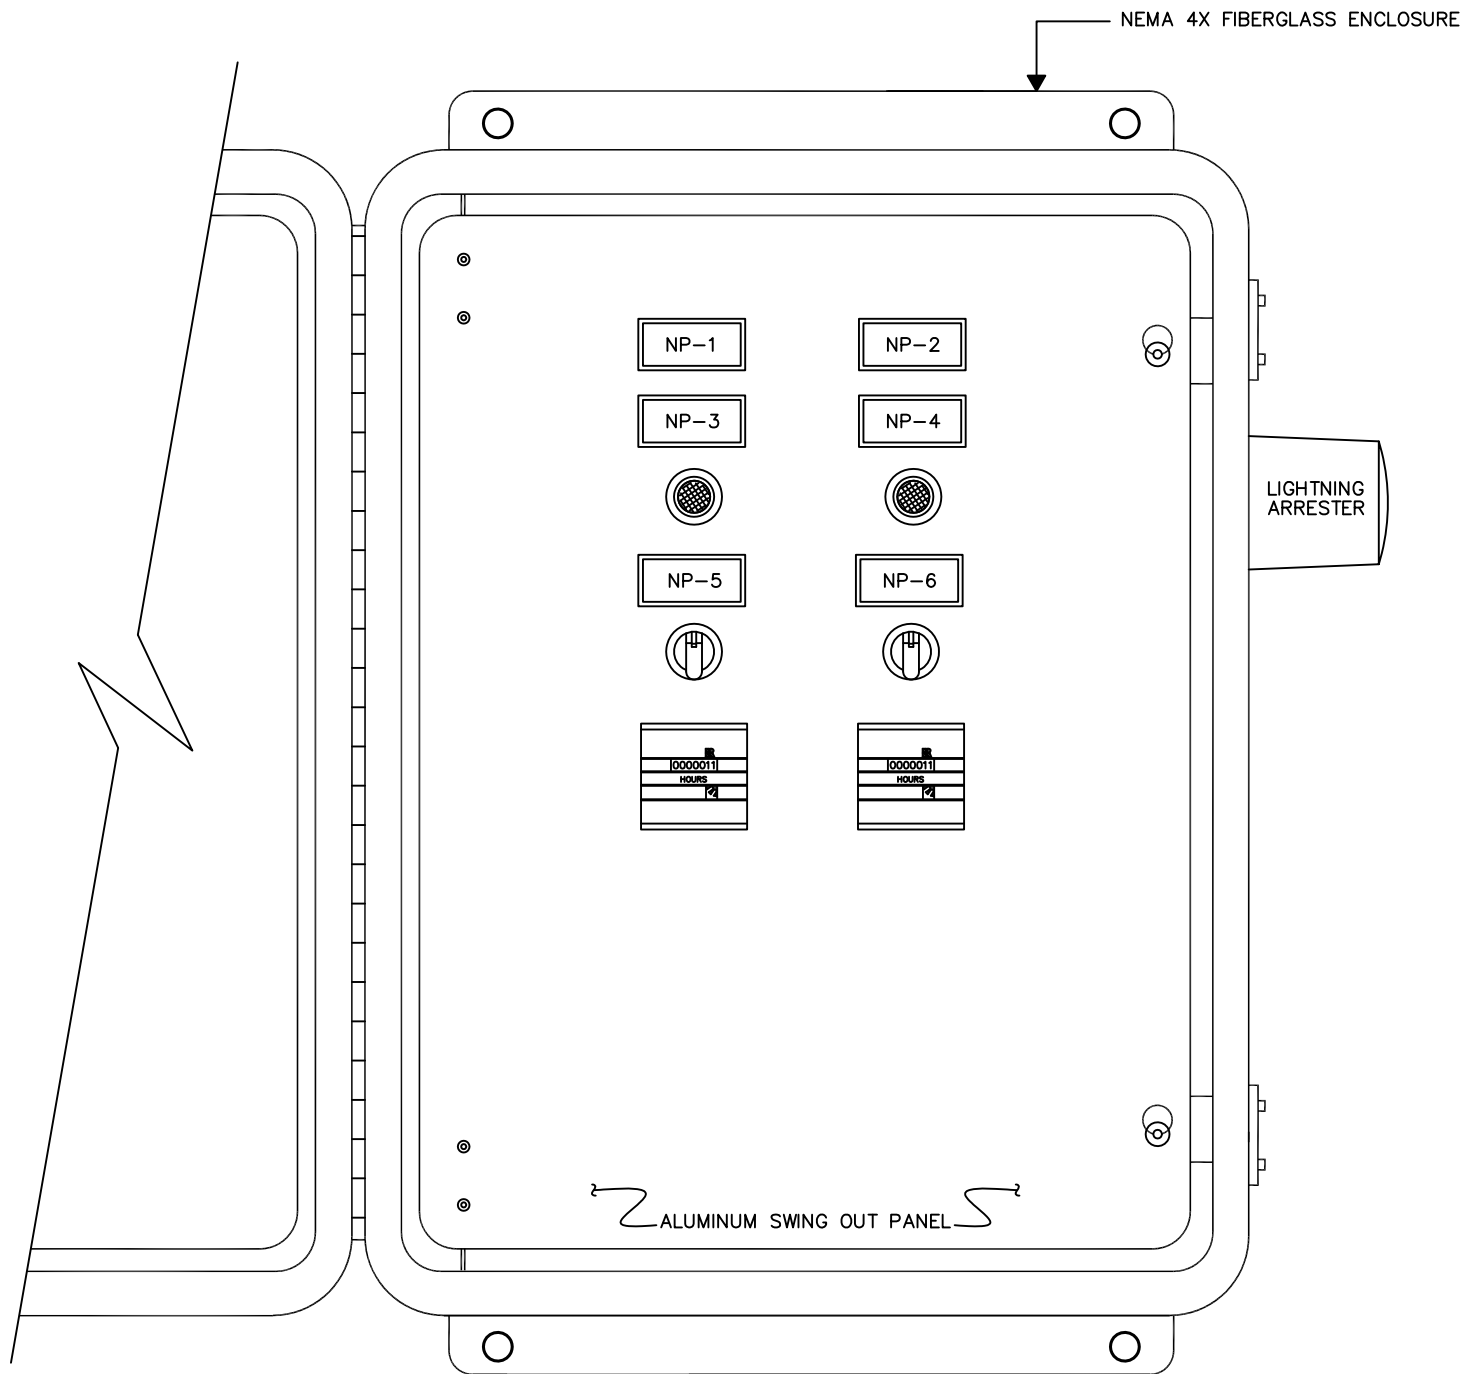

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NP-1 PUMP 1  
 NP-2 PUMP 2  
 NP-3 RUN  
 NP-4 RUN  
 NP-5 HOA  
 NP-6 HOA

**NOTE:**  
 SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.  
 PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE  
 PANEL TO PREVENT ENTRY OF GASSES.

	Drawing Title   <	
--	--	--

## BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	2	ABB	A40-30-10-84	MOTOR STARTER
3	2	ABB	TA42DU32	O.L. RELAY (22-32A)
4	2	SQUARE D	QOU350	CB1, CB2
5	1	TIMEMARK	261DT120	ALTERNATING RELAY
6	2	ACI	JR22FR	RED PILOT LIGHT
7	2	ACI	JR22P3M20B	HOA SWITCH
8	1	DELTA	LA603	LIGHTNING ARRESTER
9	1	ABB	OT63E3	DISCONNECT SWITCH
10	1	SSAC	PLMU-11	PHASE MONITOR
11	2	REDINGTON	711-0190	ELAPSED TIME METER
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

[illegible]