
COX

Research and Technology, Inc.

DUPLEX PUMP
CONTROL PANEL
OAKLAND WATER WORKS

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-2318

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	3/60	
NO. MOTORS	2	
HP	10	
FLA	35	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	Myers	
CATALOG NUMBER		

CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	No	(Yes, No)
CAPACITOR WIRING FIGURE	N/A	
THERM. & SEAL FAIL WIRING FIGURE		

OPTIONS:


SEAL FAIL LIGHTS	X	(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER	X	
ELAPSED TIME METER		
PHASE MONITOR	X	
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		

SOLD TO: Delta Process - Bossier City, LA


TAG : Oakland Water Works

SHIP TO: Delta Process - Ruston, LA


	Drawing Title						
	PANEL DESCRIPTION						
DATE 2/21/06		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div style="text-align: center;"> COX Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-2318
							SHEET NUMBER 1

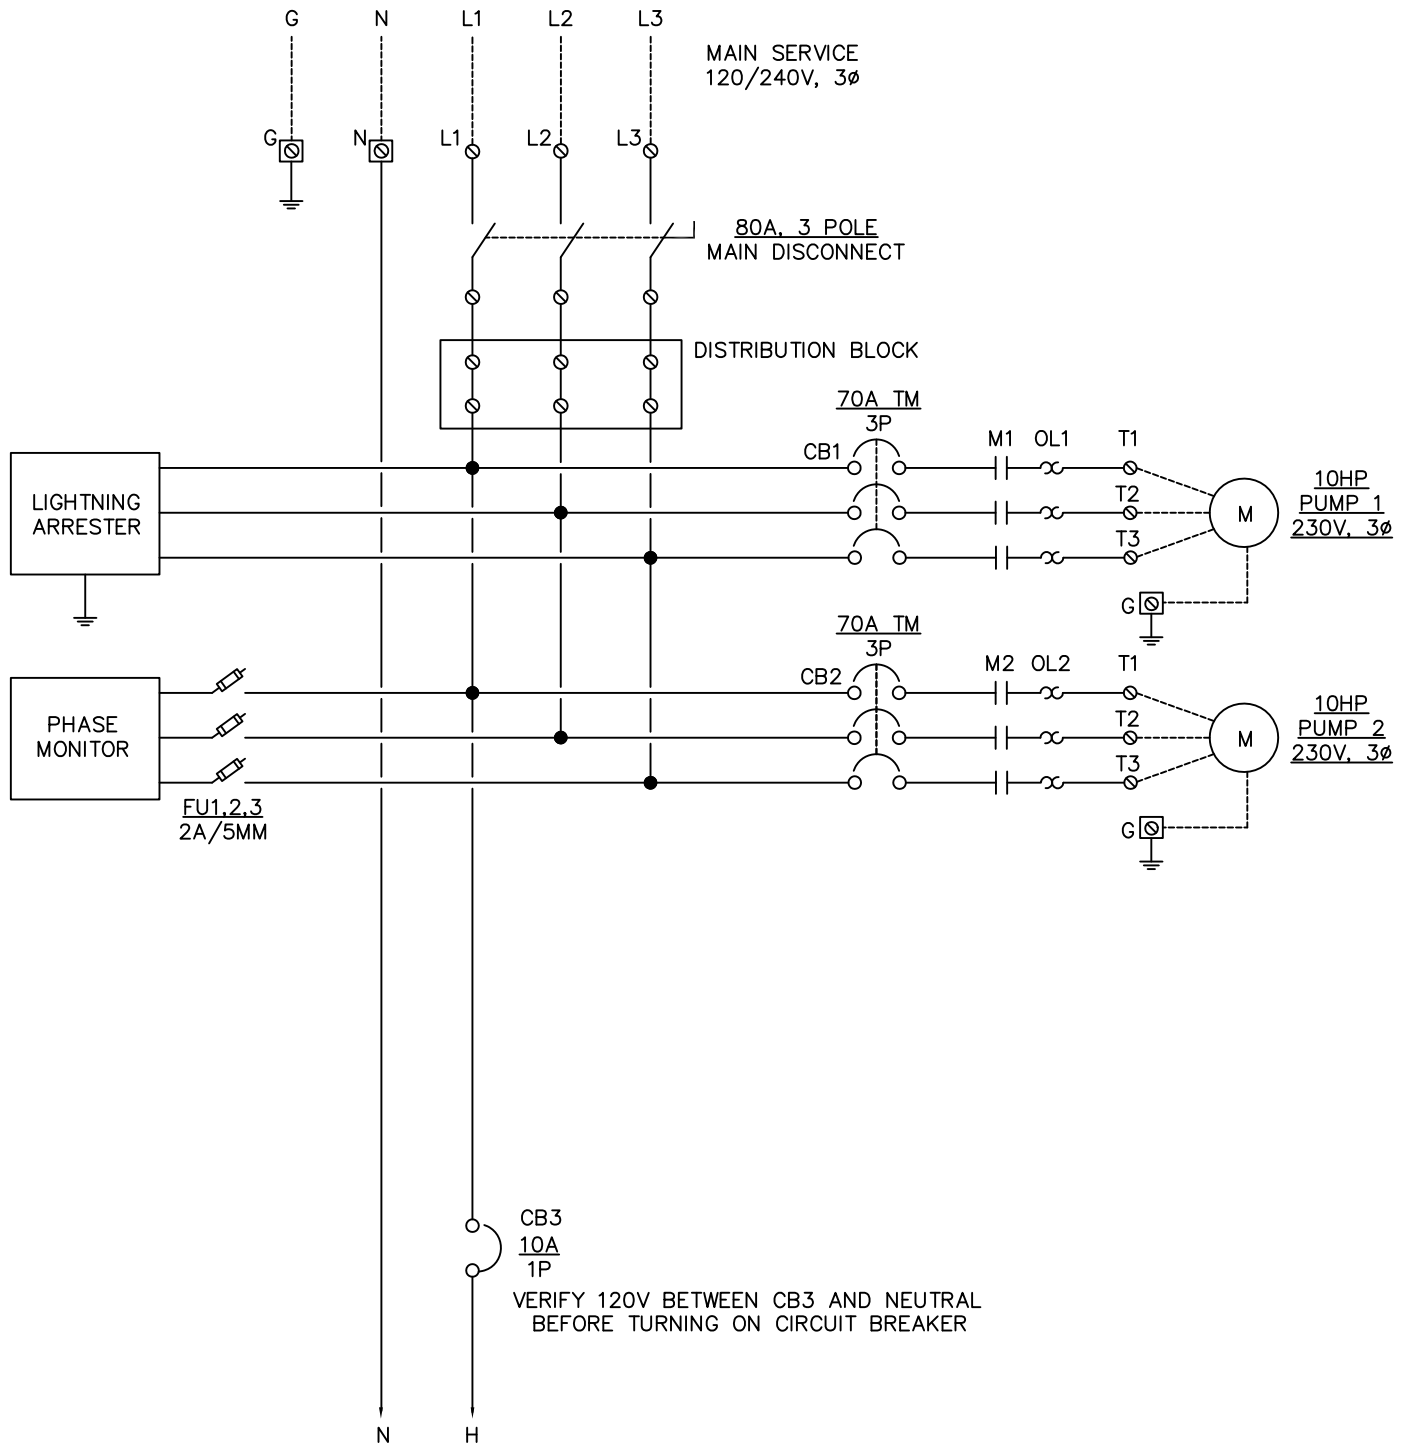

	Drawing Title								
	POWER DIAGRAM								
DATE 2/21/06		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	BY C. RACHAL	ECN	DATE	BY	APPROVED
	Project Title	COX			P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER			
	DUPLEX PUMP CONTROL PANEL	Research and Technology, Inc.			Ph. (225)756-3271 Fax (225)755-1030	DRAWING NUMBER CP-2318			
						SHEET NUMBER 2			

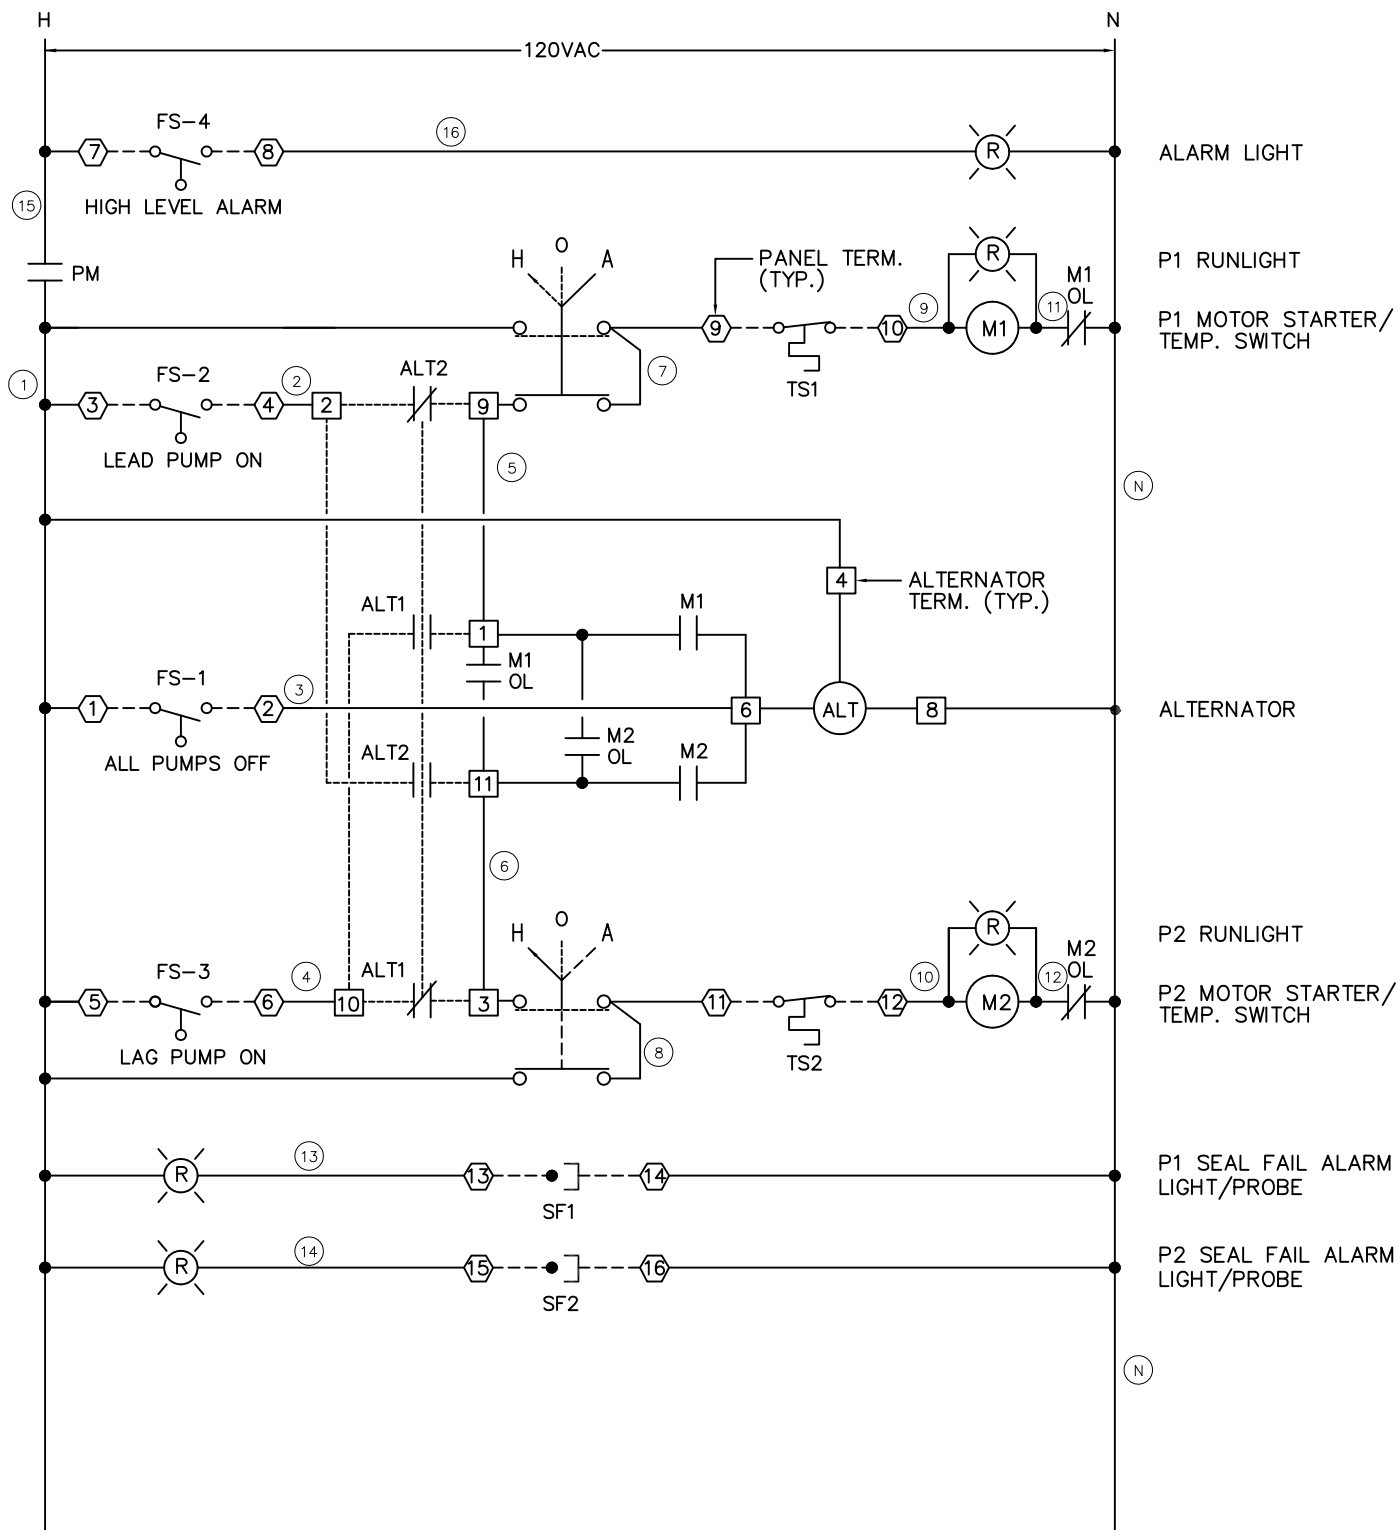

DATE 2/21/06	Drawing Title								
	CONTROL DIAGRAM								
	Project Title		COX		P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER		
	DUPLEX PUMP CONTROL PANEL		Research and Technology, Inc.		Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-2318		
							SHEET NUMBER 3		

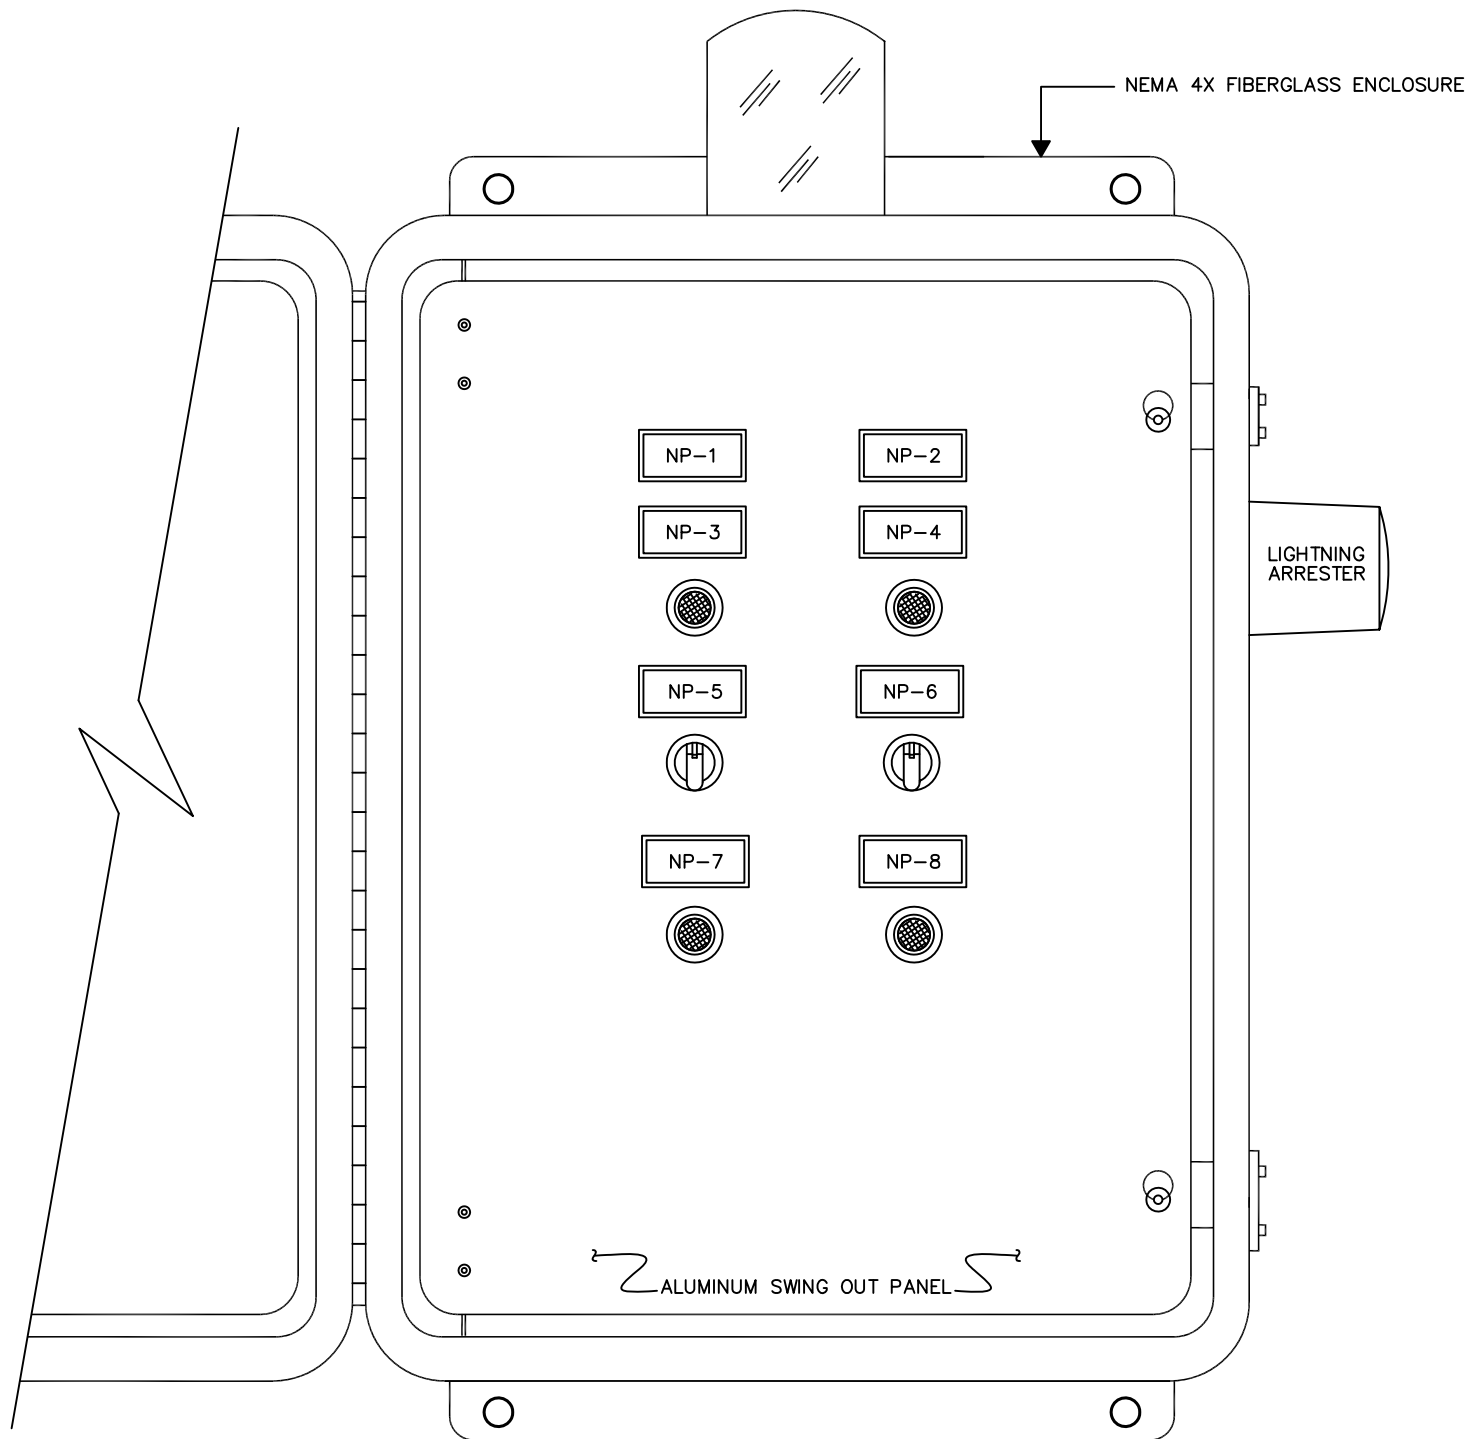

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL

NOTE:
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

	Drawing Title								
	ENCLOSURE								
DATE		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY		
2/21/06		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	APPROVED			
	Project Title					PURCHASE ORDER NUMBER			
	DUPLEX PUMP CONTROL PANEL					DRAWING NUMBER CP-2318			
						SHEET NUMBER			4

COX
Research and Technology, Inc.

P.O. Box 77808
Baton Rouge, LA
70809
Ph. (225)756-3271
Fax (225)755-1030

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	1	ABB	OT63E3	MAIN DISC. SWITCH
3	2	ABB	A40-30-10-84	MOTOR STARTER
4	2	ABB	TA42DU42	O.L. RELAY (29-42A)
5	2	SQUARE D	QOU370	CB1, CB2
6	1	SQUARE D	QOU110	CB3
7	1	TIMEMARK	261DT120	ALTERNATING RELAY
8	4	ACI	JR22FR	RED PILOT LIGHT
9	2	ACI	JR22P3M20B	HOA SWITCH
10	1	AC/DC	BL5-R-120	ALARM LIGHT
11	1	DELTA	LA603	LIGHTNING ARRESTER
12	1	SSAC	PLMU-11	PHASE MONITOR
13	1	MARATHON	1323580	DISTRIBUTION BLOCK
14	1	MARATHON	1321570	NEUTRAL BLOCK
15				

	Drawing Title							
	<h3 style="margin: 0;">BILL OF MATERIALS</h3>							
DATE 2/21/06		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
		<div style="display: flex; justify-content: space-around; align-items: center;"> <div style="text-align: center;"> <h2 style="margin: 0;">COX</h2> <p style="margin: 0;">Research and Technology, Inc.</p> </div> <div style="text-align: left;"> <p style="margin: 0;">P.O. Box 77808 Baton Rouge, LA 70809</p> <p style="margin: 0;">Ph. (225)756-3271 Fax (225)755-1030</p> </div> </div>			APPROVED BY	DATE		
	Project Title				PURCHASE ORDER NUMBER			
	<h3 style="margin: 0;">DUPLEX PUMP CONTROL PANEL</h3>				DRAWING NUMBER CP-2318			
					SHEET NUMBER		5	