


FROM
120VAC
20A BRANCH
CIRCUIT

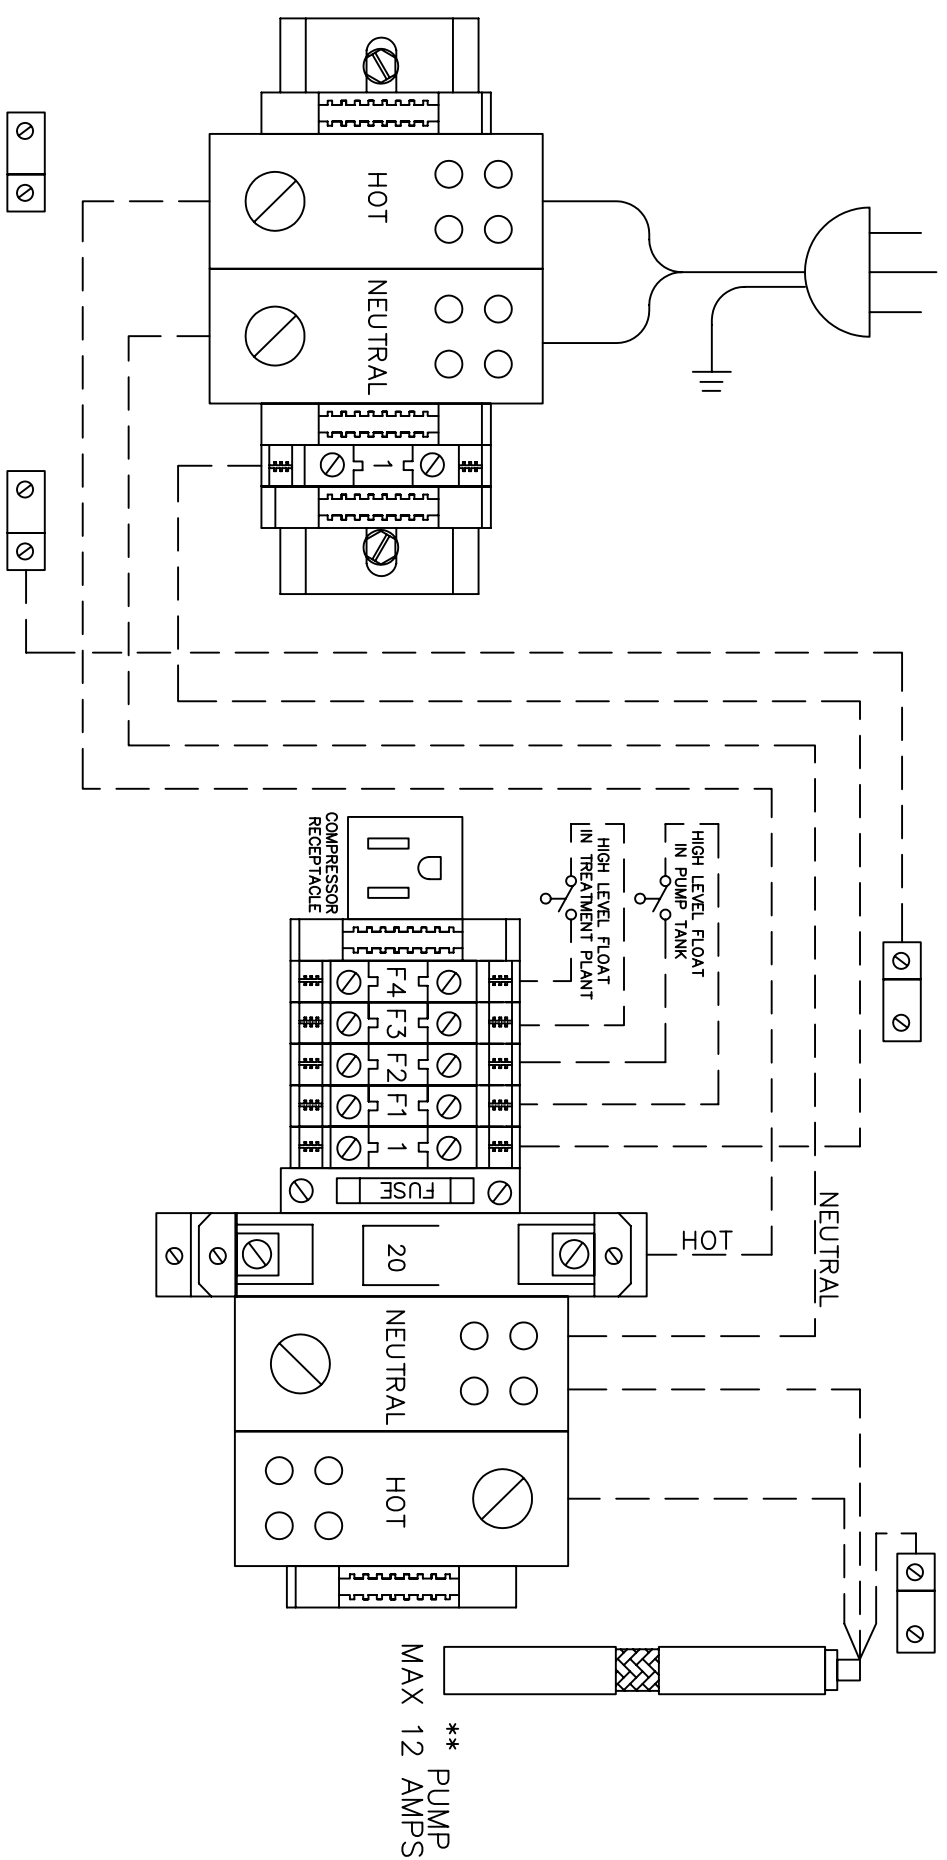

PANEL 1

PANEL 2

** INTERNAL THERMAL OVERLOADS REQUIRED

EXTERNAL WIRING DIAGRAM