


PUMP INTERNAL THERMAL
OVERLOAD IS REQ'D


* SIZE VARIES WITH
COMPRESSOR SIZE PER
NATIONAL ELECTRICAL CODE

SCHEMATIC DIAGRAM
CP-1425


ENCL.




L71



CLOCK



SW1

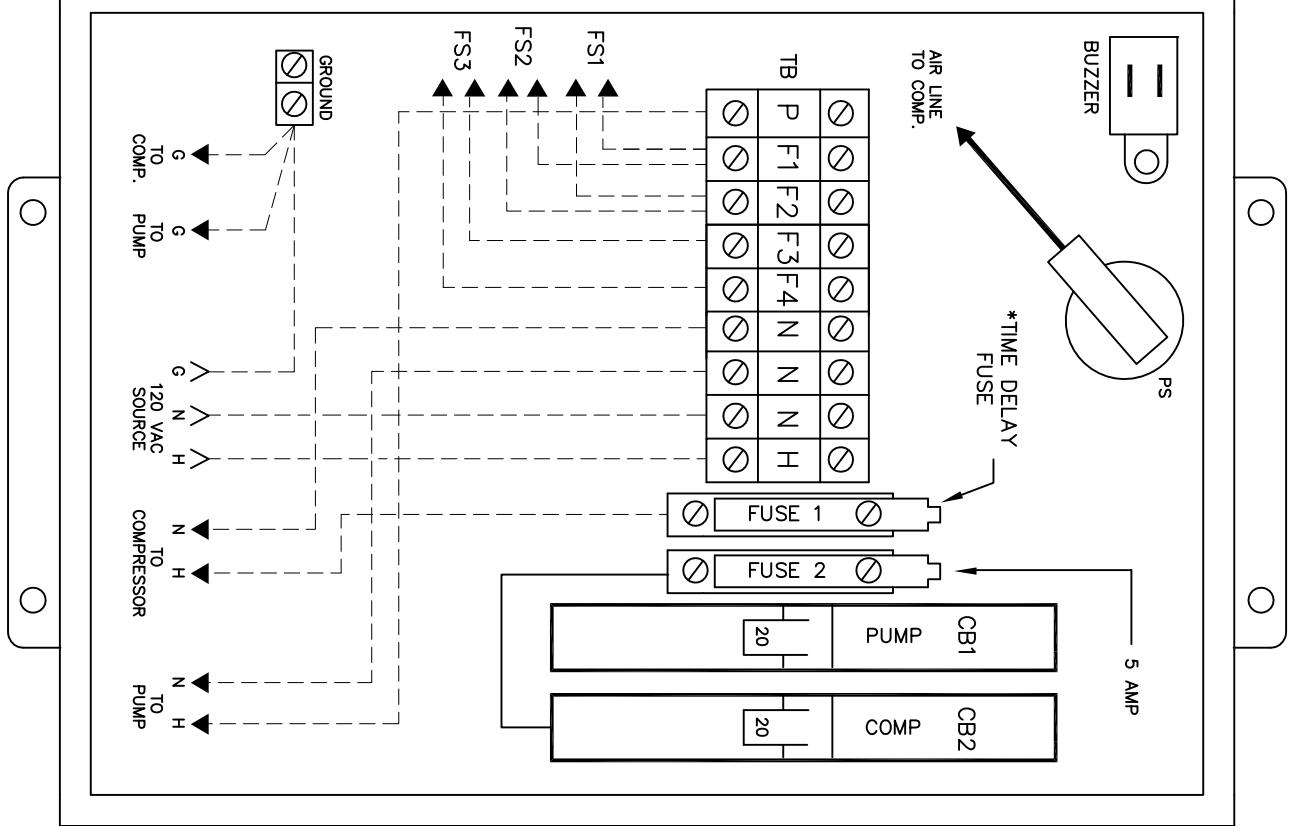

FS1 - FLOAT SWITCH IN DOSING TANK
FS2 - FLOAT SWITCH IN TREATMENT PLANT
FS3 - CLOCK OVERRIDE FLOAT SWITCH
* FUSE SIZE VARIES WITH COMPRESSOR SIZE
PER NATIONAL ELECTRIC CODE

DWG. CP-1425