

DUPLEX BLOWER
CONTROL PANEL
HIGHLAND ROAD SHELL STATION

Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727
(225) 665-6162 Fax (225) 664-9467

CP-2295

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	1/60	
NO. MOTORS	2	
HP	3	
FLA	17	
TYPE OF PUMP	Blower	(Self-Priming, Submersible)
MANUFACTURER		
CATALOG NUMBER		
CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR		(Floats, Bubbler, Other)
CAPACITORS		(Yes, No)
CAPACITOR WIRING FIGURE		
THERM. & SEAL FAIL WIRING FIGURE		

OPTIONS:

SEAL FAIL LIGHTS		(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN		(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT		
LIGHT PANEL MTD		
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER		
ELAPSED TIME METER		
PHASE MONITOR		
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		

SOLD TO: Delta Environmental - Denham Springs, LA
TAG : Highland Road Shell Station

SHIP TO: Delta Environmental - Denham Springs, LA



Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

DUPLEX BLOWER CONTROL PANEL



DWN BY:
C.RACHAL

DATE:
1/25/06

SCALE:
N.T.S.

DWG. NO.:
1 OF 6

JOB NO.:
CP-2295

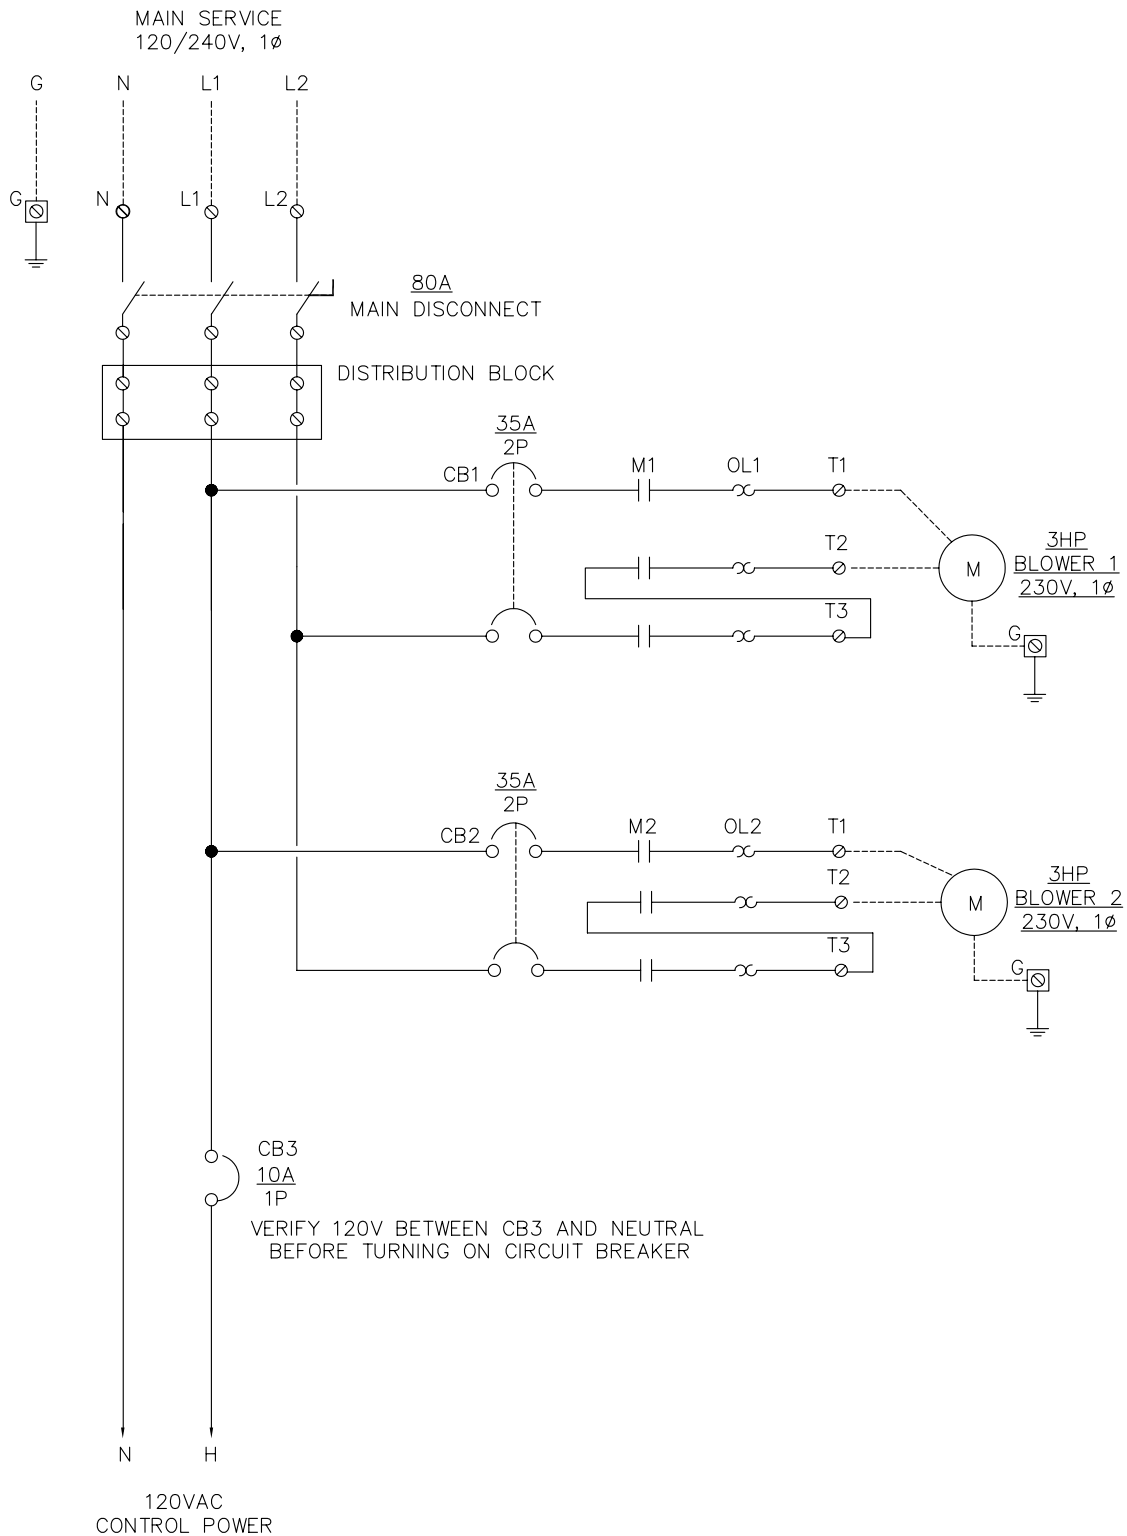

Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

DWN BY:
C.RACHAL


DATE:
1/25/06

SCALE:
N.T.S.

DWG. NO.:
2 OF 6

JOB NO.:
CP-2295


DUPLEX BLOWER CONTROL PANEL

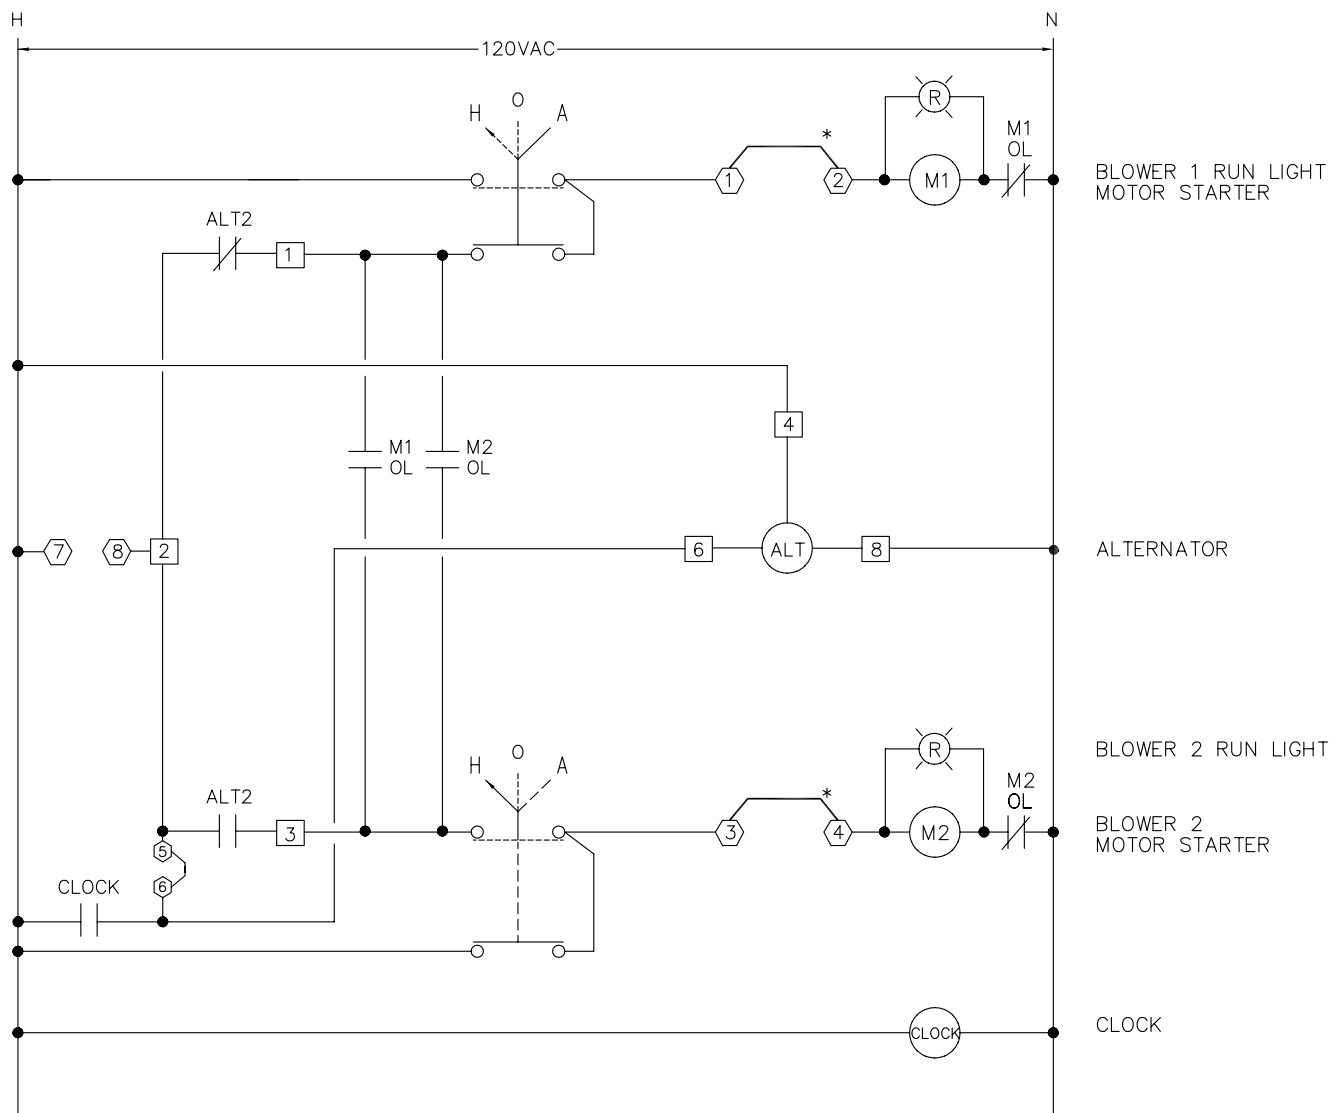

PANEL IS DESIGNED TO RUN AERATORS WITH A MINIMUM OF 15 MINUTES OF OFF TIME BETWEEN ALTERNATION. PINS PUSHED OUT ON CLOCK INDICATE RUN TIME. PINS PUSHED IN INDICATE OFF TIME. EACH PIN IS EQUAL TO 15 MINUTES.

IF NO OFF TIME IS REQUIRED BETWEEN ALTERNATION, REMOVE JUMPER FROM TERMINALS ⑤ AND ⑥ PLACE JUMPER ACROSS TERMINALS ⑦ AND ⑧ NOW AERATORS WILL RUN CONTINUOUSLY. SET 1 PIN IN AT THE TIME YOU WISH THE AERATORS TO ALTERNATE. ALL REMAINING PINS SHOULD BE PUSHED OUT.

* REMOVE JUMPERS AND INSTALL LOCKOUT DEVICES IF REQUIRED



Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

DWN BY:
C.RACHAL




DATE:
1/25/06

SCALE:
N.T.S.

DWG. NO.:
3 OF 6


JOB NO.:
CP-2295

DUPLEX BLOWER CONTROL PANEL

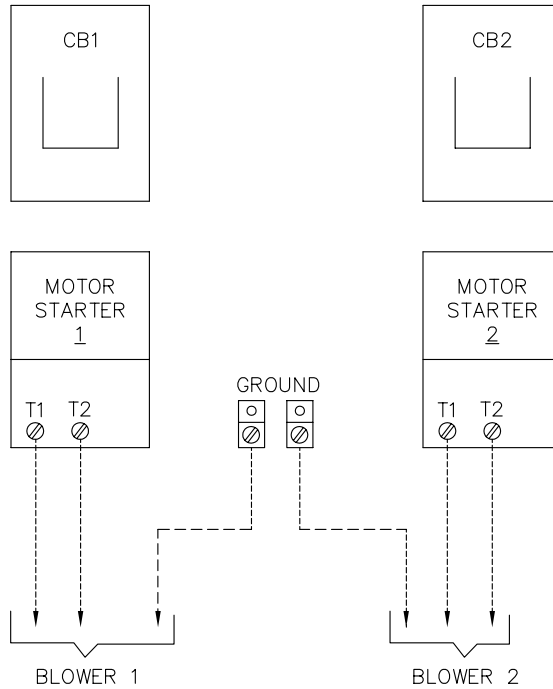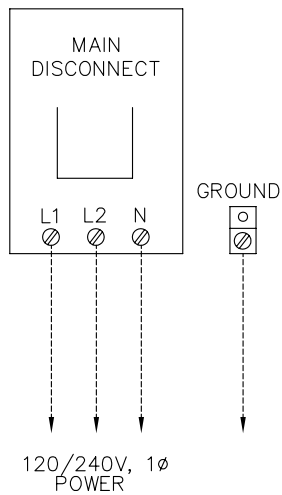


REMOVE JUMPERS & INSTALL
LOCKOUT DEVICES IF REQUIRED

IF NO OFF TIME IS REQUIRED BETWEEN
ALTERNATION, REMOVE JUMPER FROM
TERMINALS ⑤ AND ⑥ PLACE JUMPER ACROSS
TERMINALS ⑦ AND ⑧ NOW AERATORS WILL RUN
CONTINUOUSLY. SET 1 PIN IN AT THE TIME YOU
WISH THE AERATORS TO ALTERNATE.
ALL REMAINING PINS SHOULD BE PUSHED OUT.



DUPLEX BLOWER CONTROL PANEL

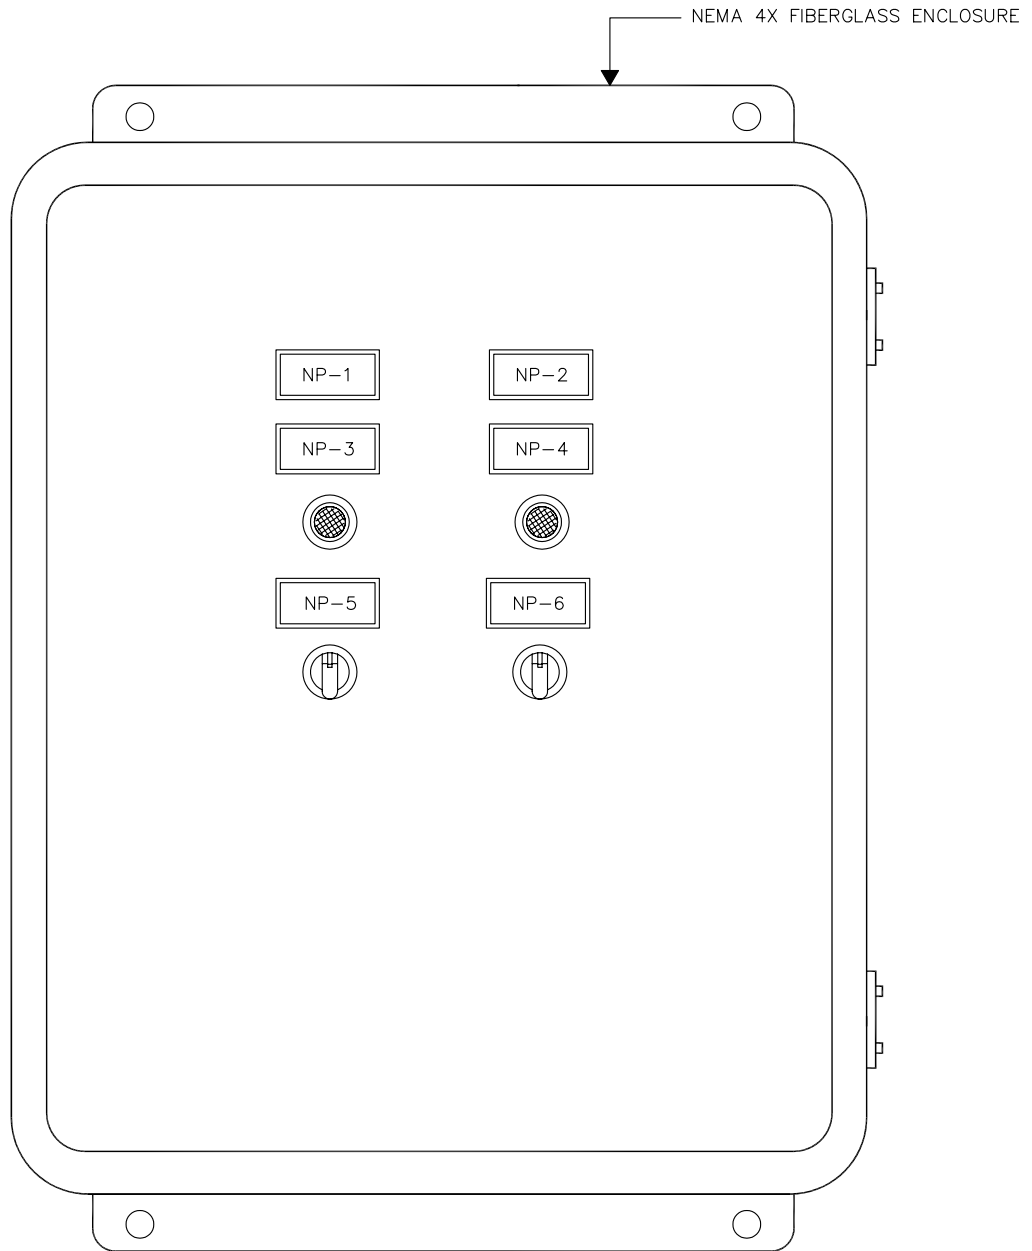


VIEW OF FRONT OF ENCLOSURE

NAMEPLATE SCHEDULE

NP-1	BLOWER 1
NP-2	BLOWER 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA

NOTE:

SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.



Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

DUPLEX BLOWER CONTROL PANEL

DWN BY:
C.RACHAL

DATE:
1/25/06

SCALE:
N.T.S.

DWG. NO.:
5 OF 6

JOB NO.:
CP-2295

BILL OF MATERIAL

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPL	ENCLOSURE
2	1	STAHLIN	BP1816AL	BACKPLATE
3	2	ABB	A16-30-10-84	STARTER
4	2	ABB	TA25DU19	O.L. (13-19A)
5	2	SQUARE D	QOU235	CIRCUIT BREAKER 1,2
6	1	ABB	OT63E3	DISC. SWITCH
7	2	ACI	JR22P3M20B	H.O.A. SWITCH
8	2	ACI	JR22FR	RED PILOT LIGHTS
9	1	TIMEMARK	261DT120	ALTERNATING RELAY
10	1	SQUARE D	QOU110	CB3
11	1	GRASSLIN	FM/1 STUZH-L	TIMER
12	1	MARATHON	1323580	DISTRIBUTION BLOCK



Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

DUPLEX BLOWER CONTROL PANEL

DWN BY:
C.RACHAL

DATE:
1/25/06

SCALE:
N.T.S.

DWG. NO.:
6 OF 6

JOB NO.:
CP-2295