
COX

Research and Technology, Inc.

DUPLEX PUMP
CONTROL PANEL
GEISMER VINYL
EFFLUENT PUMPS

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-1925


VOLTAGE	277/480V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	3/60	
NO. MOTORS	2	
HP	1.5	
FLA	3.5	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	BARNES	
CATALOG NUMBER		
CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	No	(Yes, No)
CAPACITOR WIRING FIGURE	N/A	
THERM. & SEAL FAIL WIRING FIGURE		


OPTIONS:

SEAL FAIL LIGHTS	X	(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER		
ELAPSED TIME METER		
PHASE MONITOR		
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION	X	


SOLD TO: Delta Process - Denham Springs, LA
TAG : Geismer Vinyl
Effluent Pumps

SHIP TO: Delta Process - Denham Springs, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 10/14/04		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div style="text-align: center;">  Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-1925
							SHEET NUMBER 1

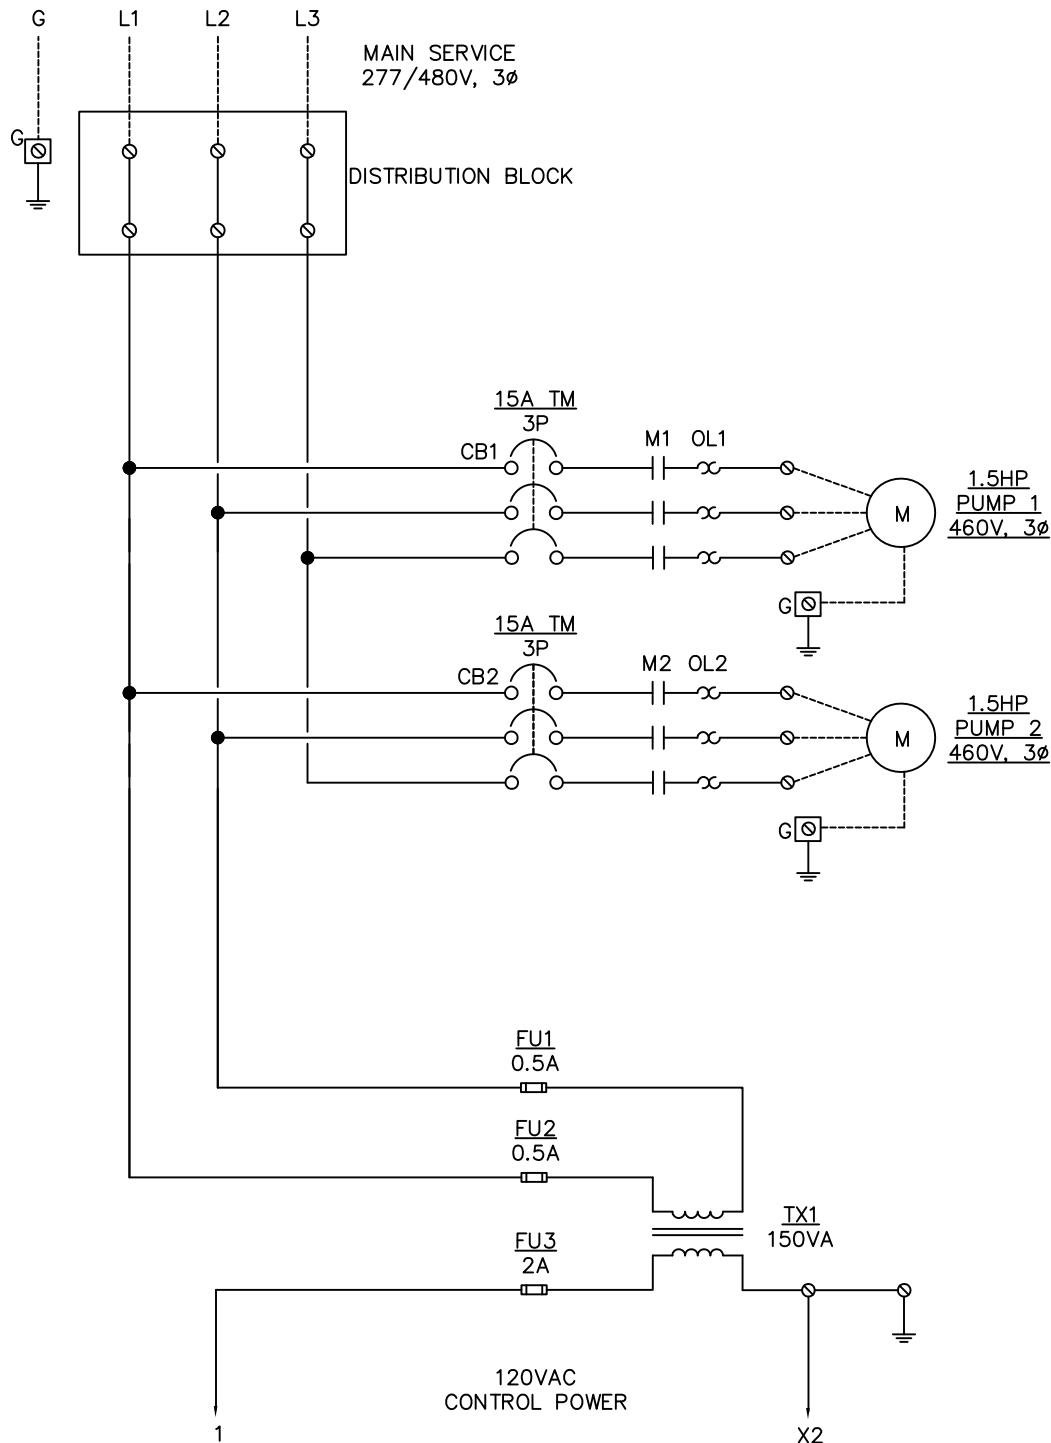

	Drawing Title							
	POWER DIAGRAM							
DATE		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	
10/14/04		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	APPROVED		
	Project Title				PURCHASE ORDER NUMBER			
	DUPLEX PUMP CONTROL PANEL	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-1925	
					SHEET NUMBER			2

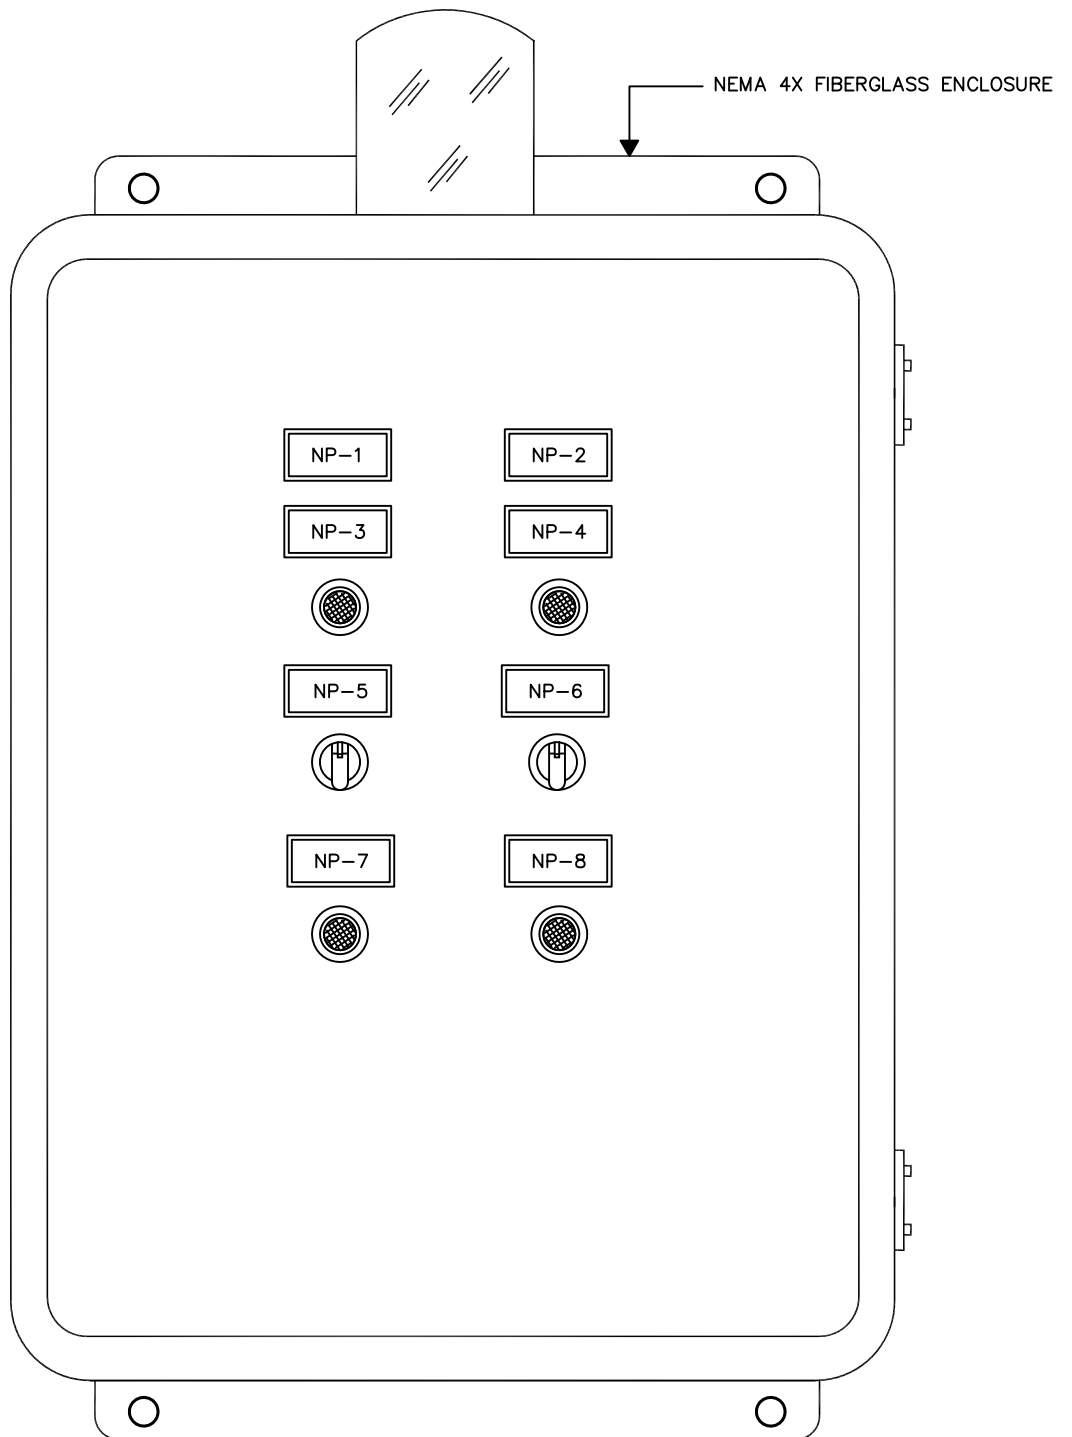

VIEW OF PANEL FRONT

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL

NOTE:
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

DATE 10/14/04	Drawing Title ENCLOSURE							
			REFERENCE DRAWING		NO.		REVISION-LOCATION	
			S/N		Sales Engineer		Application Engineer	
					C.C.		R.C.	
					BY		C. RACHAL	
					BY		DATE	
							PURCHASE ORDER NUMBER	
							DRAWING NUMBER	
							CP-1925	
							SHEET NUMBER	
							4	

Drawing Title

ENCLOSURE

DATE
10/14/04

Project Title

DUPLEX PUMP
CONTROL PANEL

COX

Research and Technology, Inc.

P.O. Box 77808
Baton Rouge, LA
70809

Ph. (225)756-3271
Fax (225)756-1030

PURCHASE ORDER NUMBER

DRAWING NUMBER
CP-1925

SHEET NUMBER
4

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	VYNCKIER	VJ1614HWPL	ENCLOSURE
1a	1	VYNCKIER	MP1614A	BACKPLATE
2	1	MARATHON	1323580	DISTRIBUTION BLOCK
3	2	ABB	A16-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU4.0	O.L. RELAY (2.8-4.0A)
5	2	ABB	S1N015TL	CB1, CB2
6	1	DIVERSIFIED	ARB-120-ADA	ALTERNATING RELAY
7	4	ACI	JR22FR	RED PILOT LIGHT
8	2	ACI	JR22P3M20B	HOA SWITCH
9	1	ABB	T4150PSF1	TRANSFORMER
10	1	INGRAM	MX-15	ALARM LIGHT
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

[illegible]