
COX

Research and Technology, Inc.

DUPLEX BLOWER
CONTROL PANEL
LAKE BISTINEAU

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-2367

VOLTAGE	<u>120/240V</u>	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	<u>1/60</u>	
NO. MOTORS	<u>2</u>	
HP	<u>7.5</u>	
FLA	<u>40 (EST.)</u>	
TYPE OF PUMP	<u>Blower</u>	(Self-Priming, Submersible)
MANUFACTURER	<u></u>	
CATALOG NUMBER	<u></u>	
CONTROL VOLTAGE	<u>120V</u>	(120V, Other)
ENCLOSURE	<u>NEMA 4X</u>	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	<u>Fiberglass</u>	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	<u></u>	(Floats, Bubbler, Other)
CAPACITORS	<u></u>	(Yes, No)
CAPACITOR WIRING FIGURE	<u></u>	
THERM. & SEAL FAIL WIRING FIGURE	<u></u>	


OPTIONS:

SEAL FAIL LIGHTS	<u></u>	(Submersible Only)
SEAL FAIL RELAYS	<u></u>	(Submersible Only)
SEAL FAIL PUMP SHUTDOWN	<u></u>	(Submersible Only)
HT PUMP SHUTDOWN	<u></u>	(Self-Primer, Submersible)
ALARM HORN	<u></u>	
ALARM LIGHT	<u></u>	
LIGHT PANEL MTD	<u></u>	
LIGHT REMOTE MTD	<u></u>	
LIGHT FLASHER	<u></u>	
LIGHTNING ARRESTER	<u></u>	
ELAPSED TIME METER	<u></u>	
PHASE MONITOR	<u></u>	
NEMA RATED STARTERS	<u></u>	
GROUND FAULT RECPT.	<u></u>	
GREEN RUN LIGHTS VS. RED	<u></u>	
POLE, BOX, SEAL	<u></u>	
INTRINSICALLY SAFE RELAYS	<u></u>	
HIGH TEMP. LOCKOUT, MANUAL RESET	<u></u>	
ECONOMY VERSION	<u></u>	


SOLD TO: Delta Process, Inc. -Bossier City, LA
TAG : LAKE BISTINEAU

SHIP TO: Delta Process, Inc. - Ruston, LA

	Drawing Title							
	PANEL DESCRIPTION							
DATE 4/20/06			REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title		<div style="text-align: center;"> COX Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030		PURCHASE ORDER NUMBER DRAWING NUMBER CP-2367 SHEET NUMBER 1
	DUPLUX BLOWER CONTROL PANEL							

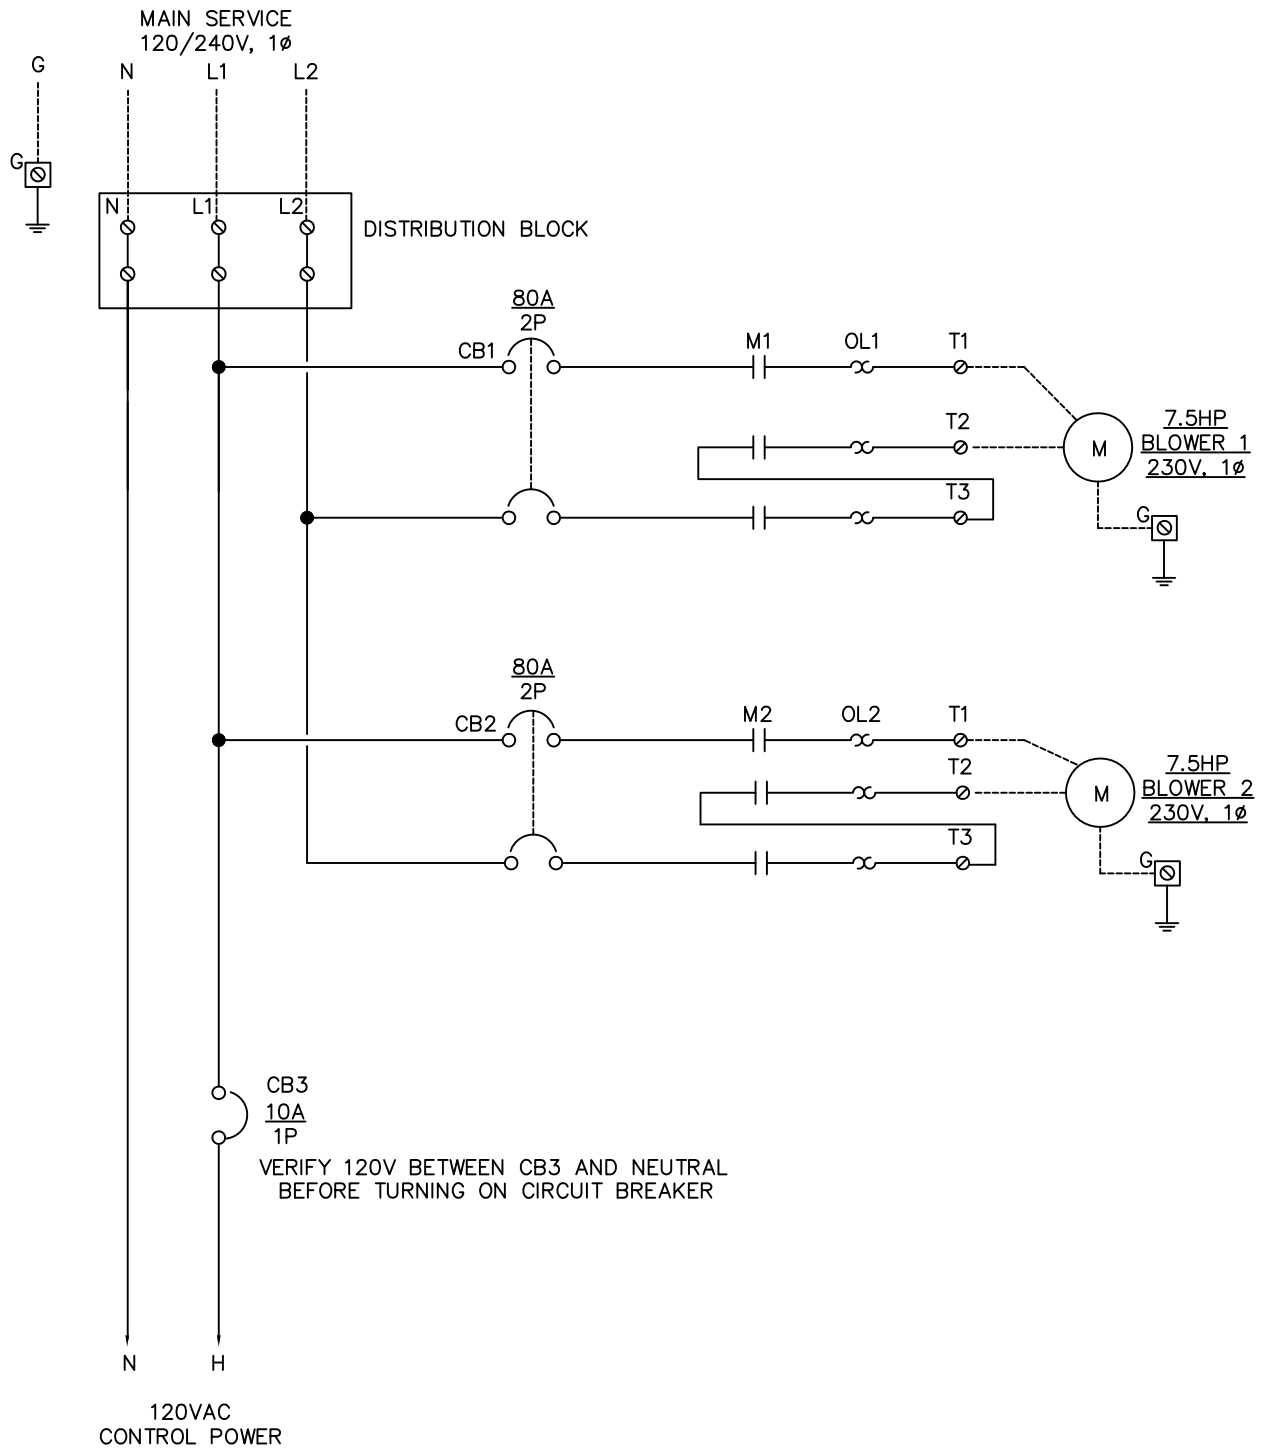

	Drawing Title POWER DIAGRAM								
DATE 4/20/06			REFERENCE DRAWING		NO.	REVISION-LOCATION		ECN	DATE
	S/N	Sales Engineer C.C.	Application Engineer R.C.		DRAWN BY C. RACHAL		APPROVED BY		DATE
	Project Title DUPLEX BLOWER CONTROL PANEL		<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030		PURCHASE ORDER NUMBER	
DRAWING NUMBER CP-2367									
SHEET NUMBER									
2									

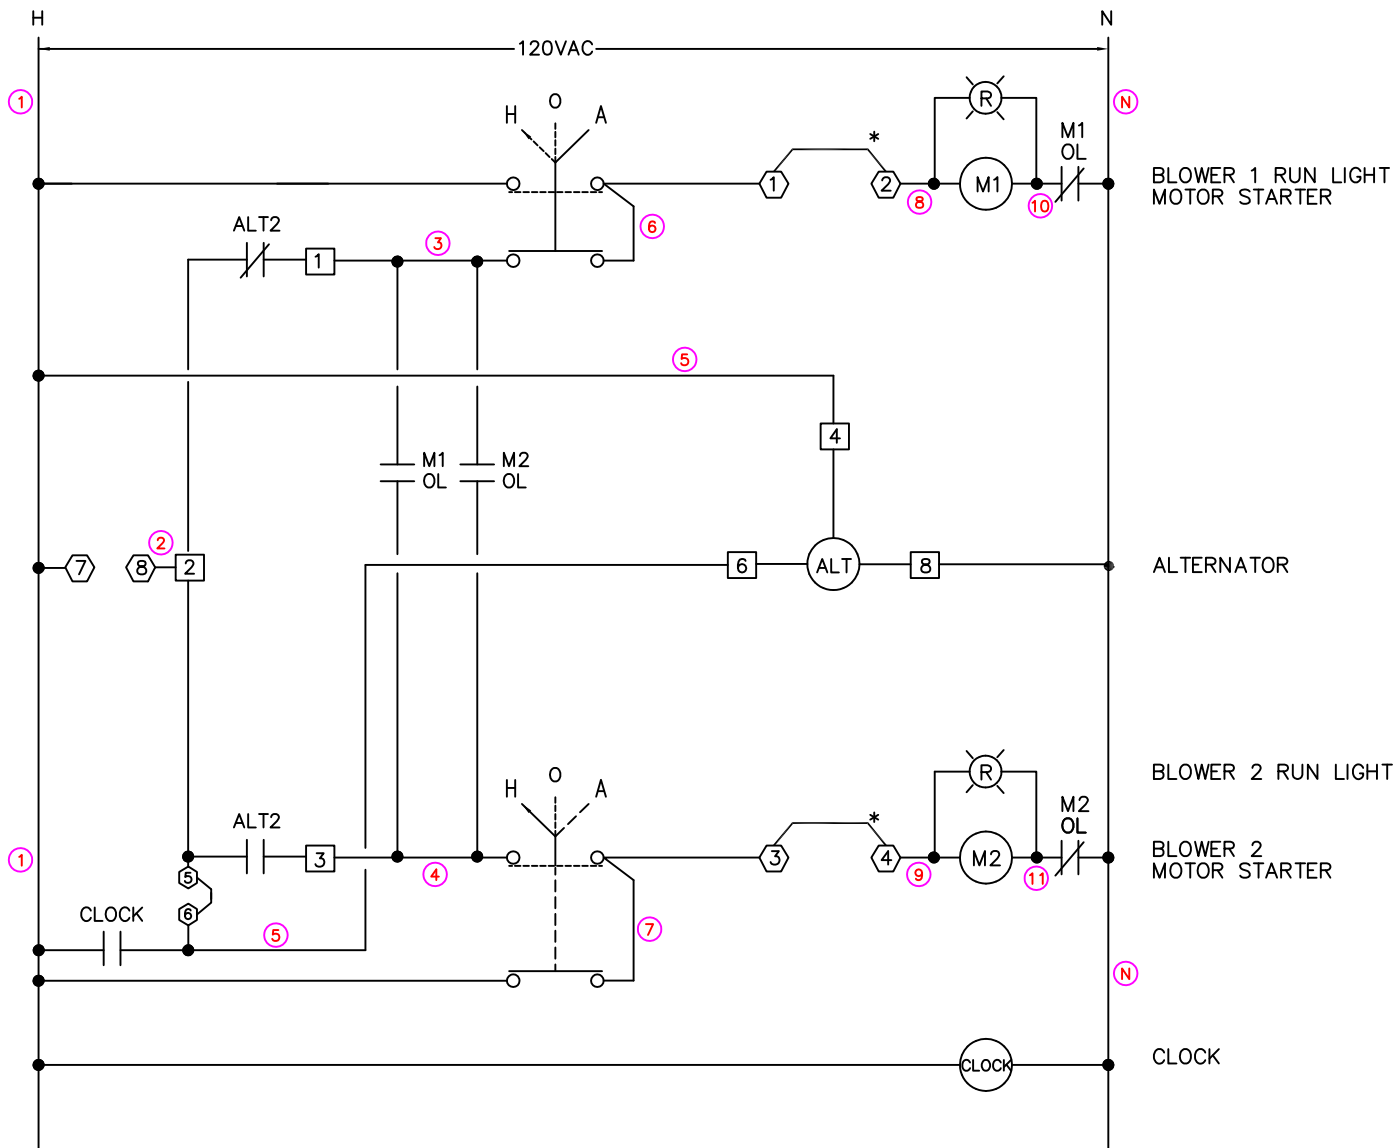

PANEL IS DESIGNED TO RUN BLOWERS WITH A MINIMUM OF 15 MINUTES OF OFF TIME BETWEEN ALTERNATION. PINS PUSHED OUT ON CLOCK INDICATE RUN TIME. PINS PUSHED IN INDICATE OFF TIME. EACH PIN IS EQUAL TO 15 MINUTES.


IF NO OFF TIME IS REQUIRED BETWEEN ALTERNATION, REMOVE JUMPER FROM TERMINALS ⑤ AND ⑥. PLACE JUMPER ACROSS TERMINALS ⑦ AND ⑧. NOW BLOWERS WILL RUN CONTINUOUSLY. SET 1 PIN IN AT THE TIME YOU WISH THE BLOWERS TO ALTERNATE. ALL REMAINING PINS SHOULD BE PUSHED OUT.

* REMOVE JUMPERS AND INSTALL LOCKOUT DEVICES IF REQUIRED

	Drawing Title 	
--	---	--



IF NO OFF TIME IS REQUIRED BETWEEN
ALTERNATION, REMOVE JUMPER FROM
TERMINALS ⑤ AND ⑥. PLACE JUMPER ACROSS
TERMINALS ⑦ AND ⑧. NOW BLOWERS WILL RUN
CONTINUOUSLY. SET 1 PIN IN AT THE TIME YOU
WISH THE BLOWERS TO ALTERNATE.
ALL REMAINING PINS SHOULD BE PUSHED OUT.

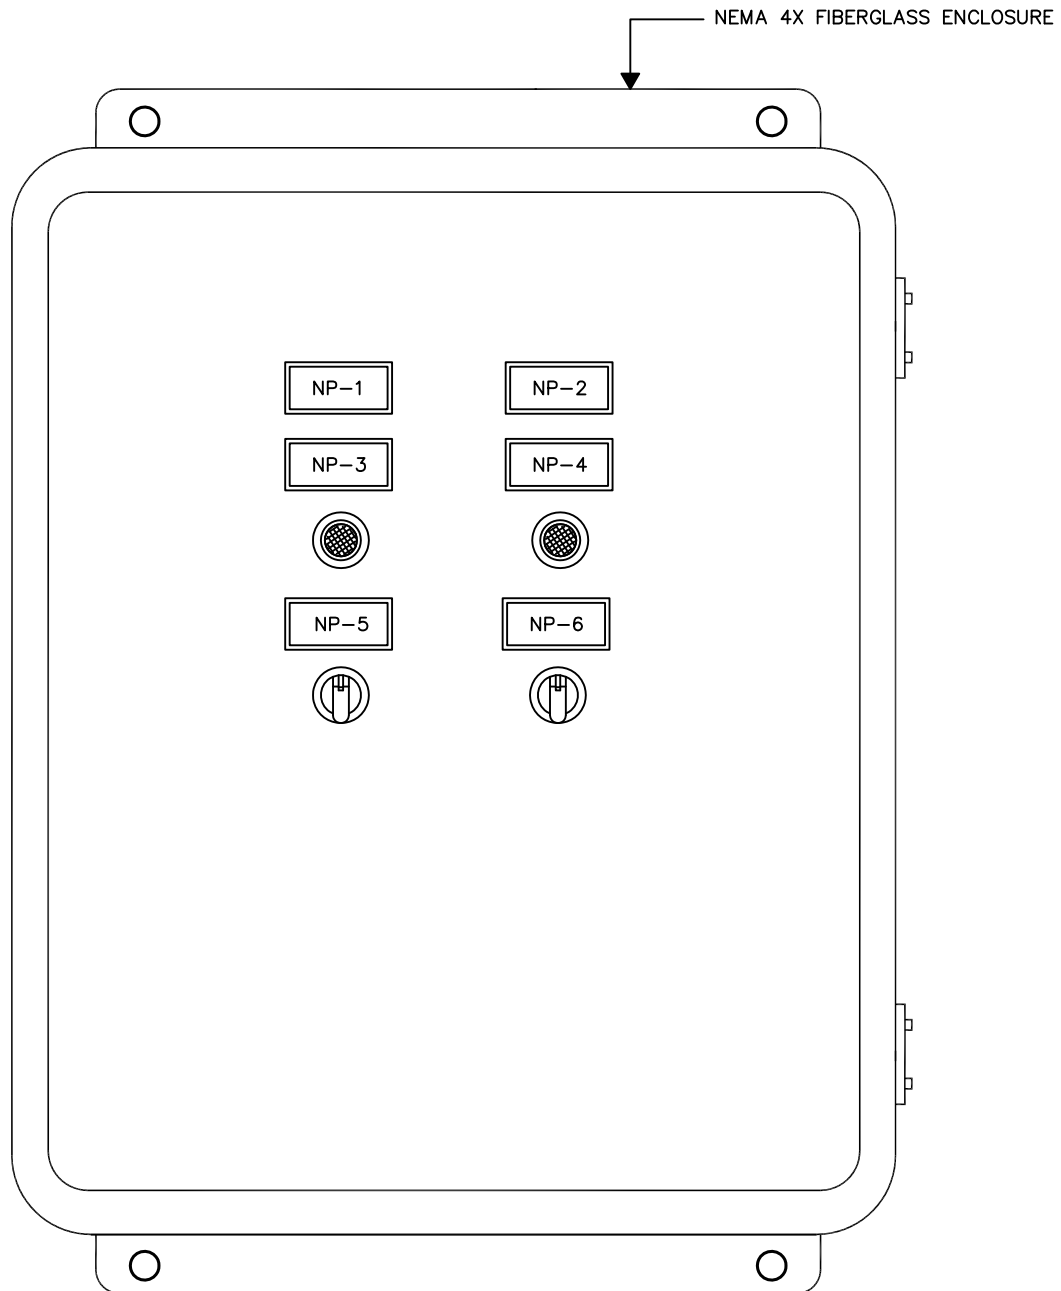

VIEW OF FRONT OF ENCLOSURE

NOTE:

SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

NAMEPLATE SCHEDULE

NP-1	BLOWER 1
NP-2	BLOWER 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA

	Drawing Title									
	ENCLOSURE									
DATE 4/20/06			REFERENCE DRAWING		NO.	REVISION-LOCATION		ECN	DATE	BY
			S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN		APPROVED		
	Project Title					BY C. RACHAL		BY	DATE	
	DUPLEX BLOWER CONTROL PANEL		<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030		PURCHASE ORDER NUMBER		
DRAWING NUMBER CP-2367										
SHEET NUMBER 5										

BILL OF MATERIAL

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPL	ENCLOSURE
2	1	STAHLIN	BP1816AL	BACKPLATE
3	2	ABB	A50-30-11-84	STARTER
4	2	ABB	TA75DU52	O.L. (36-52A)
5	2	SQUARE D	QOU280	CIRCUIT BREAKER 1,2
6	1	MARATHON	1323580	DISTRIBUTION BLOCK
7	2	ACI	JR22P3M20B	H.O.A. SWITCH
8	2	ACI	JR22FR	RED PILOT LIGHTS
9	1	TIMEMARK	261DT120	ALTERNATING RELAY
10	1	GRASSLIN	FM1/STUZZ	TIMER
11	1	SQUARE D	QOU110	CB3
12				

[illegible]