

COX

Research and Technology, Inc.


LIVINGSTON
WASTEWATER TREATMENT
PLANT
ANNUNCIATOR
CONTROL PANEL

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-1916

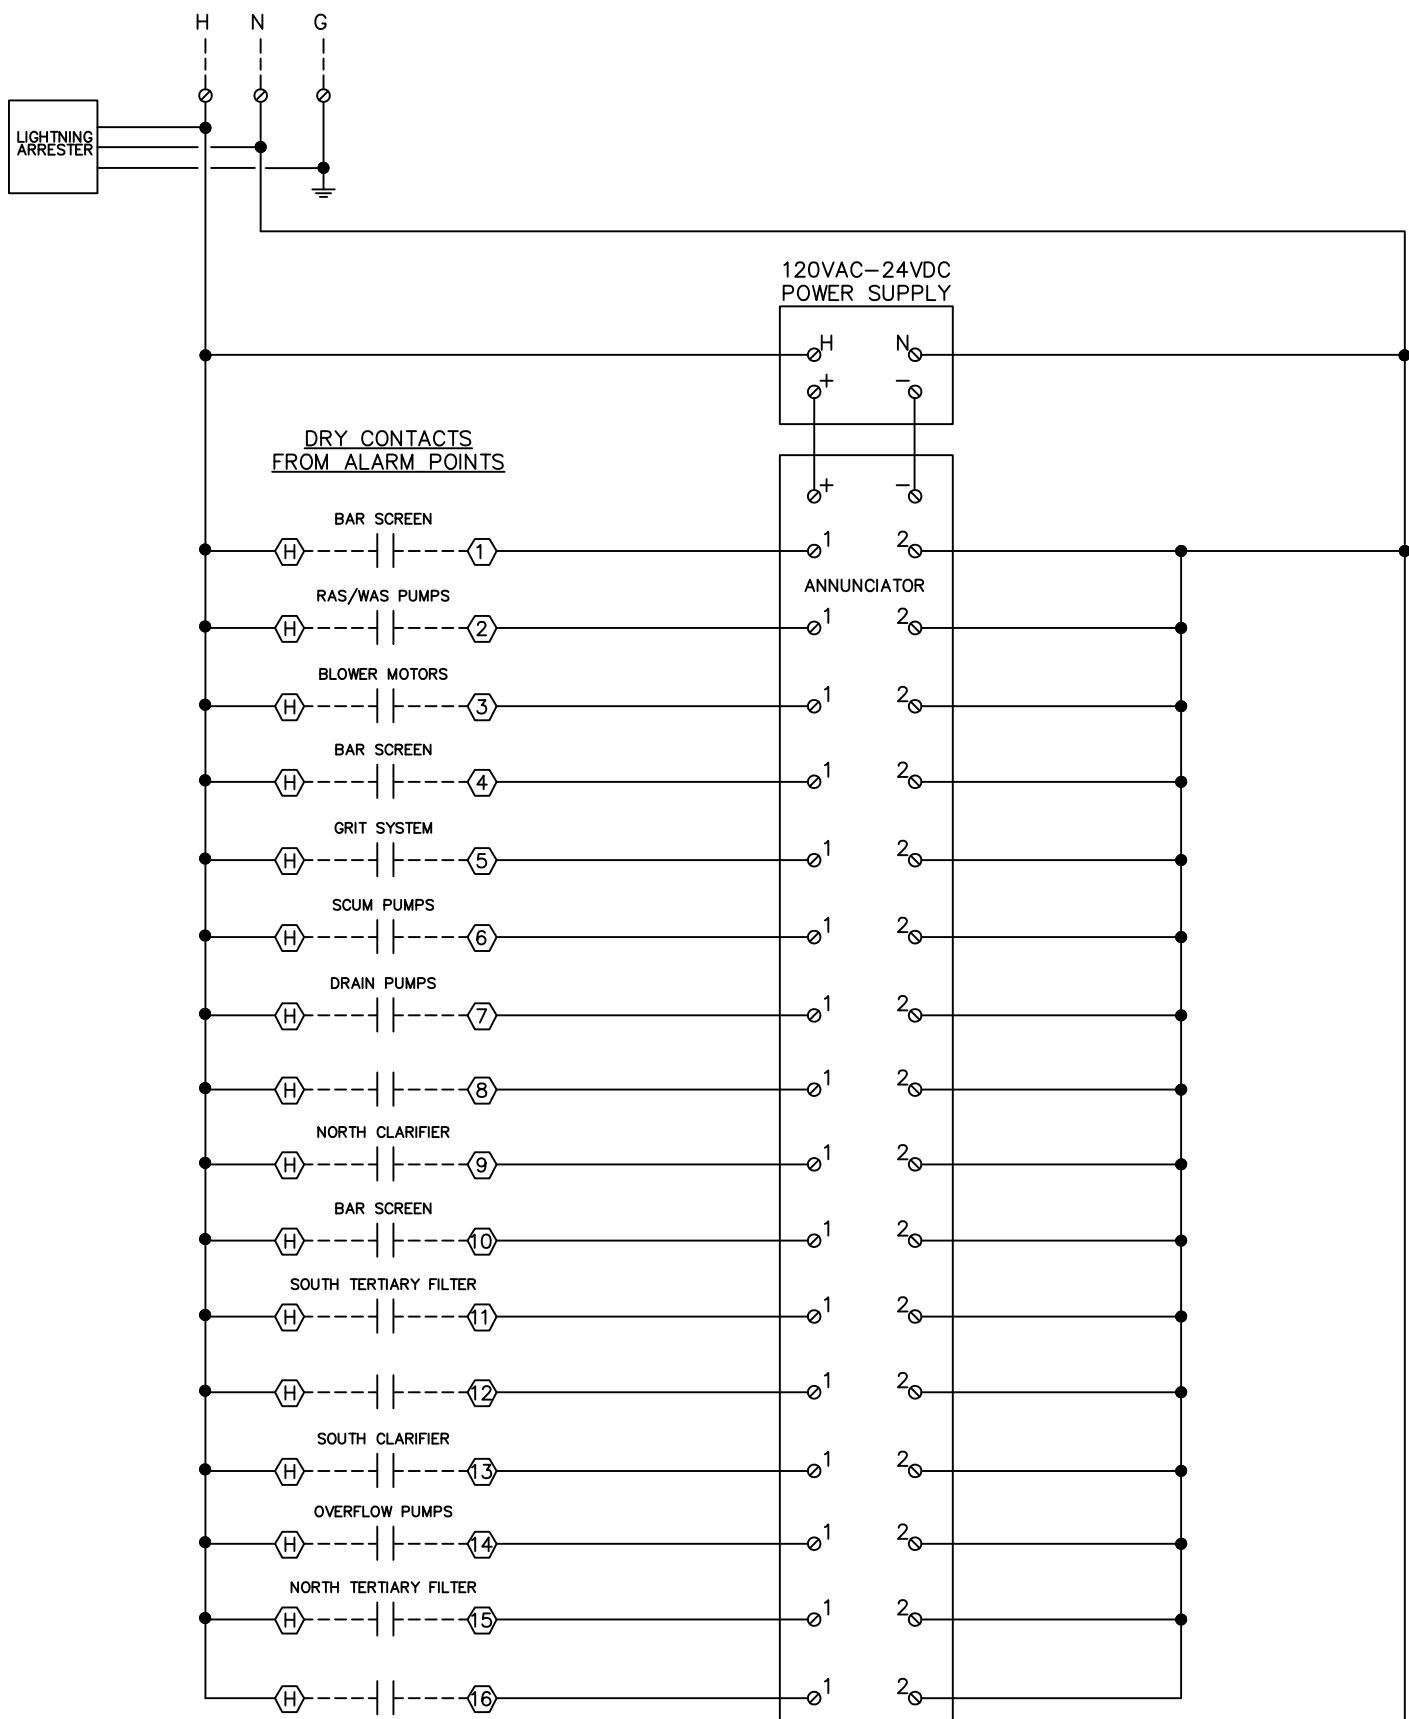


| | Drawing Title | | | | | | | | | |
|-----------------|------------------------------|----------------|---|------|--|-------------------|-----------------------|-----|----------|------|
| | POWER/CONTROL DIAGRAM | | | | | | | | | |
| DATE 9/29/04 | | | REFERENCE DRAWING | | NO. | REVISION-LOCATION | | ECN | DATE | BY |
| | S/N | Sales Engineer | Application Engineer | C.C. | R.C. | DRAWN | BY C. RACHAL | BY | APPROVED | DATE |
| | Project Title | | | | | | | | | |
| | ANNUNCIATOR CONTROL PANEL | | COX Research and Technology, Inc. | | P.O. Box 77808 Baton Rouge, LA 70809 | | PURCHASE ORDER NUMBER | | | |
| | | | | | | | DRAWING NUMBER | | CP-1916 | |
| | | | | | | | SHEET NUMBER | | 1 | |

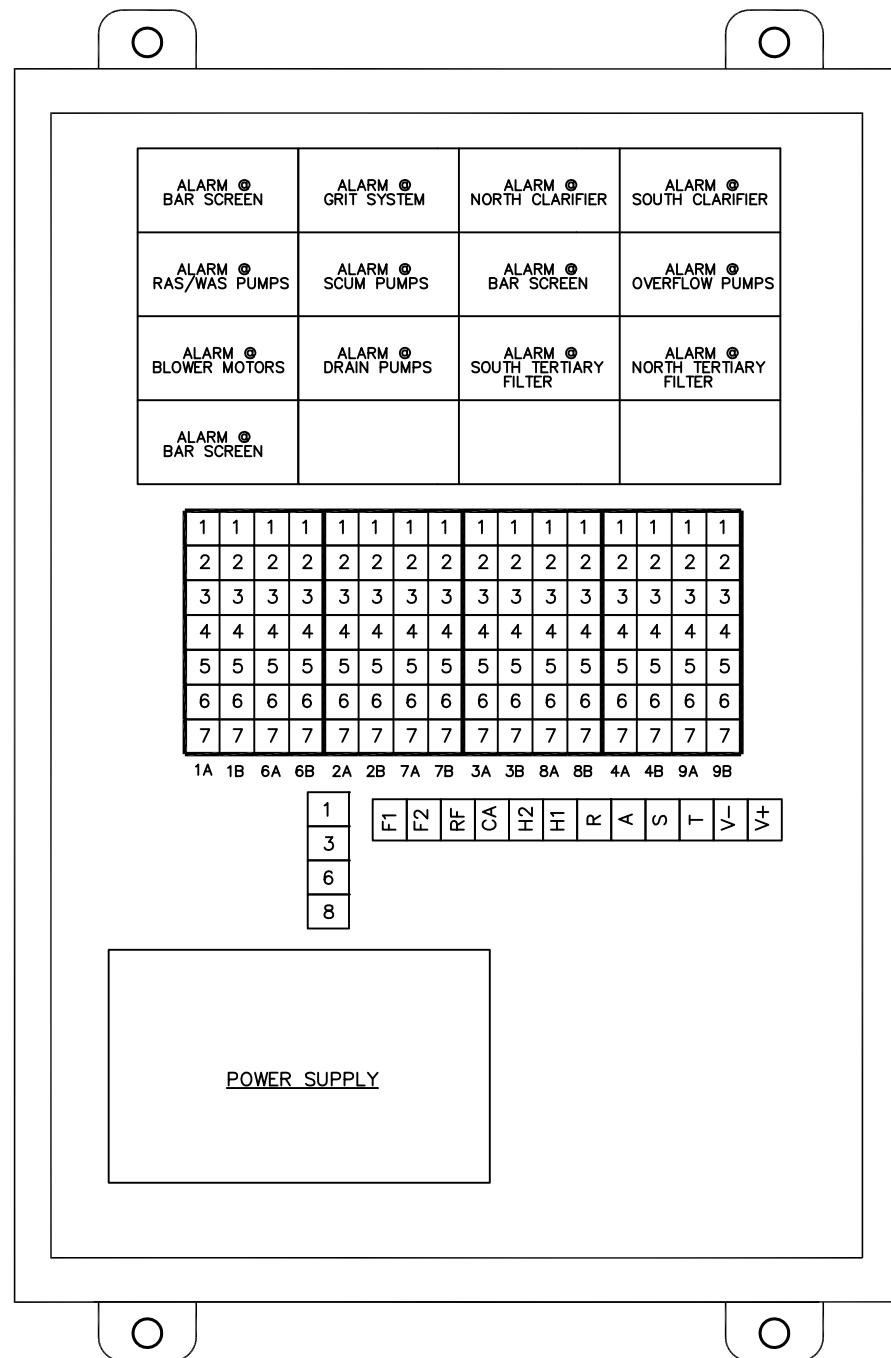

VIEW OF INSIDE OF PANEL

| | | | | | | |
|-----------------|--|--|--|---|---------|----|
| | Drawing Title ENCLOSURE REFERENCE DRAWING S/N | | | | | |
| | | | | | | |
| | | | | | | |
| | | NO. C.C. | REVISION-LOCATION DRAWN R.C. BY C. RACHAL | ECN | DATE | BY |
| DATE 9/29/04 | Project Title ANNUNCIATOR CONTROL PANEL | P.O. Box 77808 Baton Rouge, LA 70809 | APPROVED BY DATE | | | |
| | | COX Research and Technology, Inc. | Ph. (225)756-3271 Fax (225)755-1030 | PURCHASE ORDER NUMBER DRAWING NUMBER SHEET NUMBER | CP-1916 | 2 |

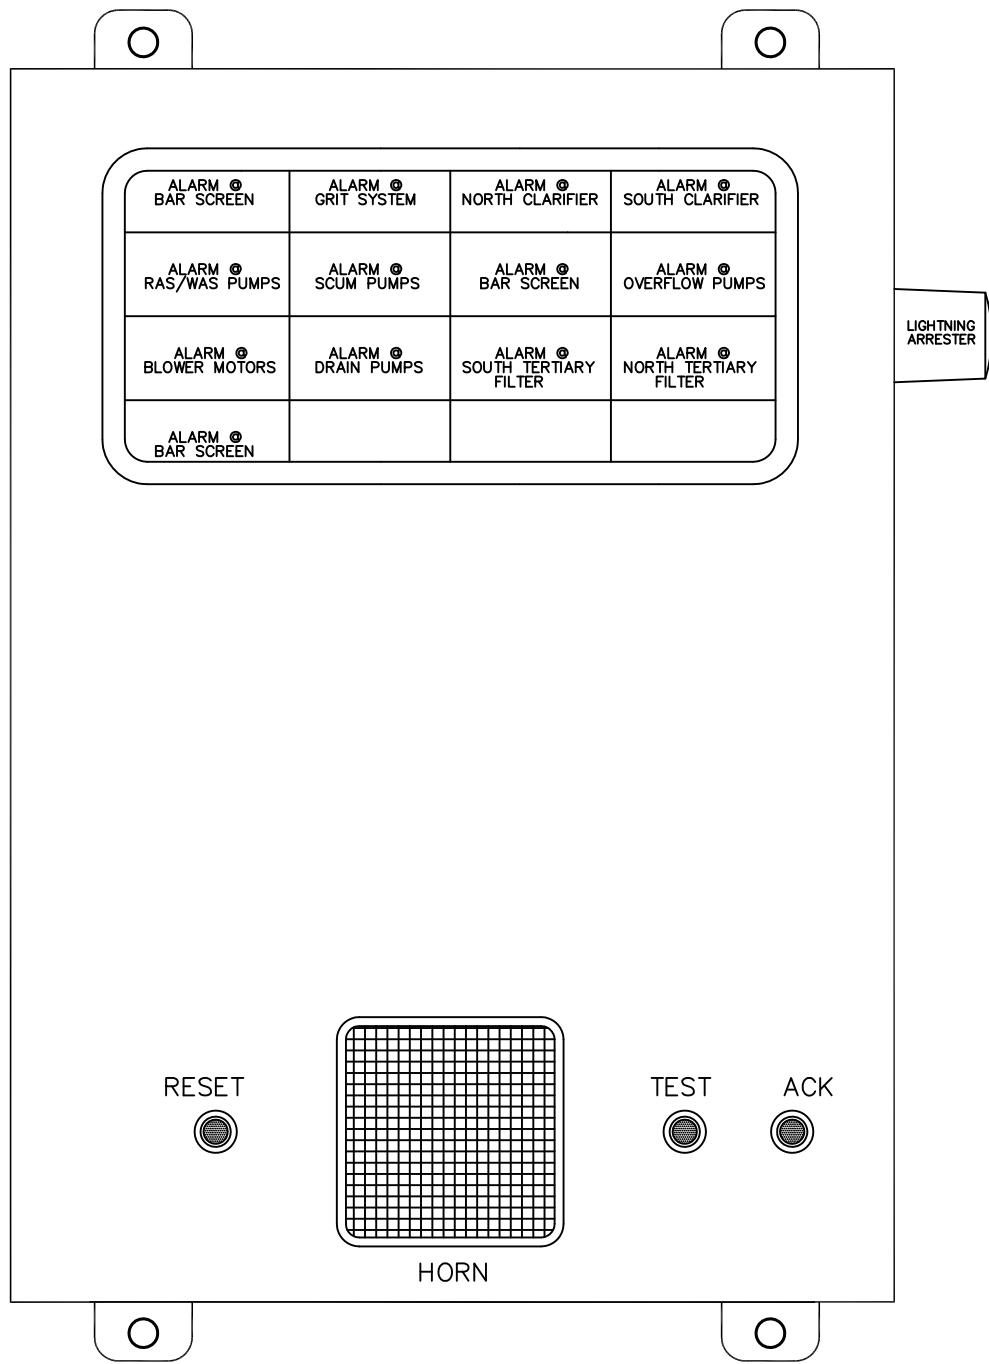

VIEW OF OUTSIDE OF PANEL

| | | | | | | |
|-----------------|------------------------------|--|----------------------|--------------|-----------------------|---------|
| | Drawing Title | | | | | |
| | ENCLOSURE | | | | | |
| DATE 9/29/04 | REFERENCE DRAWING | NO. | REVISION-LOCATION | ECN | DATE | BY |
| | S/N | Sales Engineer | Application Engineer | DRAWN | APPROVED | |
| | | C.C. | R.C. | BY C. RACHAL | BY | DATE |
| | Project Title | <hr/> <hr/> <hr/> COX <hr/> <hr/> | | | PURCHASE ORDER NUMBER | |
| | ANNUNCIATOR CONTROL PANEL | Research and Technology, Inc. | | | DRAWING NUMBER | CP-1916 |
| | | | | | SHEET NUMBER | 3 |

BILL OF MATERIAL

| ITEM | QTY | DESCRIPTION | PART NO. |
|------|-----|-------------------------------|--------------------|
| 1 | 8 | RONAN X12 ANNUNCIATOR CHASSIS | 4-4-X12SM-2000 |
| 2 | 8 | LAMP MODULE | LM2-24 |
| 3 | 1 | FLAHSER/HORN DRIVER | FHD24-0-0-0 |
| 4 | 1 | RF FILTER MODULE | RF-24-1 |
| 5 | 3 | OIL TIGHT PUSH BUTTON | 202B |
| 6 | 15 | ALARM MODULES | AM-X000 |
| 7 | 1 | POWER SUPPLY | 115-24-125 |
| 8 | 1 | ANNUNCIATOR HORN | X36SM-24VDC |
| 9 | 1 | HORN RELAY WITH RELAY BASE | KRP24VDVCw/146-103 |
| 10 | 1 | NEMA 12 ENCLOSURE | 30"X24"X10"N12 |
| 11 | 8 | ALARM POINT WIRING | WIRING |
| 12 | 3 | PUSH BUTTON WIRING | WIRING |
| 13 | 1 | HORN RELAY WIRING | WIRING |
| 14 | 1 | HORN WIRING | WIRING |
| 15 | 1 | POWER SUPPLY WIRING | WIRING |
| 16 | 1 | CUTLER HAMMER | CHSA01 |

| | | | | | | | | |
|-----------------|------------------------------|----------------|-------------------------------|-------------------|--|----------|---|----|
| | Drawing Title | | | | | | | |
| | BILL OF MATERIALS | | | | | | | |
| DATE 9/29/04 | REFERENCE DRAWING | | NO. | REVISION-LOCATION | | ECN | DATE | BY |
| | S/N | Sales Engineer | Application Engineer | DRAWN | | APPROVED | | |
| | C.C. | R.C. | BY C. RACHAL | BY | DATE | | | |
| | Project Title | | COX | | P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030 | | PURCHASE ORDER NUMBER DRAWING NUMBER CP-1916 SHEET NUMBER 4 | |
| | ANNUNCIATOR CONTROL PANEL | | Research and Technology, Inc. | | | | | |
| | | | | | | | | |